

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696362

Luminaire Tested: **MRI-FEU4C-10-L935 F4X-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696362
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-10-L935 F4X-M-X-H
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 769.0 lumens
Efficiency: N/A
Efficacy: 78.9 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696362
CATALOG NUMBER: MRI-FEU4C-10-L935 F4X-M-X-H

Luminous Intensity Polar Plot

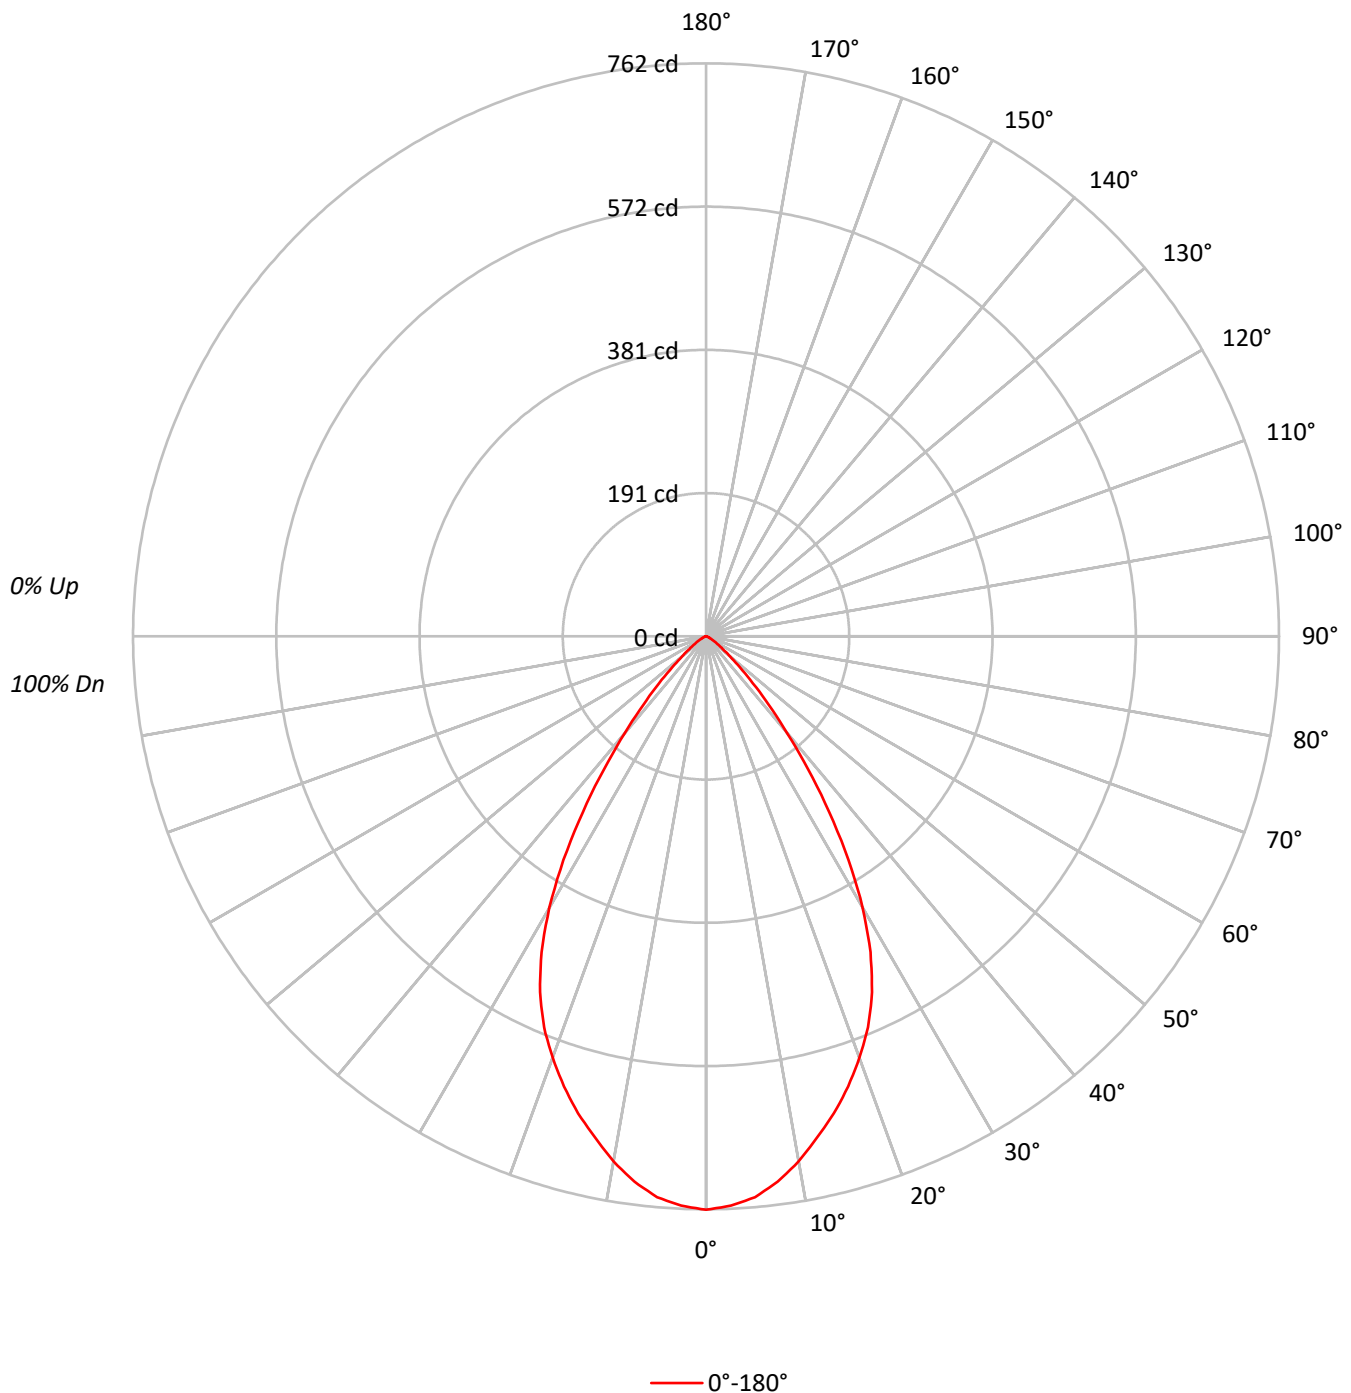



TEST NUMBER: P696362

CATALOG NUMBER: MRI-FEU4C-10-L935 F4X-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93		
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85		
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79		
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73		
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67		
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62		
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58		
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54		
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50		
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	93676
5°	92319
10°	88459
15°	83549
20°	77985
25°	70800
30°	59113
35°	42818
40°	26798
45°	15324
50°	7989
55°	4477
60°	2850
65°	1686
70°	1257
75°	570
80°	849
85°	0



TEST NUMBER: P696362
 CATALOG NUMBER: MRI-FEU4C-10-L935 F4X-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	70.2	9.1
10°-20°	184.1	23.9
20°-30°	236.6	30.8
30°-40°	178.0	23.1
40°-50°	71.5	9.3
50°-60°	20.3	2.6
60°-70°	6.4	0.8
70°-80°	1.9	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	490.8	63.8
0°-40°	668.8	87.0
0°-60°	760.6	98.9
0°-90°	769.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	769.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	762	
5°	749	70
15°	657	184
25°	522	237
35°	286	178
45°	88	71
55°	21	20
65°	6	6
75°	1	2
85°	0	0
90°	0	



TEST NUMBER: P696362
CATALOG NUMBER: MRI-FEU4C-10-L935 F4X-M-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	762.5
2.5°	757.9
5°	748.6
7.5°	731.2
10°	709.1
12.5°	682.4
15°	656.9
17.5°	627.9
20°	596.5
22.5°	562.9
25°	522.3
27.5°	473.5
30°	416.7
32.5°	352.8
35°	285.5
37.5°	222.8
40°	167.1
42.5°	123.0
45°	88.2
47.5°	60.4
50°	41.8
52.5°	29.0
55°	20.9
57.5°	15.1
60°	11.6
62.5°	8.1
65°	5.8
67.5°	4.6
70°	3.5
72.5°	2.3
75°	1.2
77.5°	1.2
80°	1.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)