

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696518

Luminaire Tested: **MRI-FEU4C-15-L930 F4X-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696518
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-15-L930 F4X-N-X-H
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 4LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 965.1 lumens
Efficiency: N/A
Efficacy: 61.1 lumens/watt
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696518
CATALOG NUMBER: MRI-FEU4C-15-L930 F4X-N-X-H

Luminous Intensity Polar Plot

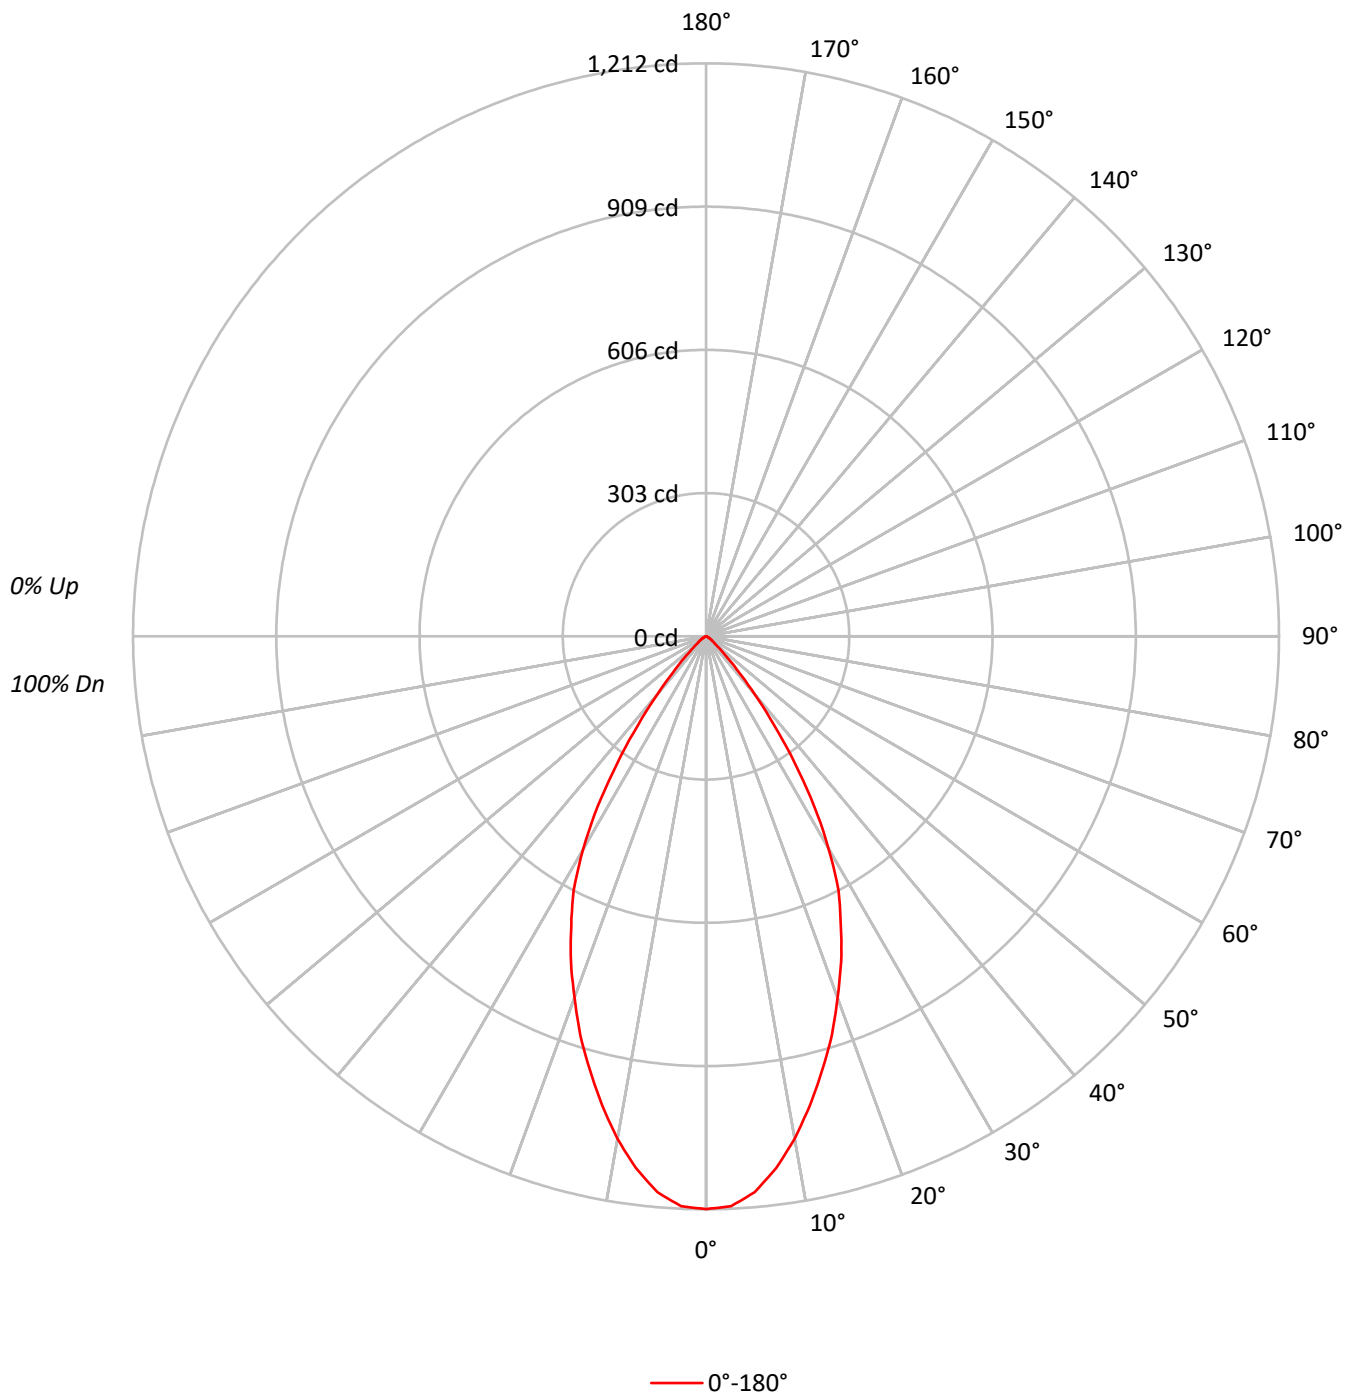



TEST NUMBER: P696518

CATALOG NUMBER: MRI-FEU4C-15-L930 F4X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50			
RCR																						
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102	100
1	113	111	108	106		111	109	106	104		105	103	101		101	99	98		97	96	95	93
2	108	103	99	96		106	101	98	94		98	95	92		95	93	90		92	90	89	87
3	102	96	91	87		100	95	90	86		92	88	85		90	86	84		87	85	82	81
4	97	90	84	80		95	89	83	79		86	82	78		84	81	78		83	79	77	75
5	92	84	78	74		91	83	78	73		81	76	73		80	75	72		78	74	72	70
6	88	79	73	69		86	78	72	68		76	72	68		75	71	67		74	70	67	65
7	83	74	68	64		82	73	68	64		72	67	63		71	66	63		70	66	63	61
8	79	70	64	60		78	69	64	60		68	63	59		67	63	59		66	62	59	58
9	76	66	60	56		74	65	60	56		65	59	56		64	59	56		63	59	55	54
10	72	62	57	53		71	62	56	53		61	56	53		60	56	52		60	55	52	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	148849
5°	145533
10°	134566
15°	120739
20°	106290
25°	91472
30°	73667
35°	49042
40°	25515
45°	11554
50°	5008
55°	3363
60°	2162
65°	1541
70°	1257
75°	854
80°	0
85°	0



TEST NUMBER: P696518
 CATALOG NUMBER: MRI-FEU4C-15-L930 F4X-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	109.3	11.3
10°-20°	265.2	27.5
20°-30°	307.9	31.9
30°-40°	203.9	21.1
40°-50°	57.2	5.9
50°-60°	14.4	1.5
60°-70°	5.4	0.6
70°-80°	1.9	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	682.3	70.7
0°-40°	886.2	91.8
0°-60°	957.8	99.2
0°-90°	965.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	965.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1212	
5°	1180	109
15°	949	265
25°	675	308
35°	327	204
45°	66	57
55°	16	14
65°	5	5
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P696518

CATALOG NUMBER: MRI-FEU4C-15-L930 F4X-N-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1211.6
2.5°	1206.3
5°	1180.1
7.5°	1134.6
10°	1078.7
12.5°	1015.7
15°	949.3
17.5°	884.6
20°	813.0
22.5°	746.5
25°	674.8
27.5°	606.7
30°	519.3
32.5°	426.6
35°	327.0
37.5°	234.3
40°	159.1
42.5°	103.1
45°	66.5
47.5°	40.2
50°	26.2
52.5°	19.2
55°	15.7
57.5°	12.3
60°	8.8
62.5°	7.0
65°	5.3
67.5°	3.5
70°	3.5
72.5°	1.8
75°	1.8
77.5°	1.8
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)