

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696554

Luminaire Tested: **MRI-FEU4C-15-L935 F4X-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696554
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-15-L935 F4X-N-X-H
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 979.0 lumens
Efficiency: N/A
Efficacy: 62.0 lumens/watt
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696554
CATALOG NUMBER: MRI-FEU4C-15-L935 F4X-N-X-H

Luminous Intensity Polar Plot

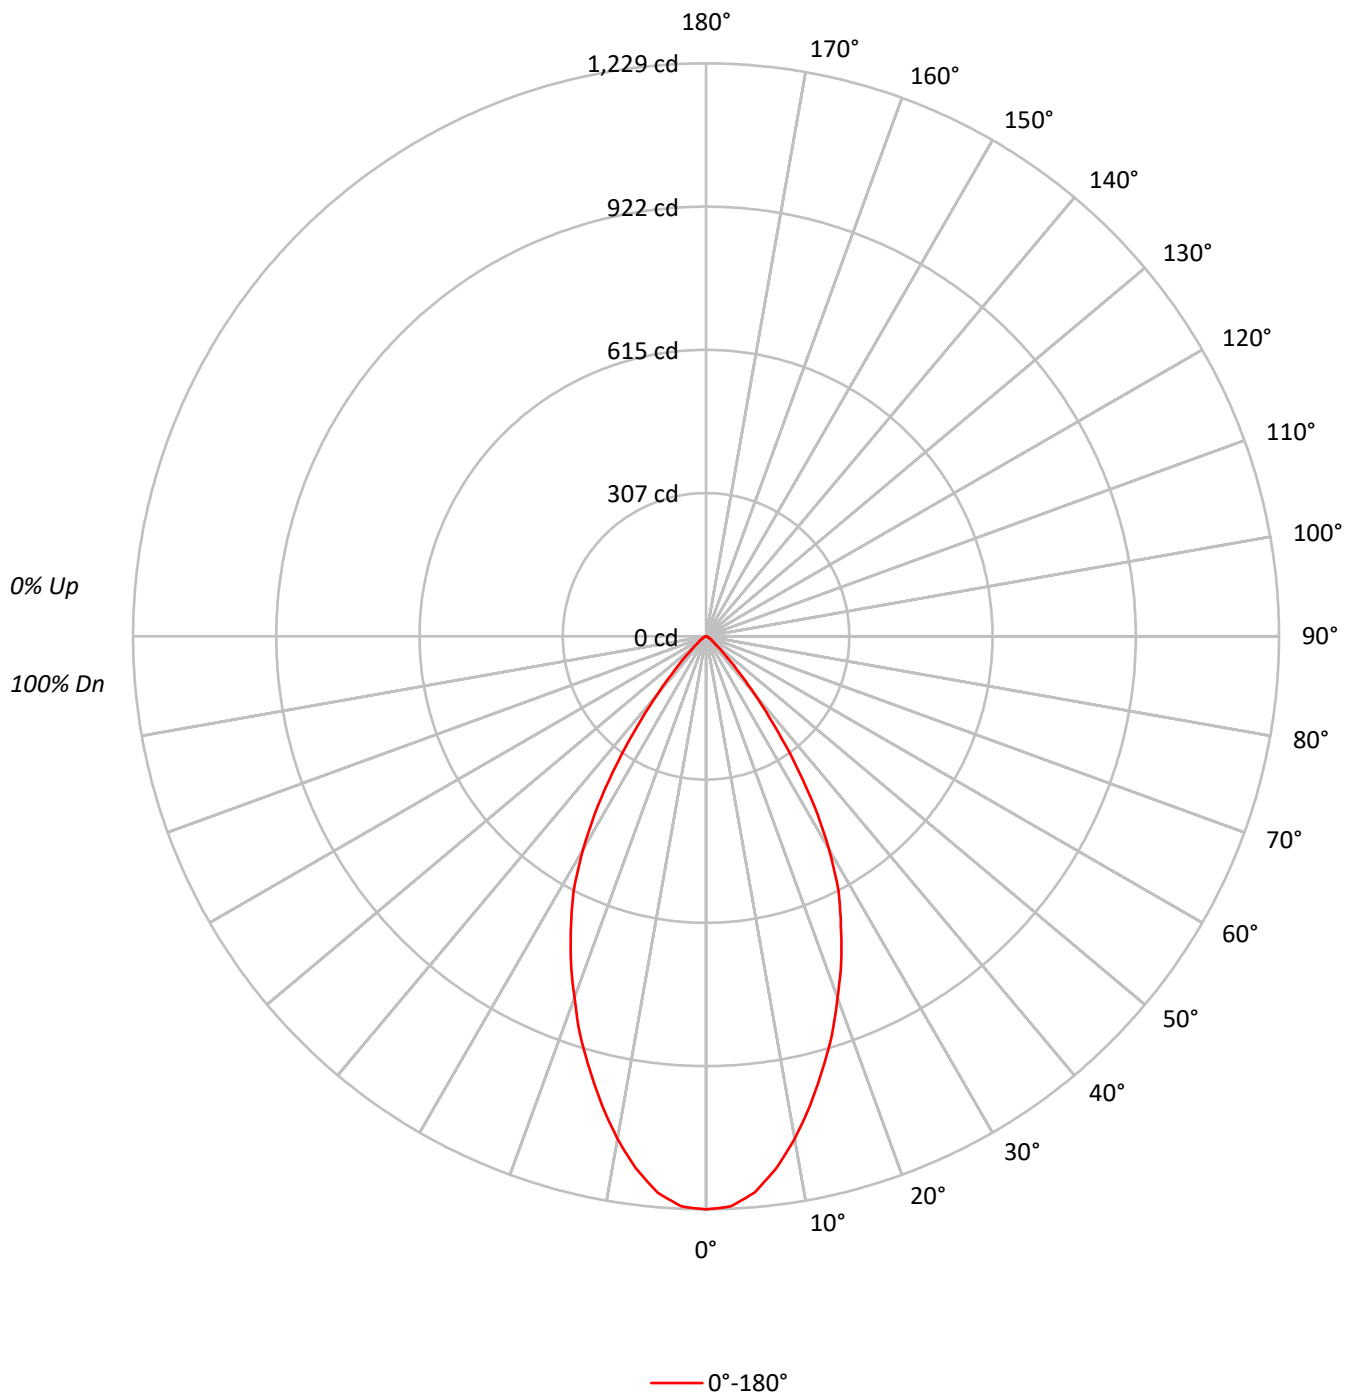



TEST NUMBER: P696554

CATALOG NUMBER: MRI-FEU4C-15-L935 F4X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	93		
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75		
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70		
6	88	79	73	69	86	78	72	68	76	72	68	75	71	67	74	70	67	65		
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61		
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58		
9	76	66	60	56	74	65	60	56	65	59	56	64	59	56	63	59	55	54		
10	72	62	57	53	71	62	56	53	61	56	53	60	56	52	60	55	52	51		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	151011
5°	147642
10°	136512
15°	122494
20°	107833
25°	92800
30°	74731
35°	49747
40°	25884
45°	11710
50°	5084
55°	3406
60°	2187
65°	1541
70°	1293
75°	854
80°	0
85°	0



TEST NUMBER: P696554

CATALOG NUMBER: MRI-FEU4C-15-L935 F4X-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	110.9	11.3
10°-20°	269.0	27.5
20°-30°	312.3	31.9
30°-40°	206.8	21.1
40°-50°	58.0	5.9
50°-60°	14.6	1.5
60°-70°	5.5	0.6
70°-80°	1.9	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	692.2	70.7
0°-40°	899.1	91.8
0°-60°	971.7	99.2
0°-90°	979.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	979.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1229	
5°	1197	111
15°	963	269
25°	685	312
35°	332	207
45°	67	58
55°	16	15
65°	5	5
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P696554

CATALOG NUMBER: MRI-FEU4C-15-L935 F4X-N-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1229.2
2.5°	1223.8
5°	1197.2
7.5°	1151.1
10°	1094.3
12.5°	1030.5
15°	963.1
17.5°	897.5
20°	824.8
22.5°	757.4
25°	684.6
27.5°	615.5
30°	526.8
32.5°	432.8
35°	331.7
37.5°	237.7
40°	161.4
42.5°	104.6
45°	67.4
47.5°	40.8
50°	26.6
52.5°	19.5
55°	15.9
57.5°	12.5
60°	8.9
62.5°	7.1
65°	5.3
67.5°	3.6
70°	3.6
72.5°	1.8
75°	1.8
77.5°	1.8
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)