

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696638

Luminaire Tested: **MRI-FEU4C-15-L950 F4X-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696638
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P206636)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-15-L950 F4X-W-X-H
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 4LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1338.0 lumens
Efficiency: N/A
Efficacy: 84.7 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.13
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696638
CATALOG NUMBER: MRI-FEU4C-15-L950 F4X-W-X-H

Luminous Intensity Polar Plot

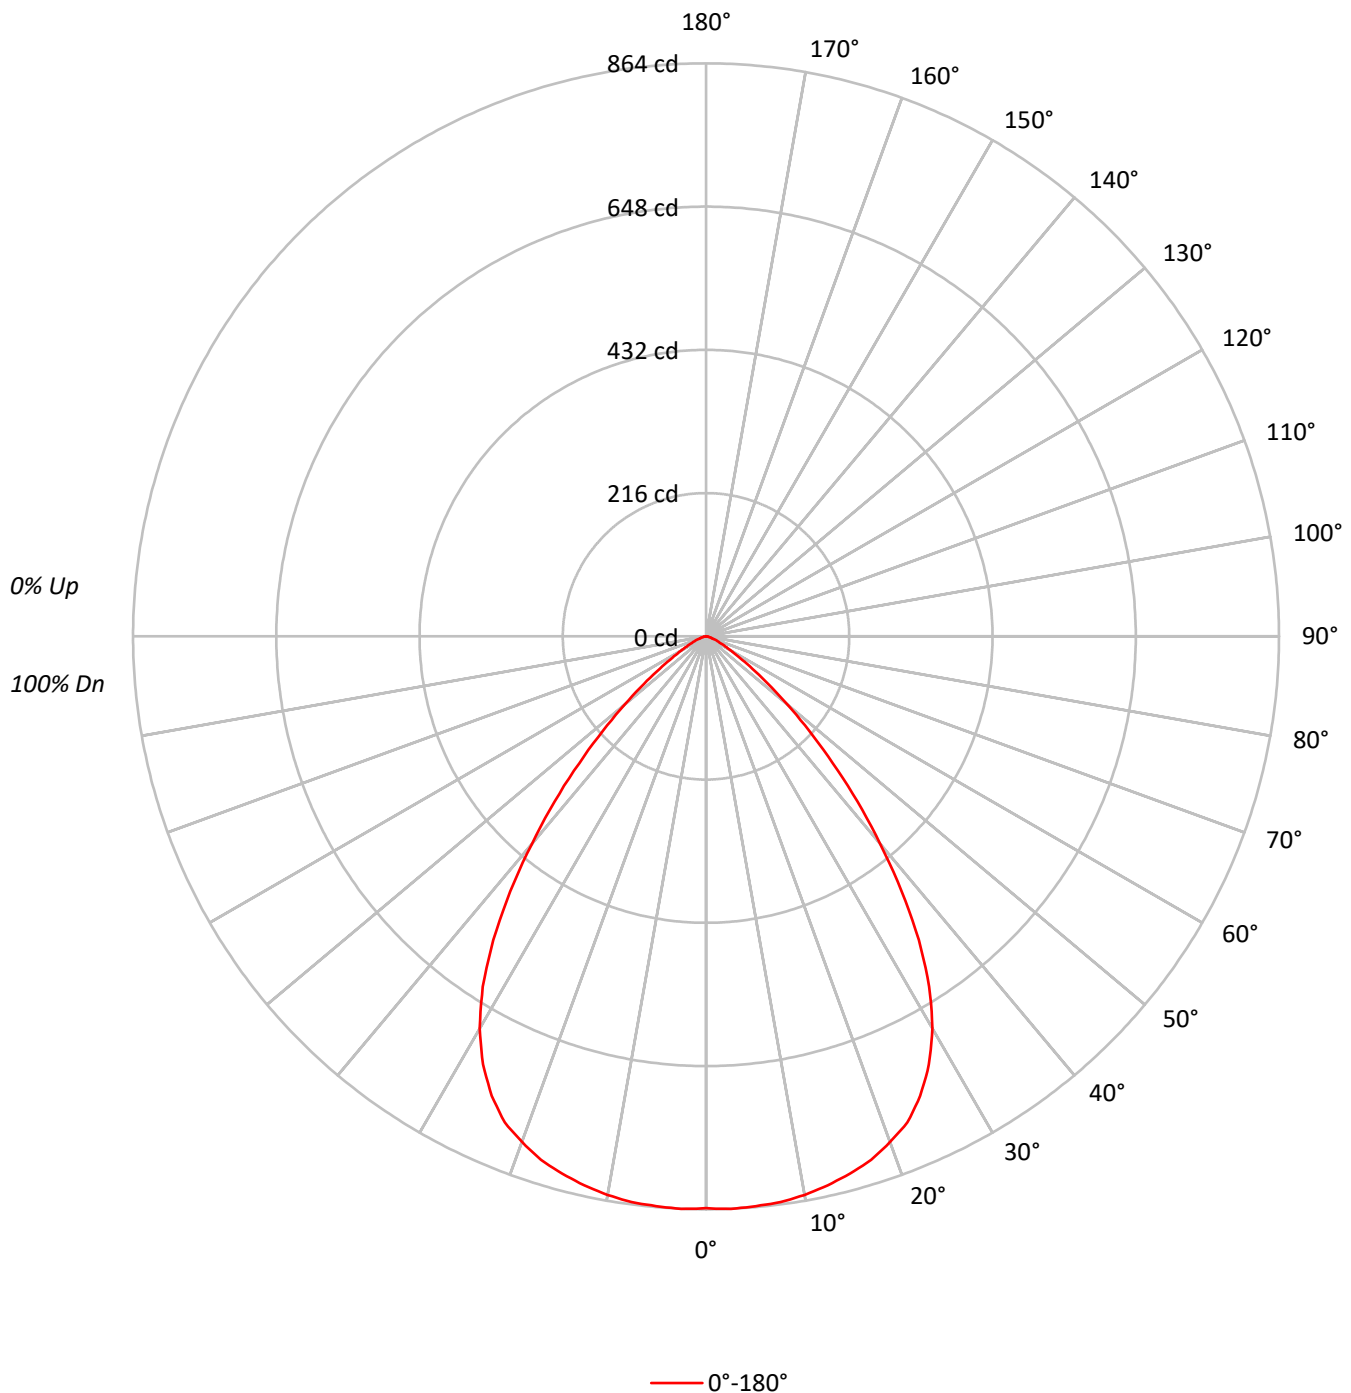



TEST NUMBER: P696638

CATALOG NUMBER: MRI-FEU4C-15-L950 F4X-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	104	110	107	104	102	103	101	99		99	97	96		96
2	105	100	95	91	103	98	93	90	95	91	88		91	88	86		89
3	99	91	85	80	97	90	84	80	87	82	78		84	80	77		82
4	92	83	77	72	90	82	76	71	80	75	70		78	73	70		76
5	87	77	70	65	85	76	69	64	74	68	64		72	67	63		70
6	81	71	64	58	80	70	63	58	68	62	58		67	61	57		65
7	76	65	58	53	75	65	58	53	63	57	53		62	56	52		61
8	72	60	53	49	70	60	53	49	59	53	48		58	52	48		57
9	68	56	49	45	66	56	49	45	55	49	44		54	48	44		53
10	64	52	46	41	63	52	46	41	51	45	41		50	45	41		49

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	105949
5°	106354
10°	106685
15°	106685
20°	106094
25°	103617
30°	96847
35°	83867
40°	65513
45°	46997
50°	30542
55°	18270
60°	10688
65°	6860
70°	4562
75°	3465
80°	2547
85°	0



TEST NUMBER: P696638
 CATALOG NUMBER: MRI-FEU4C-15-L950 F4X-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	82.1	6.1
10°-20°	236.6	17.7
20°-30°	349.2	26.1
30°-40°	344.6	25.8
40°-50°	210.9	15.8
50°-60°	80.8	6.0
60°-70°	25.3	1.9
70°-80°	7.4	0.6
80°-90°	1.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	668.0	49.9
0°-40°	1012.6	75.7
0°-60°	1304.3	97.5
0°-90°	1338.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1338.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	862	
5°	862	82
15°	839	237
25°	764	349
35°	559	345
45°	270	211
55°	85	81
65°	24	25
75°	7	7
85°	0	1
90°	0	



TEST NUMBER: P696638
CATALOG NUMBER: MRI-FEU4C-15-L950 F4X-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	862.4
2.5°	864.2
5°	862.4
7.5°	860.6
10°	855.2
12.5°	847.9
15°	838.8
17.5°	827.9
20°	811.5
22.5°	793.4
25°	764.4
27.5°	728.0
30°	682.7
32.5°	626.4
35°	559.2
37.5°	484.7
40°	408.5
42.5°	337.7
45°	270.5
47.5°	210.6
50°	159.8
52.5°	118.0
55°	85.3
57.5°	59.9
60°	43.5
62.5°	32.7
65°	23.6
67.5°	18.2
70°	12.7
72.5°	9.1
75°	7.3
77.5°	3.6
80°	3.6
82.5°	1.8
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)