

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696752

Luminaire Tested: **MRI-FEU4C-20-L935 F4X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696752
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-20-L935 F4X-W-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2000.0 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696752
CATALOG NUMBER: MRI-FEU4C-20-L935 F4X-W-X-LI

Luminous Intensity Polar Plot

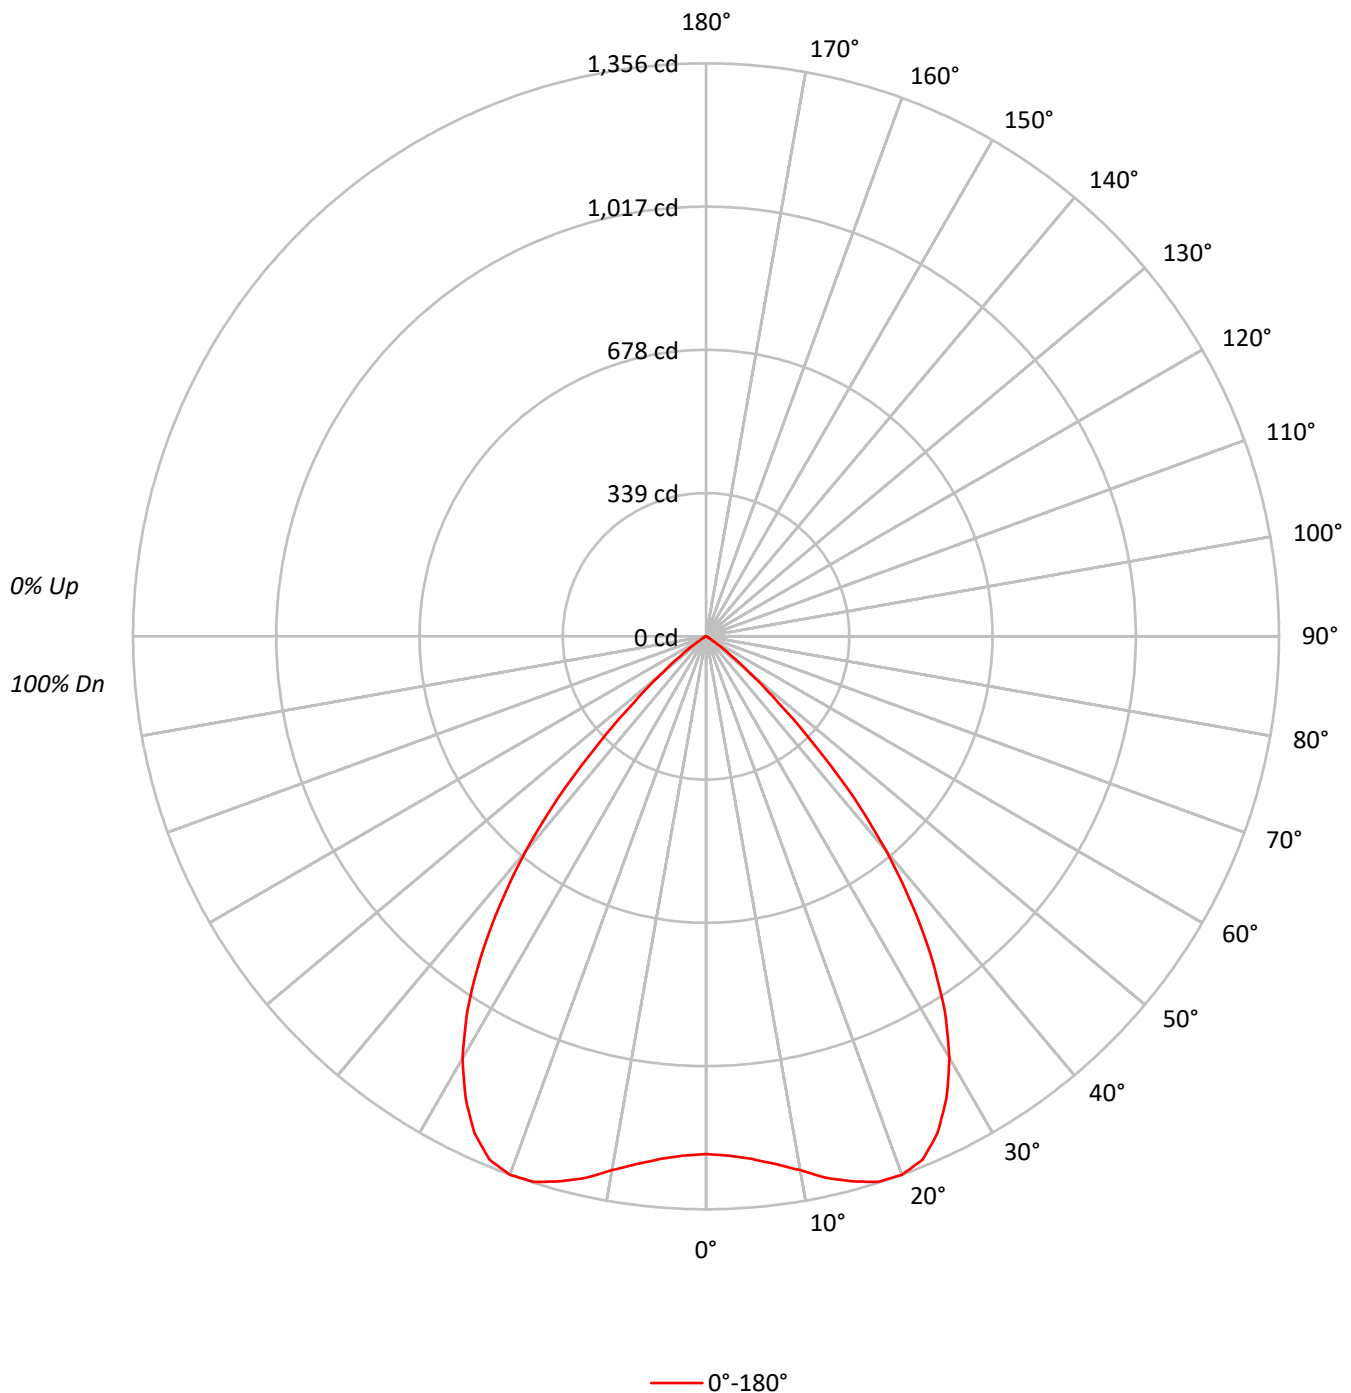



TEST NUMBER: P696752

CATALOG NUMBER: MRI-FEU4C-20-L935 F4X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	110	108	105	103	104	102	100		100	98	97		96
2	106	101	97	93	104	99	95	92	96	93	90		93	90	88		90
3	100	93	87	83	98	92	86	82	89	85	81		86	83	80		84
4	94	86	79	75	92	84	79	74	82	77	73		80	76	72		78
5	88	79	72	68	87	78	72	67	76	71	67		74	70	66		73
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68
7	78	68	61	56	77	67	61	56	66	60	56		64	59	55		63
8	74	63	56	52	72	62	56	51	61	55	51		60	55	51		59
9	69	59	52	48	68	58	52	47	57	51	47		56	51	47		55
10	66	55	48	44	65	54	48	44	53	48	44		53	47	44		52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	150545
5°	153093
10°	160015
15°	169846
20°	177281
25°	175746
30°	163436
35°	139823
40°	106520
45°	62477
50°	26700
55°	7861
60°	2261
65°	1337
70°	826
75°	1092
80°	0
85°	0



TEST NUMBER: P696752
 CATALOG NUMBER: MRI-FEU4C-20-L935 F4X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.8	6.0
10°-20°	378.2	18.9
20°-30°	590.0	29.5
30°-40°	574.0	28.7
40°-50°	286.7	14.3
50°-60°	44.4	2.2
60°-70°	5.4	0.3
70°-80°	1.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1088.0	54.4
0°-40°	1662.0	83.1
0°-60°	1993.1	99.7
0°-90°	2000.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2000.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1225	
5°	1241	120
15°	1335	378
25°	1296	590
35°	932	574
45°	360	287
55°	37	44
65°	5	5
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P696752
CATALOG NUMBER: MRI-FEU4C-20-L935 F4X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1225.4
2.5°	1230.0
5°	1241.4
7.5°	1259.8
10°	1282.7
12.5°	1312.4
15°	1335.4
17.5°	1353.7
20°	1356.0
22.5°	1340.0
25°	1296.5
27.5°	1232.3
30°	1152.1
32.5°	1051.4
35°	932.3
37.5°	801.6
40°	664.2
42.5°	517.7
45°	359.6
47.5°	231.3
50°	139.7
52.5°	75.6
55°	36.7
57.5°	16.1
60°	9.2
62.5°	6.9
65°	4.6
67.5°	4.6
70°	2.3
72.5°	2.3
75°	2.3
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)