

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696776

Luminaire Tested: **MRI-FEU4C-20-L940 F4X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696776
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-20-L940 F4X-N-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 4000K, 90 CRI LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1489.0 lumens
Efficiency: N/A
Efficacy: 68.3 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696776
CATALOG NUMBER: MRI-FEU4C-20-L940 F4X-N-X-LI

Luminous Intensity Polar Plot

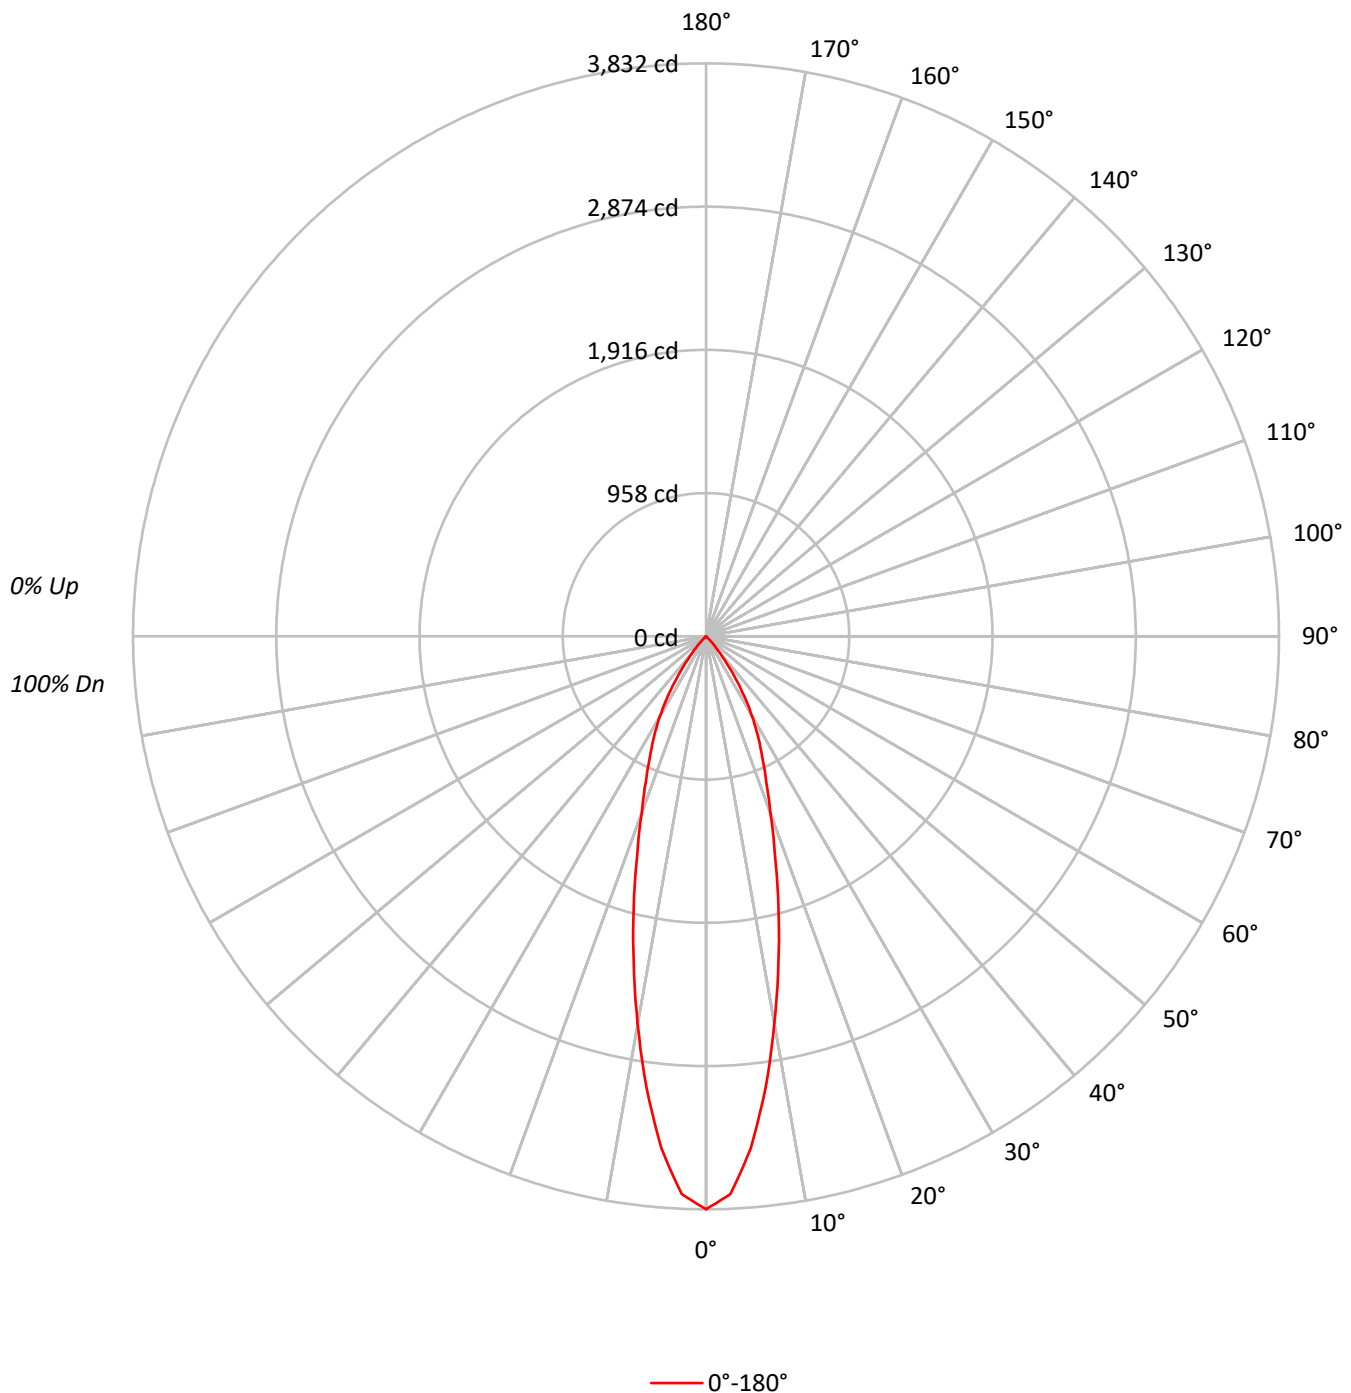



TEST NUMBER: P696776

CATALOG NUMBER: MRI-FEU4C-20-L940 F4X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	99	99
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	94	93
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90	89	88
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	84	83
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81	80	79
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77	76	75
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73	72	71
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69	68	67
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66	65	64
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63	62	61
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	470750
5°	423626
10°	328401
15°	237700
20°	164586
25°	119992
30°	87187
35°	51592
40°	21699
45°	6759
50°	879
55°	493
60°	565
65°	669
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P696776
 CATALOG NUMBER: MRI-FEU4C-20-L940 F4X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	302.0	20.3
10°-20°	517.0	34.7
20°-30°	410.9	27.6
30°-40°	217.5	14.6
40°-50°	37.5	2.5
50°-60°	2.8	0.2
60°-70°	1.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1229.8	82.6
0°-40°	1447.3	97.2
0°-60°	1487.6	99.9
0°-90°	1489.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1489.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3832	
5°	3435	302
15°	1869	517
25°	885	411
35°	344	218
45°	39	37
55°	2	3
65°	2	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P696776

CATALOG NUMBER: MRI-FEU4C-20-L940 F4X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	3831.8
2.5°	3733.2
5°	3435.1
7.5°	3045.3
10°	2632.5
12.5°	2233.5
15°	1868.9
17.5°	1529.5
20°	1258.9
22.5°	1052.5
25°	885.2
27.5°	749.9
30°	614.6
32.5°	477.0
35°	344.0
37.5°	227.1
40°	135.3
42.5°	78.0
45°	38.9
47.5°	13.8
50°	4.6
52.5°	4.6
55°	2.3
57.5°	2.3
60°	2.3
62.5°	2.3
65°	2.3
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)