

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696824

Luminaire Tested: **MRI-FEU4C-20-L950 F4X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696824
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-20-L950 F4X-W-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2044.0 lumens
Efficiency: N/A
Efficacy: 93.8 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696824
CATALOG NUMBER: MRI-FEU4C-20-L950 F4X-W-X-LI

Luminous Intensity Polar Plot

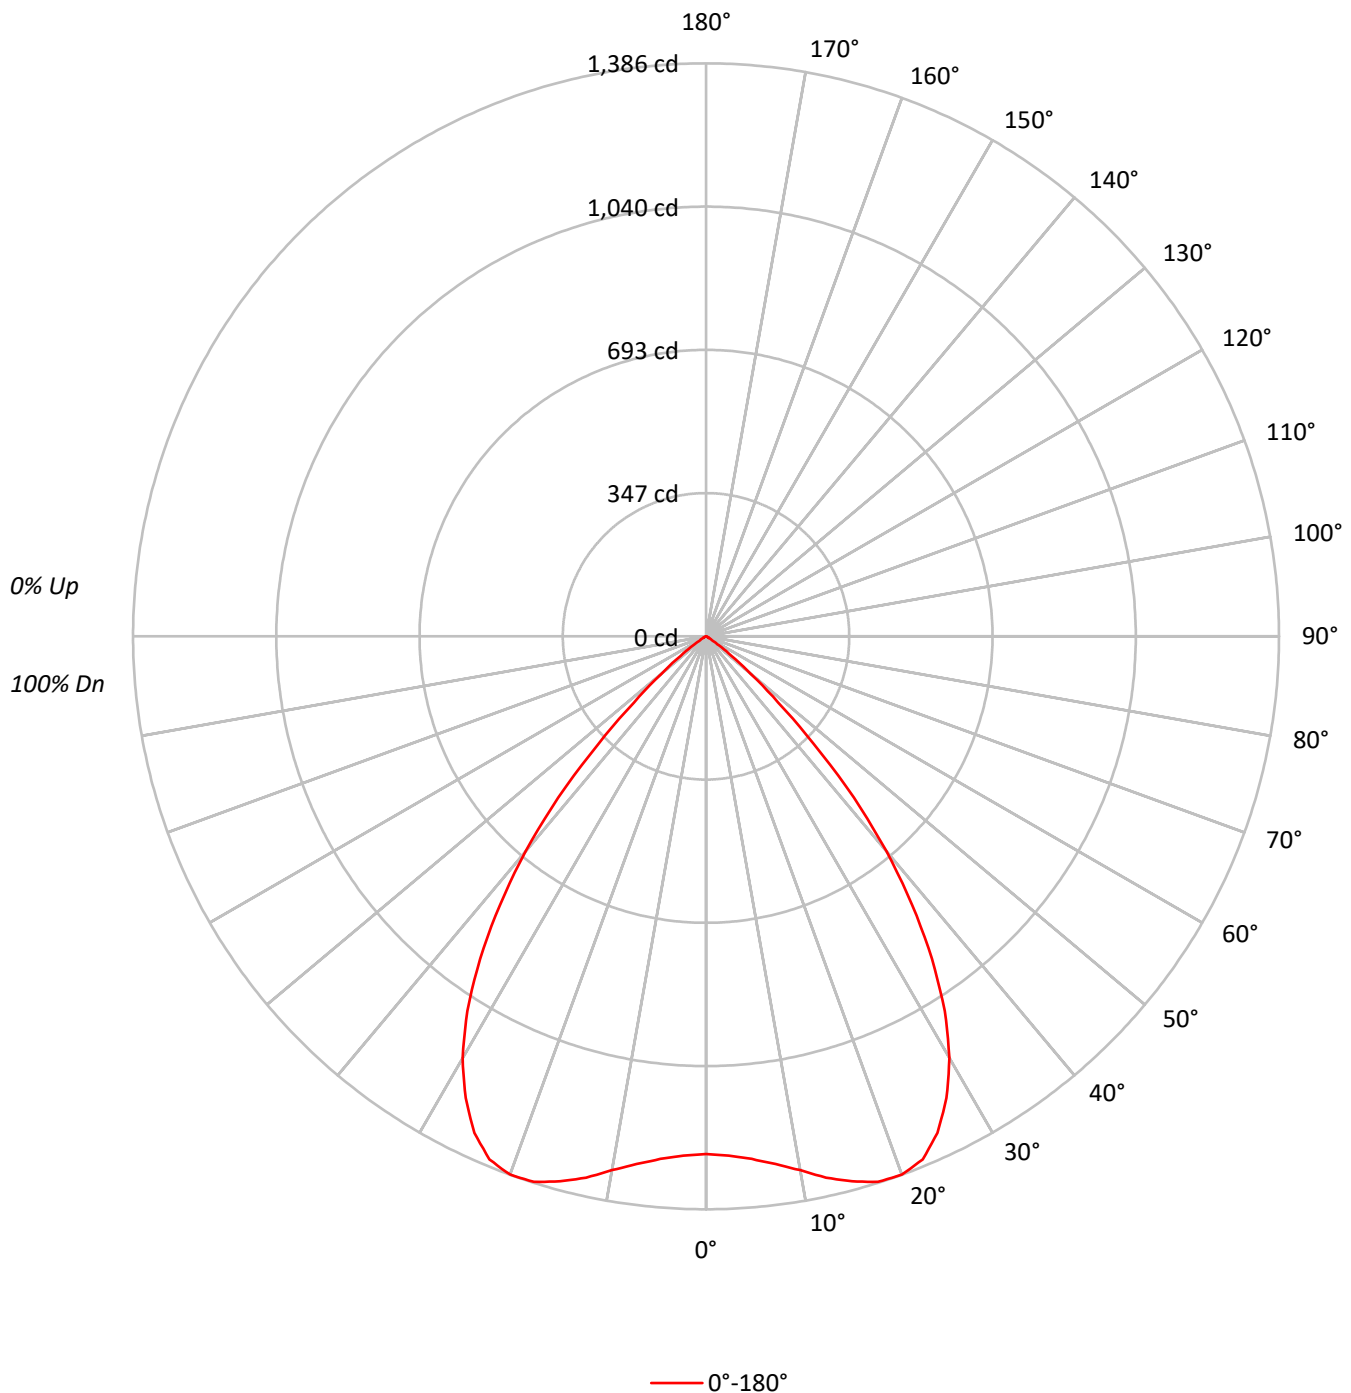



TEST NUMBER: P696824

CATALOG NUMBER: MRI-FEU4C-20-L950 F4X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	110	108	105	103	104	102	100		100	98	97		96
2	106	101	97	93	104	99	95	92	96	93	90		93	90	88		90
3	100	93	87	83	98	92	86	82	89	85	81		86	83	80		84
4	94	86	79	75	92	84	79	74	82	77	73		80	76	72		78
5	88	79	72	68	87	78	72	67	76	71	67		74	70	66		73
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68
7	78	68	61	56	77	67	61	56	66	60	56		64	59	55		63
8	74	63	56	52	72	62	56	51	61	55	51		60	55	51		59
9	69	59	52	48	68	58	52	47	57	51	47		56	51	47		55
10	66	55	48	44	65	54	48	44	53	48	44		53	47	44		52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	153849
5°	156472
10°	163533
15°	173572
20°	181177
25°	179609
30°	167039
35°	142898
40°	108878
45°	63867
50°	27293
55°	8032
60°	2310
65°	1366
70°	826
75°	1092
80°	0
85°	0



TEST NUMBER: P696824
 CATALOG NUMBER: MRI-FEU4C-20-L950 F4X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	122.5	6.0
10°-20°	386.5	18.9
20°-30°	602.9	29.5
30°-40°	586.7	28.7
40°-50°	293.0	14.3
50°-60°	45.4	2.2
60°-70°	5.5	0.3
70°-80°	1.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1111.9	54.4
0°-40°	1698.6	83.1
0°-60°	2037.0	99.7
0°-90°	2044.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2044.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1252	
5°	1269	122
15°	1365	386
25°	1325	603
35°	953	587
45°	368	293
55°	38	45
65°	5	5
75°	2	2
85°	0	0
90°	0	



TEST NUMBER: P696824
CATALOG NUMBER: MRI-FEU4C-20-L950 F4X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1252.3
2.5°	1257.0
5°	1268.8
7.5°	1287.5
10°	1310.9
12.5°	1341.3
15°	1364.7
17.5°	1383.5
20°	1385.8
22.5°	1369.4
25°	1325.0
27.5°	1259.4
30°	1177.5
32.5°	1074.5
35°	952.8
37.5°	819.3
40°	678.9
42.5°	529.1
45°	367.6
47.5°	236.4
50°	142.8
52.5°	77.2
55°	37.5
57.5°	16.4
60°	9.4
62.5°	7.0
65°	4.7
67.5°	4.7
70°	2.3
72.5°	2.3
75°	2.3
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)