

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P696902

Luminaire Tested: **MRI-FEU4C-25-L935 F4X-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P696902
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-25-L935 F4X-M-X-H
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2240.1 lumens
Efficiency: N/A
Efficacy: 70.9 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P696902
CATALOG NUMBER: MRI-FEU4C-25-L935 F4X-M-X-H

Luminous Intensity Polar Plot

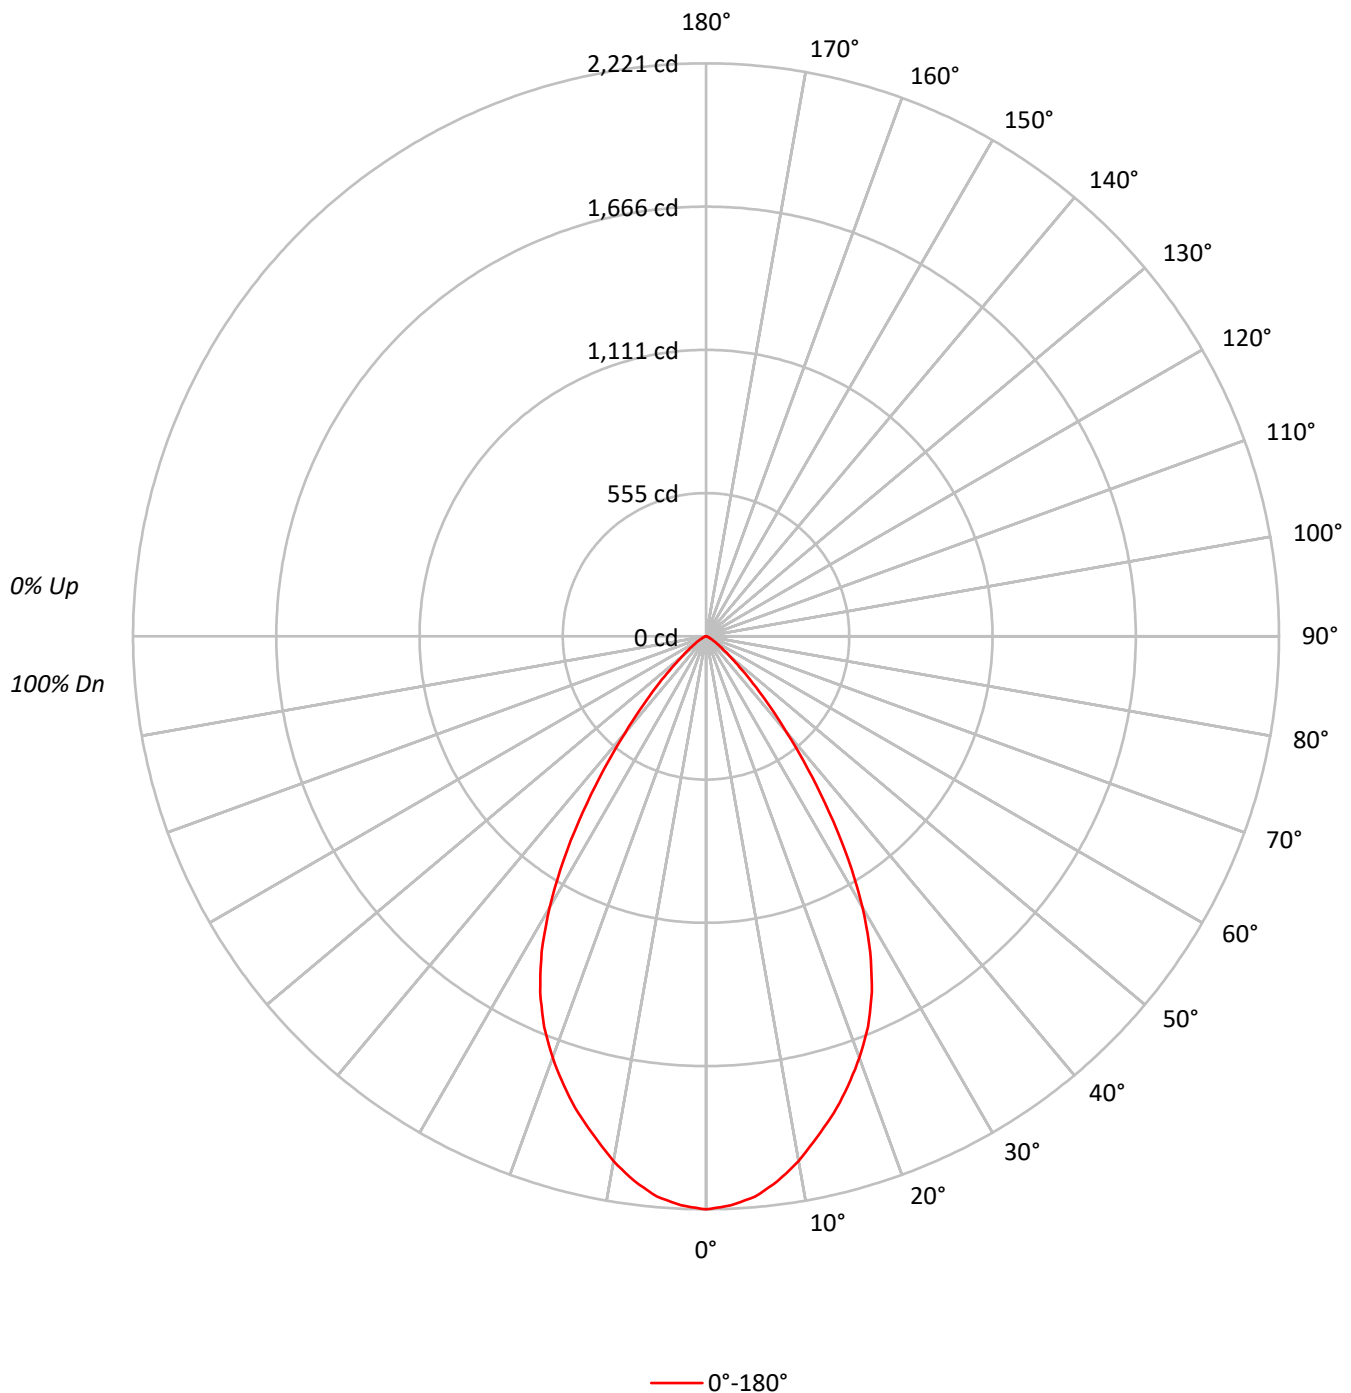



TEST NUMBER: P696902

CATALOG NUMBER: MRI-FEU4C-25-L935 F4X-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	108	105	111	108	106	104	104	102	100		100	99	97		97
2	107	102	98	94	105	100	96	93	97	94	91		94	91	89		91
3	101	94	89	85	99	93	88	84	90	86	83		88	84	82		86
4	96	88	82	77	94	86	81	77	84	80	76		82	78	75		80
5	90	82	75	71	89	81	75	70	79	74	70		77	73	69		75
6	86	76	70	65	84	75	69	65	74	68	64		72	68	64		71
7	81	71	65	60	80	70	64	60	69	64	60		68	63	59		67
8	77	67	60	56	75	66	60	56	65	59	56		64	59	55		63
9	73	63	56	52	72	62	56	52	61	56	52		60	55	52		59
10	69	59	53	49	68	59	53	49	58	52	49		57	52	48		56

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	272870
5°	268905
10°	257668
15°	243373
20°	227170
25°	206218
30°	172174
35°	124735
40°	78086
45°	44634
50°	23279
55°	13044
60°	8305
65°	4913
70°	3628
75°	1614
80°	2405
85°	0



TEST NUMBER: P696902
 CATALOG NUMBER: MRI-FEU4C-25-L935 F4X-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	204.4	9.1
10°-20°	536.2	23.9
20°-30°	689.1	30.8
30°-40°	518.5	23.1
40°-50°	208.2	9.3
50°-60°	59.2	2.6
60°-70°	18.7	0.8
70°-80°	5.4	0.2
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1429.6	63.8
0°-40°	1948.1	87.0
0°-60°	2215.5	98.9
0°-90°	2240.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2240.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2221	
5°	2180	204
15°	1914	536
25°	1521	689
35°	832	518
45°	257	208
55°	61	59
65°	17	19
75°	3	5
85°	0	0
90°	0	



TEST NUMBER: P696902

CATALOG NUMBER: MRI-FEU4C-25-L935 F4X-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	2221.1
2.5°	2207.6
5°	2180.5
7.5°	2129.8
10°	2065.5
12.5°	1987.9
15°	1913.5
17.5°	1828.9
20°	1737.6
22.5°	1639.7
25°	1521.3
27.5°	1379.3
30°	1213.7
32.5°	1027.7
35°	831.7
37.5°	649.1
40°	486.9
42.5°	358.3
45°	256.9
47.5°	175.9
50°	121.8
52.5°	84.6
55°	60.9
57.5°	44.0
60°	33.8
62.5°	23.7
65°	16.9
67.5°	13.5
70°	10.1
72.5°	6.8
75°	3.4
77.5°	3.4
80°	3.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)