

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697076

Luminaire Tested: **MRI-FEU4C-05-L930 F4X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697076
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-05-L930 F4X-W-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 647.0 lumens
Efficiency: N/A
Efficacy: 89.9 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697076
CATALOG NUMBER: MRI-FEU4C-05-L930 F4X-W-X-LI

Luminous Intensity Polar Plot

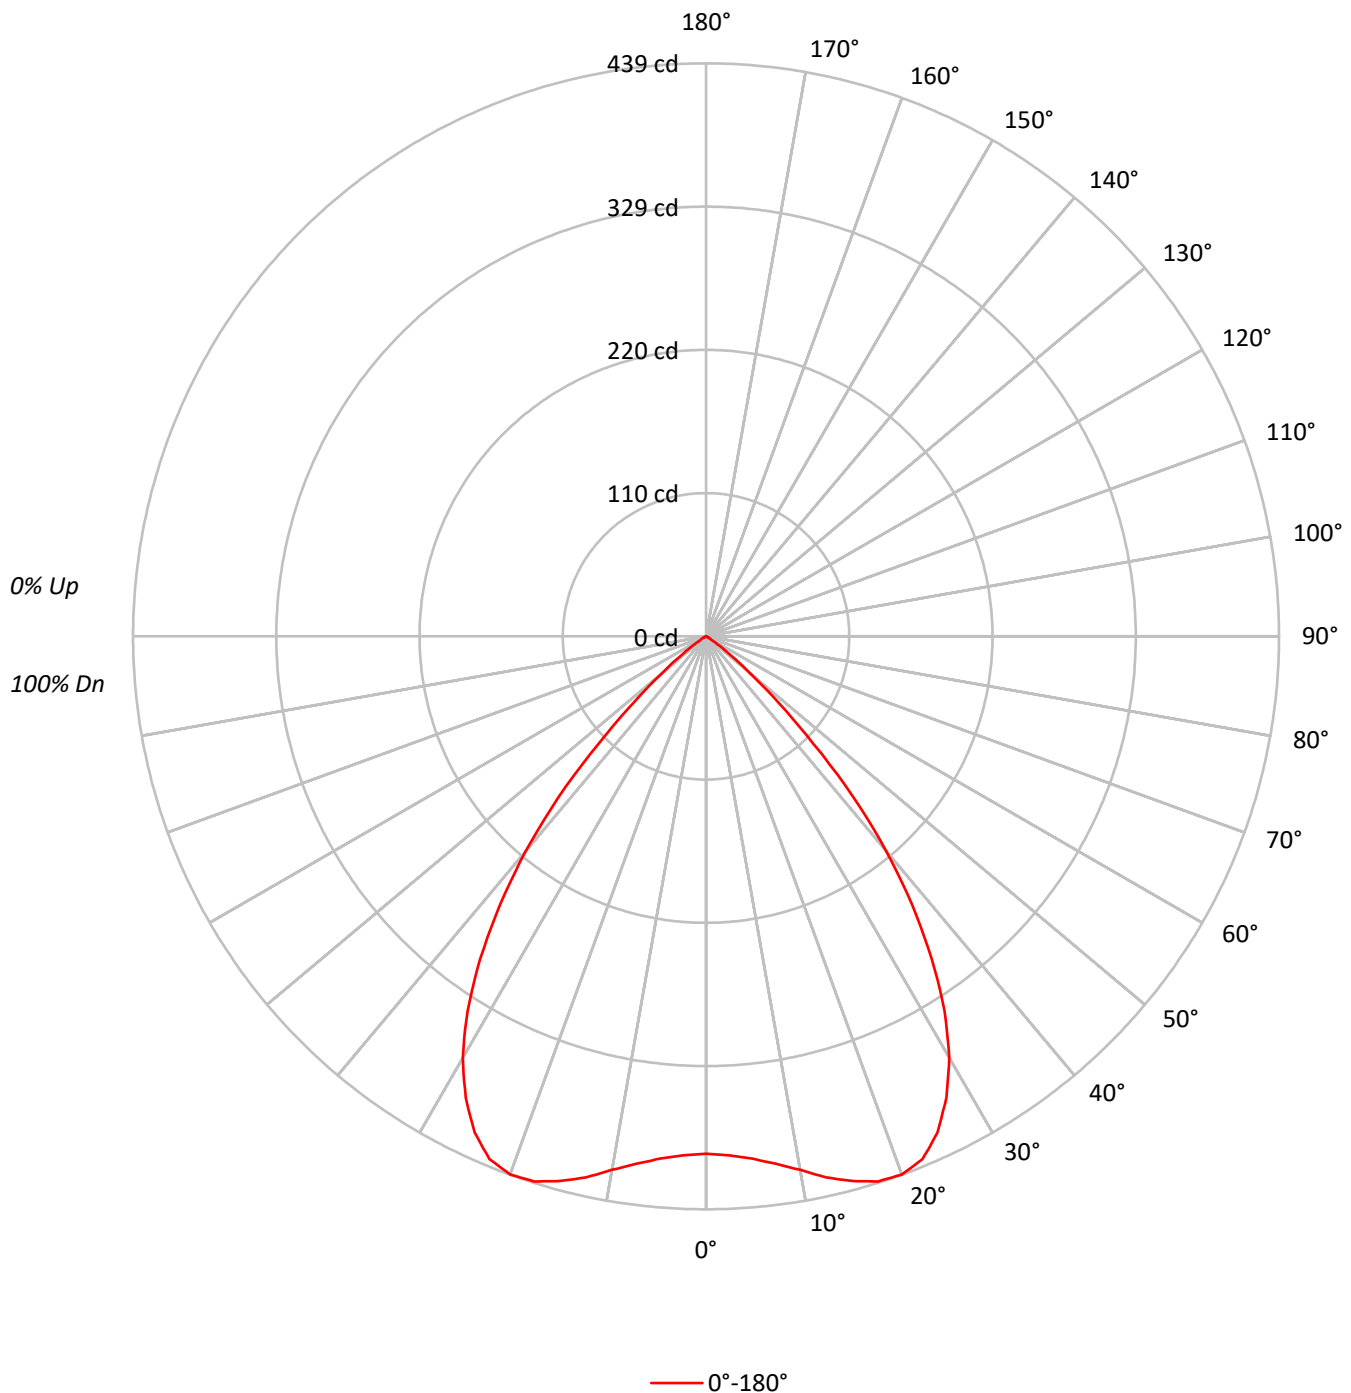



TEST NUMBER: P697076

CATALOG NUMBER: MRI-FEU4C-05-L930 F4X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	110	108	105	103	104	102	100		100	98	97		96
2	106	101	97	93	104	99	95	92	96	93	90		93	90	88		90
3	100	93	87	83	98	92	86	82	89	85	81		86	83	80		84
4	94	86	79	75	92	84	79	74	82	77	73		80	76	72		78
5	88	79	72	68	87	78	72	67	76	71	67		74	70	66		73
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68
7	78	68	61	56	77	67	61	56	66	60	56		64	59	55		63
8	74	63	56	52	72	62	56	51	61	55	51		60	55	51		59
9	69	59	52	48	68	58	52	47	57	51	47		56	51	47		55
10	66	55	48	44	65	54	48	44	53	48	44		53	47	44		52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	48699
5°	49526
10°	51771
15°	54945
20°	57355
25°	56851
30°	52871
35°	45233
40°	34464
45°	20206
50°	8639
55°	2549
60°	737
65°	436
70°	251
75°	332
80°	0
85°	0



TEST NUMBER: P697076
 CATALOG NUMBER: MRI-FEU4C-05-L930 F4X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	38.8	6.0
10°-20°	122.3	18.9
20°-30°	190.9	29.5
30°-40°	185.7	28.7
40°-50°	92.7	14.3
50°-60°	14.4	2.2
60°-70°	1.7	0.3
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	352.0	54.4
0°-40°	537.7	83.1
0°-60°	644.8	99.7
0°-90°	647.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	647.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	396	
5°	402	39
15°	432	122
25°	419	191
35°	302	186
45°	116	93
55°	12	14
65°	2	2
75°	1	0
85°	0	0
90°	0	



TEST NUMBER: P697076
CATALOG NUMBER: MRI-FEU4C-05-L930 F4X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	396.4
2.5°	397.9
5°	401.6
7.5°	407.5
10°	415.0
12.5°	424.6
15°	432.0
17.5°	437.9
20°	438.7
22.5°	433.5
25°	419.4
27.5°	398.6
30°	372.7
32.5°	340.1
35°	301.6
37.5°	259.3
40°	214.9
42.5°	167.5
45°	116.3
47.5°	74.8
50°	45.2
52.5°	24.4
55°	11.9
57.5°	5.2
60°	3.0
62.5°	2.2
65°	1.5
67.5°	1.5
70°	0.7
72.5°	0.7
75°	0.7
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)