

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697100

Luminaire Tested: **MRI-FEU4C-05-L935 F4X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697100
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-05-L935 F4X-N-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 488.0 lumens
Efficiency: N/A
Efficacy: 67.8 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697100
CATALOG NUMBER: MRI-FEU4C-05-L935 F4X-N-X-LI

Luminous Intensity Polar Plot

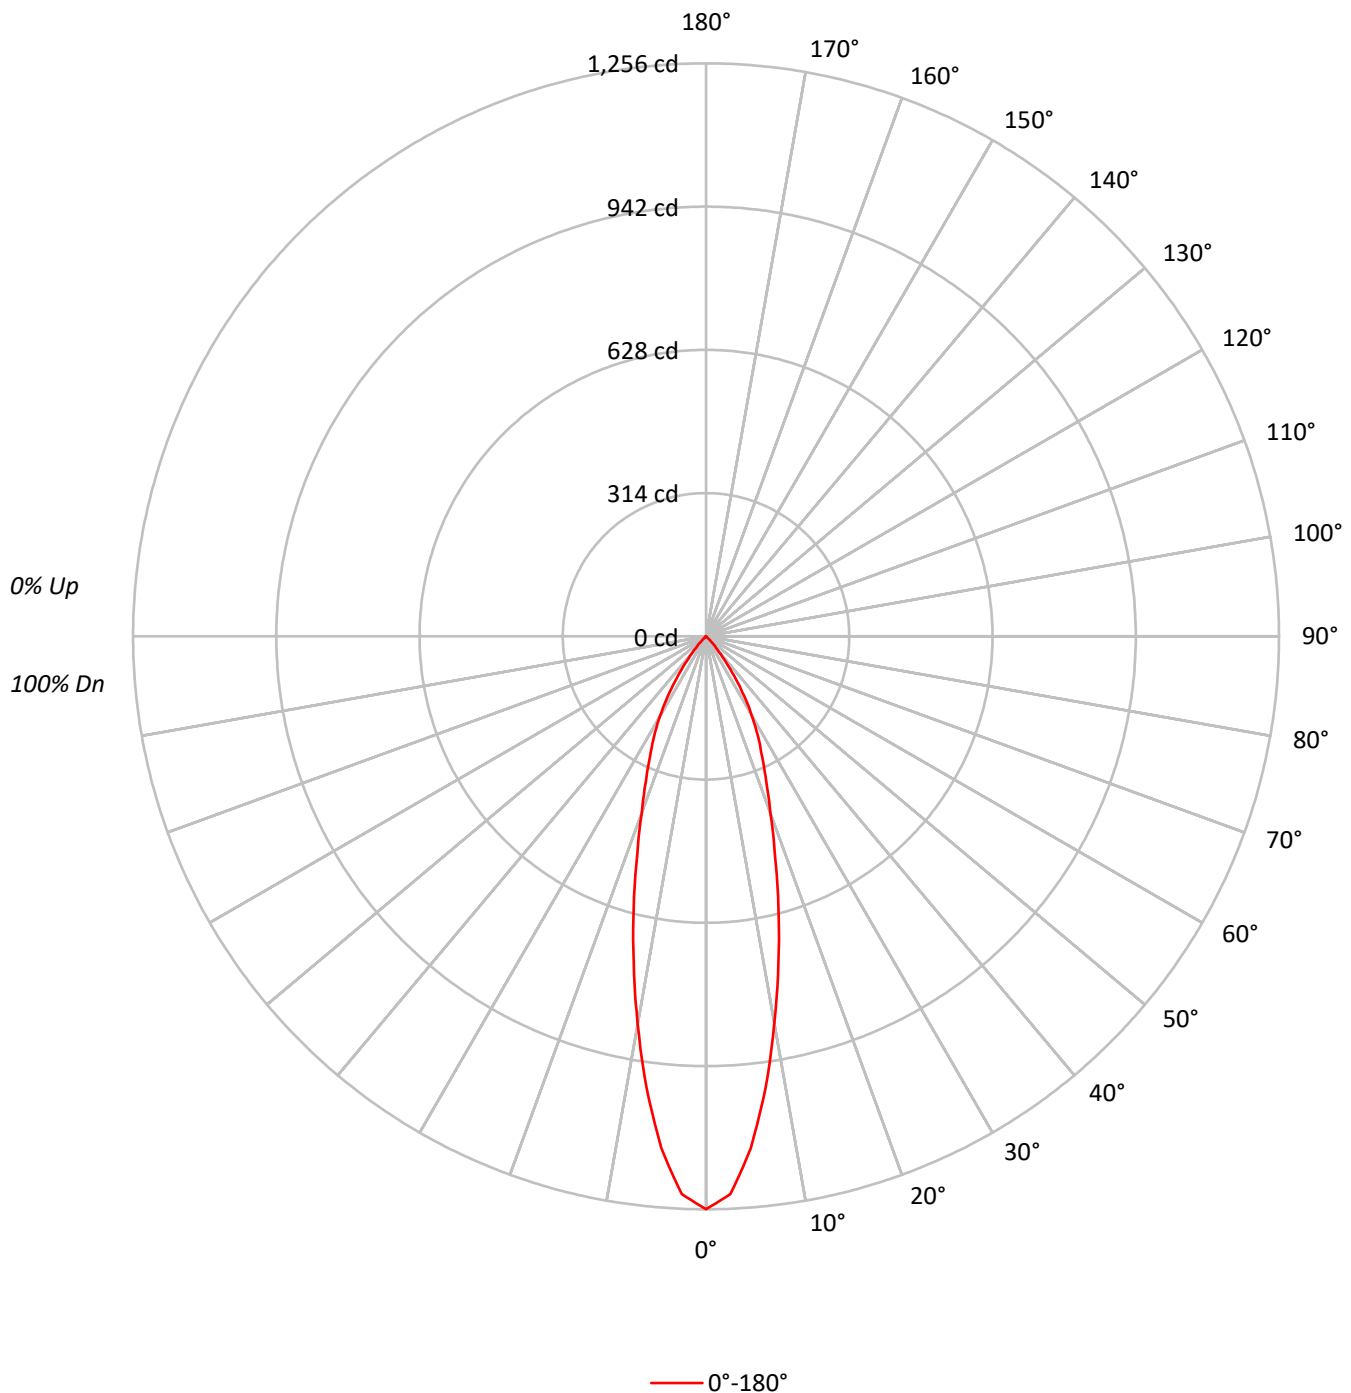



TEST NUMBER: P697100

CATALOG NUMBER: MRI-FEU4C-05-L935 F4X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	110	108	112	110	108	106	106	104	103		102	101	100		99
2	109	105	102	99	107	103	100	98	100	98	95		97	95	93		95
3	105	99	95	92	103	98	94	91	95	92	89		93	90	88		91
4	101	94	89	86	99	93	88	85	91	87	84		89	86	83		87
5	96	89	84	80	95	88	84	80	87	82	79		85	81	79		83
6	92	85	80	76	91	84	79	76	83	78	75		81	78	75		80
7	89	81	76	72	88	80	75	72	79	75	71		78	74	71		77
8	85	77	72	68	84	77	72	68	76	71	68		75	71	68		74
9	82	74	69	65	81	73	68	65	72	68	65		72	68	65		71
10	79	71	66	62	78	70	65	62	69	65	62		69	65	62		68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	154279
5°	138837
10°	107633
15°	77902
20°	53942
25°	39324
30°	28570
35°	16902
40°	7105
45°	2224
50°	287
55°	171
60°	197
65°	233
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P697100
 CATALOG NUMBER: MRI-FEU4C-05-L935 F4X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.0	20.3
10°-20°	169.4	34.7
20°-30°	134.7	27.6
30°-40°	71.3	14.6
40°-50°	12.3	2.5
50°-60°	0.9	0.2
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	403.1	82.6
0°-40°	474.3	97.2
0°-60°	487.6	99.9
0°-90°	488.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	488.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1256	
5°	1126	99
15°	612	169
25°	290	135
35°	113	71
45°	13	12
55°	1	1
65°	1	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P697100

CATALOG NUMBER: MRI-FEU4C-05-L935 F4X-N-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1255.8
2.5°	1223.5
5°	1125.8
7.5°	998.1
10°	862.8
12.5°	732.0
15°	612.5
17.5°	501.3
20°	412.6
22.5°	344.9
25°	290.1
27.5°	245.8
30°	201.4
32.5°	156.3
35°	112.7
37.5°	74.4
40°	44.3
42.5°	25.6
45°	12.8
47.5°	4.5
50°	1.5
52.5°	1.5
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)