

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697148

Luminaire Tested: **MRI-FEU4C-05-L940 F4X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697148
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-05-L940 F4X-W-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 4000K, 90 CRI LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 658.0 lumens
Efficiency: N/A
Efficacy: 91.4 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697148
CATALOG NUMBER: MRI-FEU4C-05-L940 F4X-W-X-LI

Luminous Intensity Polar Plot

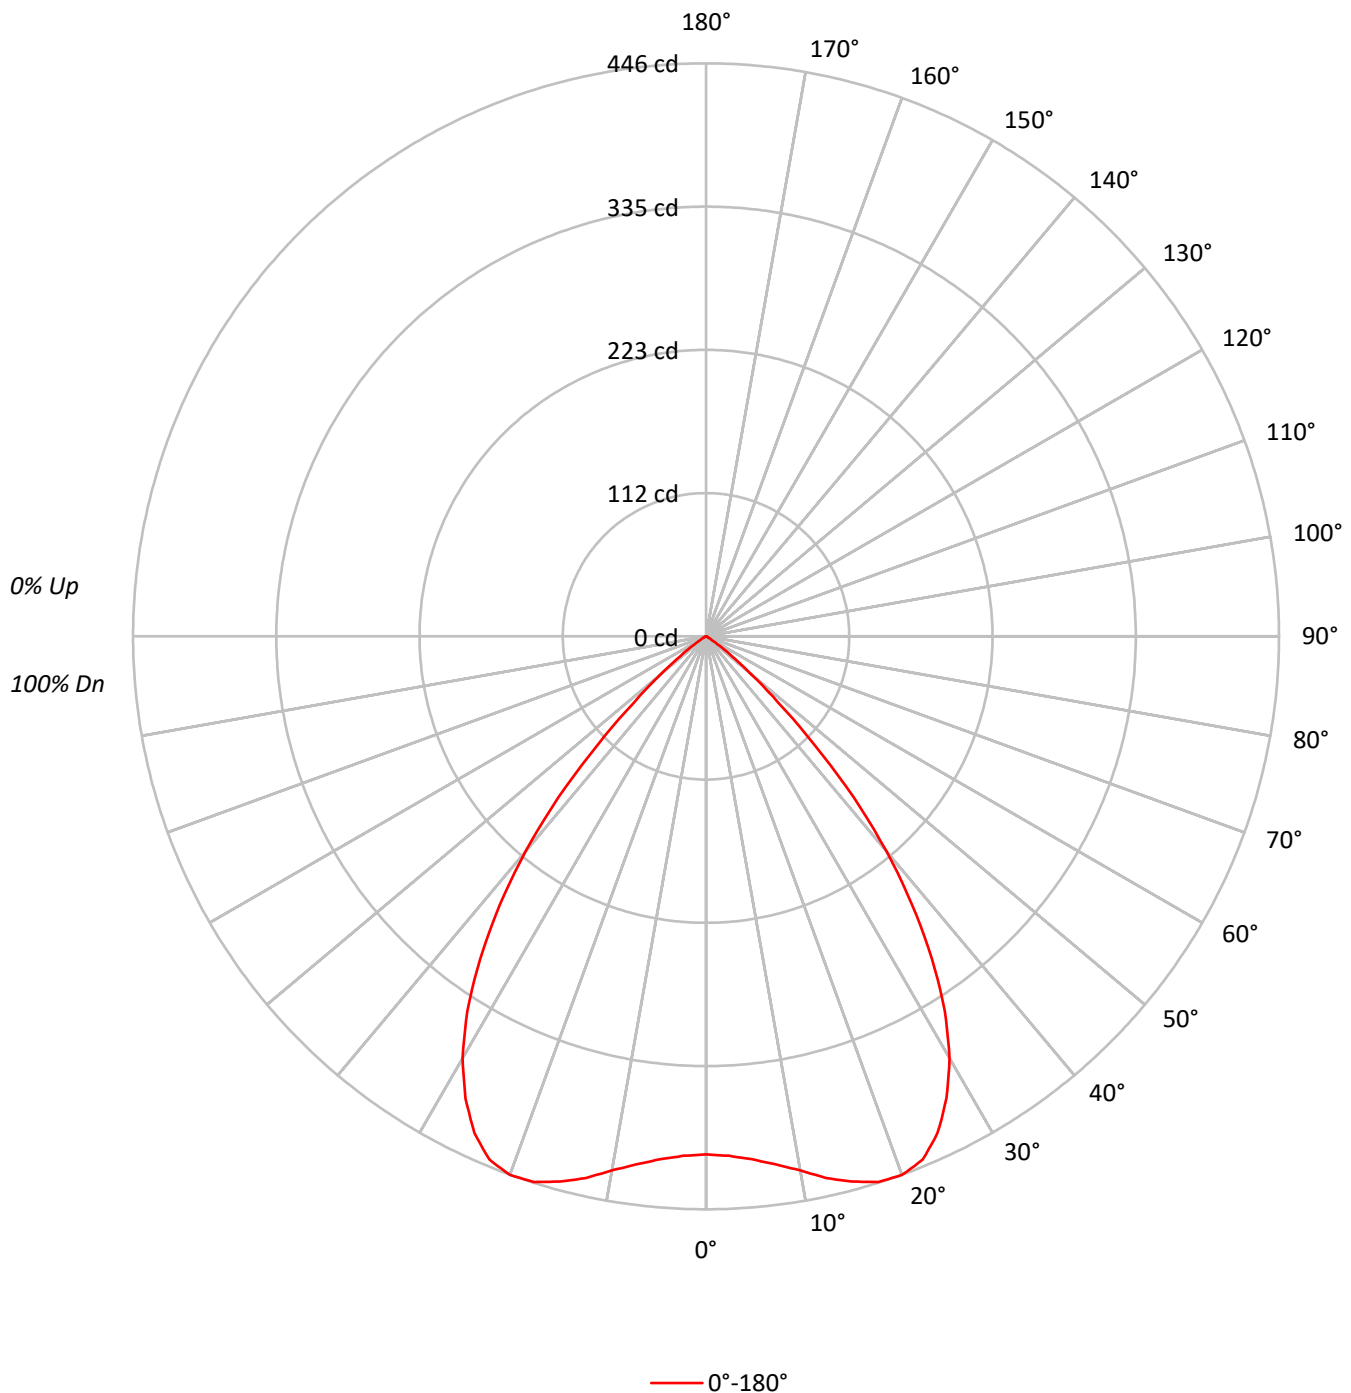



TEST NUMBER: P697148

CATALOG NUMBER: MRI-FEU4C-05-L940 F4X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	110	108	105	103	104	102	100		100	98	97		96
2	106	101	97	93	104	99	95	92	96	93	90		93	90	88		90
3	100	93	87	83	98	92	86	82	89	85	81		86	83	80		84
4	94	86	79	75	92	84	79	74	82	77	73		80	76	72		78
5	88	79	72	68	87	78	72	67	76	71	67		74	70	66		73
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68
7	78	68	61	56	77	67	61	56	66	60	56		64	59	55		63
8	74	63	56	52	72	62	56	51	61	55	51		60	55	51		59
9	69	59	52	48	68	58	52	47	57	51	47		56	51	47		55
10	66	55	48	44	65	54	48	44	53	48	44		53	47	44		52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	49535
5°	50365
10°	52644
15°	55873
20°	58322
25°	57814
30°	53765
35°	45998
40°	35042
45°	20554
50°	8792
55°	2592
60°	737
65°	436
70°	287
75°	380
80°	0
85°	0



TEST NUMBER: P697148
 CATALOG NUMBER: MRI-FEU4C-05-L940 F4X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	39.4	6.0
10°-20°	124.4	18.9
20°-30°	194.1	29.5
30°-40°	188.8	28.7
40°-50°	94.3	14.3
50°-60°	14.6	2.2
60°-70°	1.8	0.3
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	357.9	54.4
0°-40°	546.8	83.1
0°-60°	655.7	99.7
0°-90°	658.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	658.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	403	
5°	408	39
15°	439	124
25°	426	194
35°	307	189
45°	118	94
55°	12	15
65°	2	2
75°	1	1
85°	0	0
90°	0	

TEST NUMBER: P697148

CATALOG NUMBER: MRI-FEU4C-05-L940 F4X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	403.2
2.5°	404.7
5°	408.4
7.5°	414.5
10°	422.0
12.5°	431.8
15°	439.3
17.5°	445.4
20°	446.1
22.5°	440.8
25°	426.5
27.5°	405.4
30°	379.0
32.5°	345.9
35°	306.7
37.5°	263.7
40°	218.5
42.5°	170.3
45°	118.3
47.5°	76.1
50°	46.0
52.5°	24.9
55°	12.1
57.5°	5.3
60°	3.0
62.5°	2.3
65°	1.5
67.5°	1.5
70°	0.8
72.5°	0.8
75°	0.8
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)