

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697166

Luminaire Tested: **MRI-FEU4C-05-L950 F4X-N-X-H**

Issue Date: 08/03/2023



**Test Information**

Test Method: LM-79-08  
Report Number: P697166  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-FEU4C-05-L950 F4X-N-X-H  
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 4LBNH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 424.0 lumens  
Efficiency: N/A  
Efficacy: 58.9 lumens/watt  
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.2  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P697166

CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-H

### Luminous Intensity Polar Plot

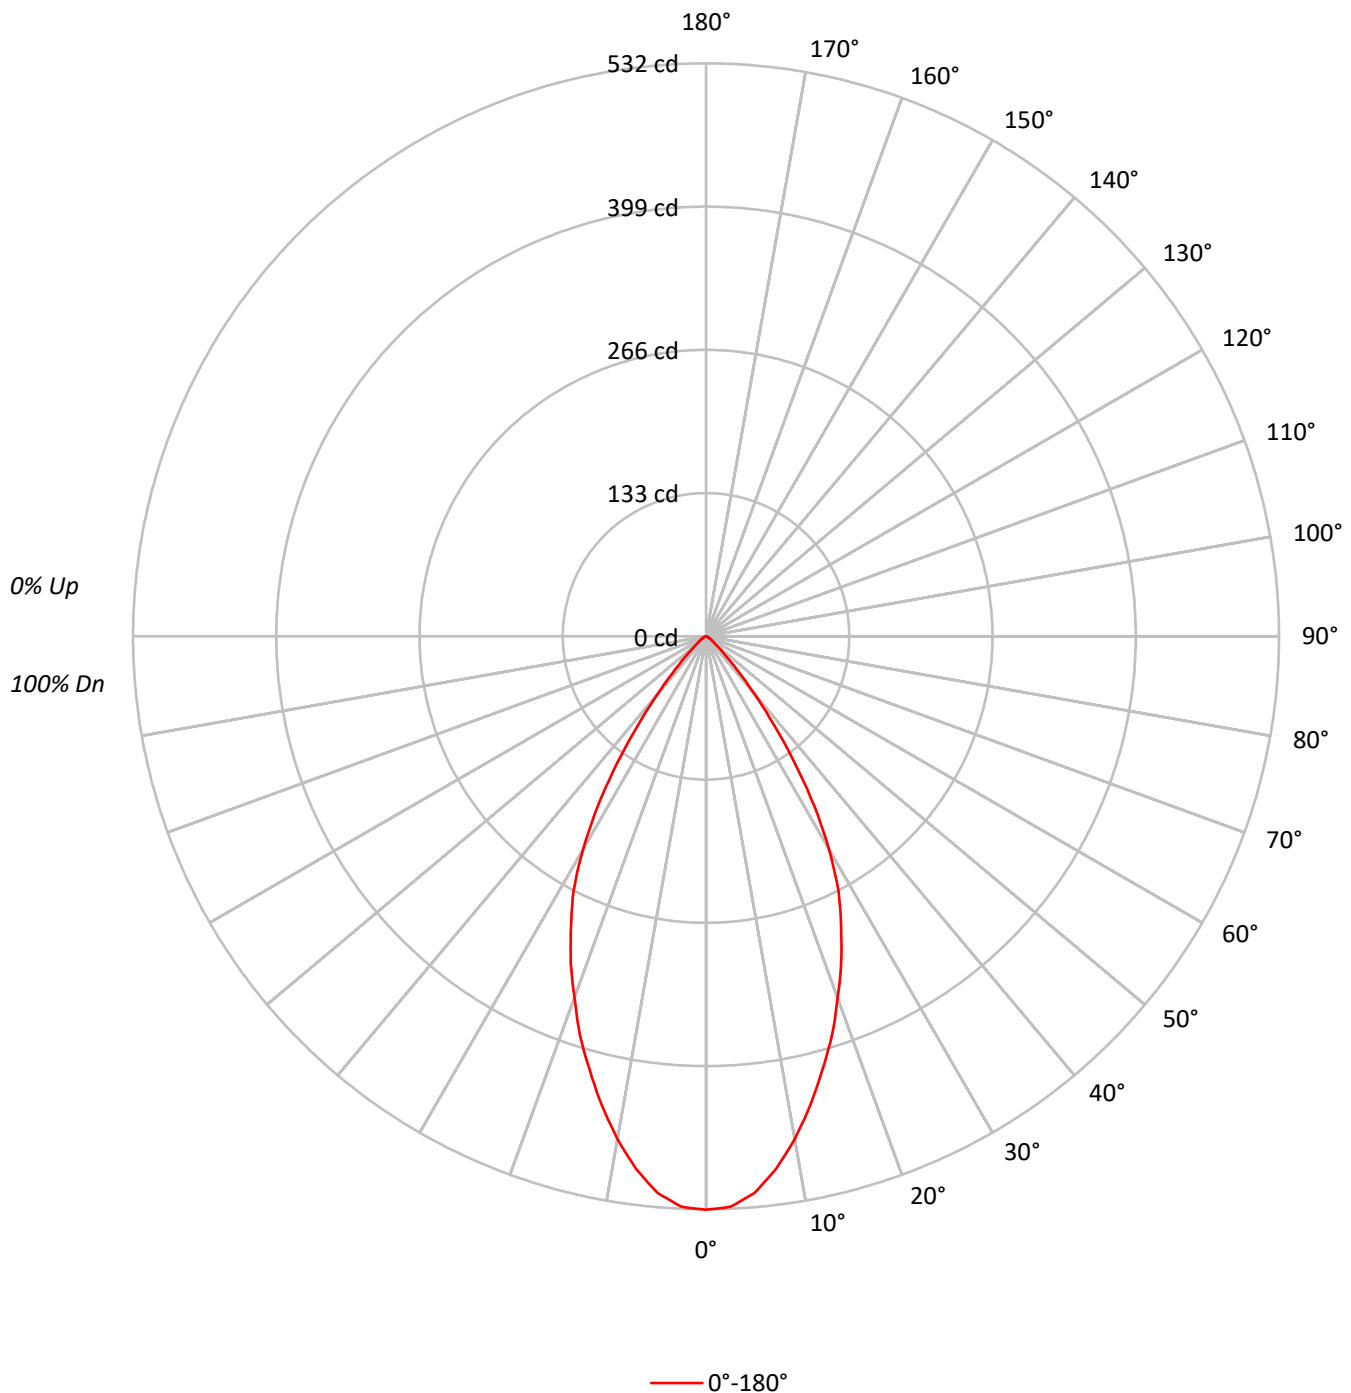



TEST NUMBER: P697166

CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |  |     |     |     |     |  |     |     |     |  |     |     |     |  |     |     |     |
|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|
| RF  | 20  |     |     |     |  | 20  |     |     |     |  | 20  |     |     |  |     | 20  |     |  |     |     | 20  |
| RC  | 80  |     |     |     |  | 70  |     |     |     |  | 30  |     |     |  |     | 10  |     |  |     |     | 0   |
| RW  | 70  | 50  | 30  | 10  |  | 70  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |
| RCR |     |     |     |     |  |     |     |     |     |  |     |     |     |  |     |     |     |  |     |     |     |
| 0   | 119 | 119 | 119 | 119 |  | 116 | 116 | 116 | 116 |  | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 |
| 1   | 113 | 111 | 108 | 106 |  | 111 | 109 | 106 | 104 |  | 105 | 103 | 101 |  | 101 | 99  | 98  |  | 97  | 96  | 95  |
| 2   | 108 | 103 | 99  | 96  |  | 106 | 101 | 98  | 94  |  | 98  | 95  | 92  |  | 95  | 93  | 90  |  | 92  | 90  | 89  |
| 3   | 102 | 96  | 91  | 87  |  | 100 | 95  | 90  | 86  |  | 92  | 88  | 85  |  | 90  | 86  | 84  |  | 87  | 85  | 82  |
| 4   | 97  | 90  | 84  | 80  |  | 95  | 89  | 83  | 79  |  | 86  | 82  | 78  |  | 84  | 81  | 78  |  | 83  | 79  | 77  |
| 5   | 92  | 84  | 78  | 74  |  | 91  | 83  | 78  | 73  |  | 81  | 76  | 73  |  | 80  | 75  | 72  |  | 78  | 74  | 72  |
| 6   | 88  | 79  | 73  | 69  |  | 86  | 78  | 72  | 68  |  | 76  | 72  | 68  |  | 75  | 71  | 67  |  | 74  | 70  | 67  |
| 7   | 83  | 74  | 68  | 64  |  | 82  | 73  | 68  | 64  |  | 72  | 67  | 63  |  | 71  | 66  | 63  |  | 70  | 66  | 63  |
| 8   | 79  | 70  | 64  | 60  |  | 78  | 69  | 64  | 60  |  | 68  | 63  | 59  |  | 67  | 63  | 59  |  | 66  | 62  | 59  |
| 9   | 76  | 66  | 60  | 56  |  | 74  | 65  | 60  | 56  |  | 65  | 59  | 56  |  | 64  | 59  | 56  |  | 63  | 59  | 55  |
| 10  | 72  | 62  | 57  | 53  |  | 71  | 62  | 56  | 53  |  | 61  | 56  | 53  |  | 60  | 56  | 52  |  | 60  | 55  | 52  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |       |
|-----|-------|
|     | 0°    |
| 0°  | 65407 |
| 5°  | 63943 |
| 10° | 59118 |
| 15° | 53050 |
| 20° | 46700 |
| 25° | 40192 |
| 30° | 32372 |
| 35° | 21552 |
| 40° | 11210 |
| 45° | 5073  |
| 50° | 2198  |
| 55° | 1478  |
| 60° | 958   |
| 65° | 669   |
| 70° | 539   |
| 75° | 380   |
| 80° | 0     |
| 85° | 0     |



TEST NUMBER: P697166  
 CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-H

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 48.0   | 11.3      |
| 10°-20°   | 116.5  | 27.5      |
| 20°-30°   | 135.3  | 31.9      |
| 30°-40°   | 89.6   | 21.1      |
| 40°-50°   | 25.1   | 5.9       |
| 50°-60°   | 6.3    | 1.5       |
| 60°-70°   | 2.4    | 0.6       |
| 70°-80°   | 0.8    | 0.2       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 299.8  | 70.7      |
| 0°-40°    | 389.4  | 91.8      |
| 0°-60°    | 420.8  | 99.2      |
| 0°-90°    | 424.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 424.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 532 |      |
| 5°  | 518 | 48   |
| 15° | 417 | 117  |
| 25° | 296 | 135  |
| 35° | 144 | 90   |
| 45° | 29  | 25   |
| 55° | 7   | 6    |
| 65° | 2   | 2    |
| 75° | 1   | 1    |
| 85° | 0   | 0    |
| 90° | 0   |      |



TEST NUMBER: P697166

CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-H

**CANDELA DISTRIBUTION (FULL):**

|       | 0°    |
|-------|-------|
| 0°    | 532.4 |
| 2.5°  | 530.0 |
| 5°    | 518.5 |
| 7.5°  | 498.5 |
| 10°   | 473.9 |
| 12.5° | 446.3 |
| 15°   | 417.1 |
| 17.5° | 388.7 |
| 20°   | 357.2 |
| 22.5° | 328.0 |
| 25°   | 296.5 |
| 27.5° | 266.6 |
| 30°   | 228.2 |
| 32.5° | 187.4 |
| 35°   | 143.7 |
| 37.5° | 102.9 |
| 40°   | 69.9  |
| 42.5° | 45.3  |
| 45°   | 29.2  |
| 47.5° | 17.7  |
| 50°   | 11.5  |
| 52.5° | 8.4   |
| 55°   | 6.9   |
| 57.5° | 5.4   |
| 60°   | 3.9   |
| 62.5° | 3.1   |
| 65°   | 2.3   |
| 67.5° | 1.5   |
| 70°   | 1.5   |
| 72.5° | 0.8   |
| 75°   | 0.8   |
| 77.5° | 0.8   |
| 80°   | 0.0   |
| 82.5° | 0.0   |
| 85°   | 0.0   |
| 87.5° | 0.0   |
| 90°   | 0.0   |

(END OF REPORT)