

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697172

Luminaire Tested: **MRI-FEU4C-05-L950 F4X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697172
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU4C-05-L950 F4X-N-X-LI
Description: 4 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 499.0 lumens
Efficiency: N/A
Efficacy: 69.3 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697172
CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-LI

Luminous Intensity Polar Plot

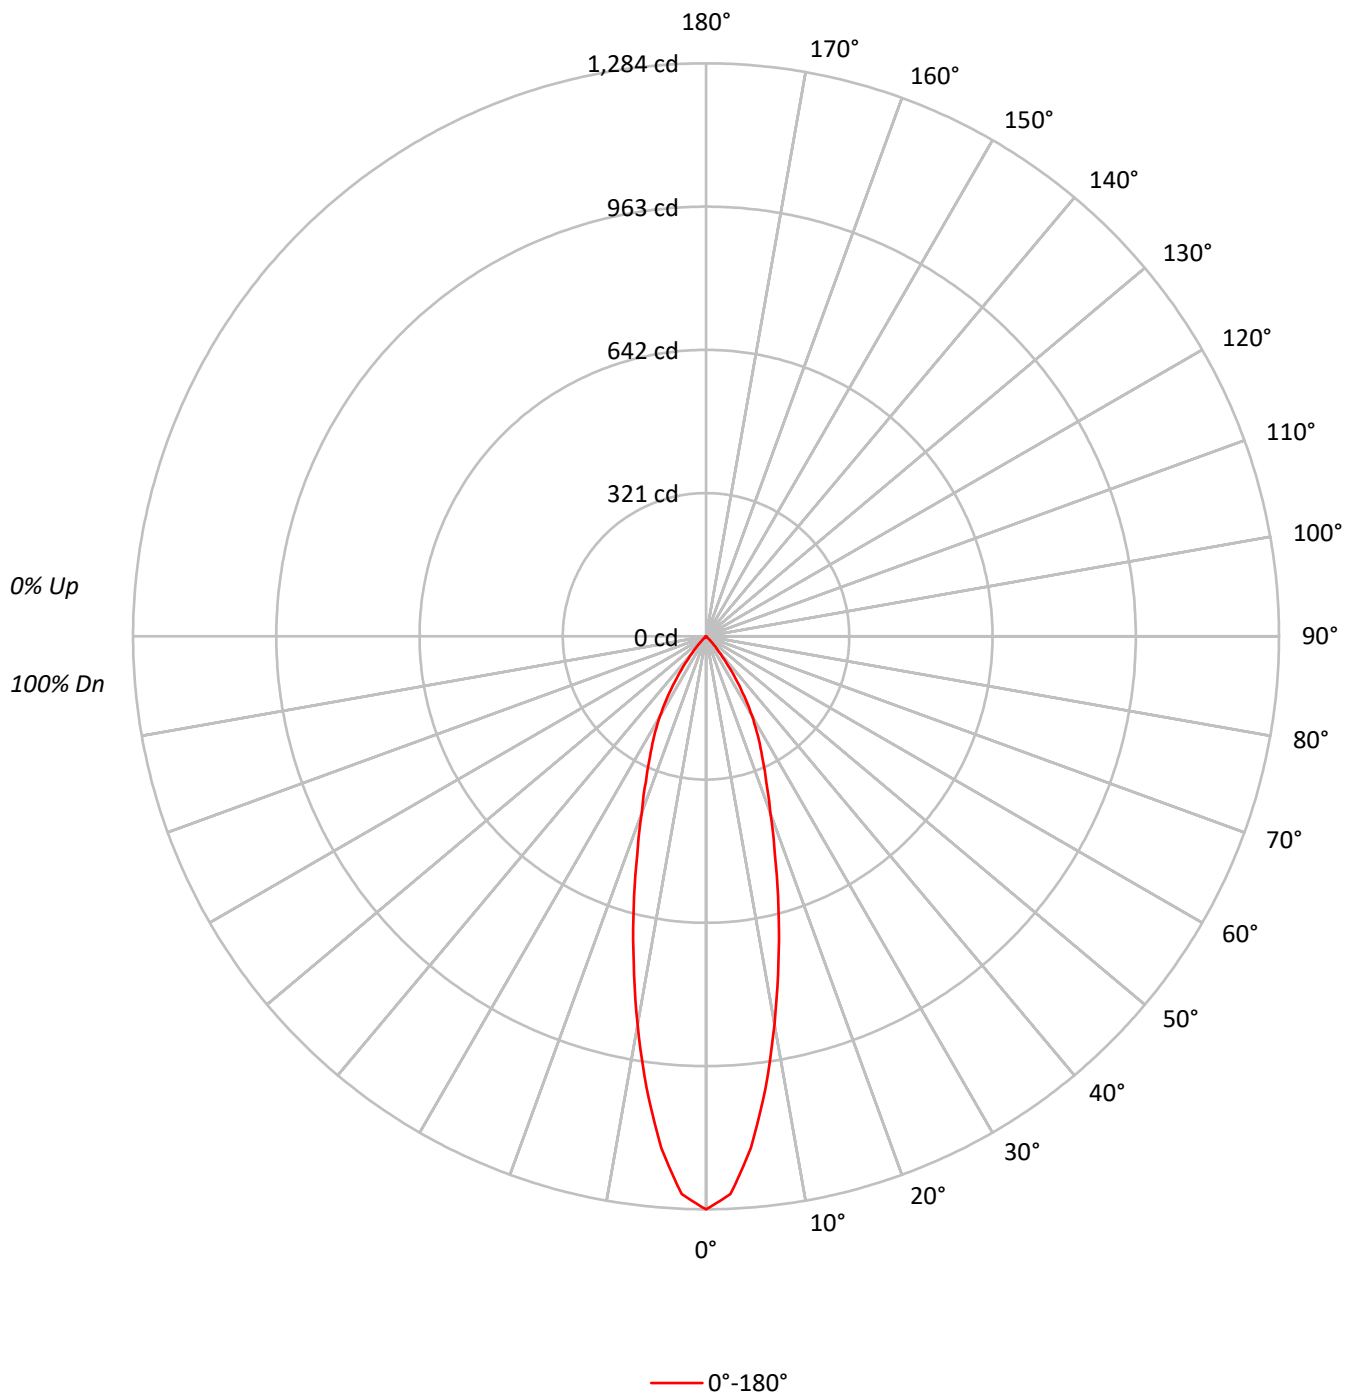



TEST NUMBER: P697172

CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	99	99
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	94	93
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90	89	88
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	84	83
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81	80	79
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77	76	75
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73	72	71
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69	68	67
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66	65	64
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63	62	61
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	157756
5°	141969
10°	110053
15°	79657
20°	55158
25°	40205
30°	29223
35°	17292
40°	7265
45°	2259
50°	287
55°	171
60°	197
65°	233
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P697172
 CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	101.2	20.3
10°-20°	173.3	34.7
20°-30°	137.7	27.6
30°-40°	72.9	14.6
40°-50°	12.5	2.5
50°-60°	0.9	0.2
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	412.1	82.6
0°-40°	485.0	97.2
0°-60°	498.5	99.9
0°-90°	499.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	499.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1284	
5°	1151	101
15°	626	173
25°	297	138
35°	115	73
45°	13	13
55°	1	1
65°	1	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P697172

CATALOG NUMBER: MRI-FEU4C-05-L950 F4X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1284.1
2.5°	1251.1
5°	1151.2
7.5°	1020.6
10°	882.2
12.5°	748.5
15°	626.3
17.5°	512.6
20°	421.9
22.5°	352.7
25°	296.6
27.5°	251.3
30°	206.0
32.5°	159.8
35°	115.3
37.5°	76.1
40°	45.3
42.5°	26.1
45°	13.0
47.5°	4.6
50°	1.5
52.5°	1.5
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)