

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697254

Luminaire Tested: **MRI-FEU6C-10-L930 F6X-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697254
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203254)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-10-L930 F6X-M-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 753.0 lumens
Efficiency: N/A
Efficacy: 77.2 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697254
CATALOG NUMBER: MRI-FEU6C-10-L930 F6X-M-X-H

Luminous Intensity Polar Plot

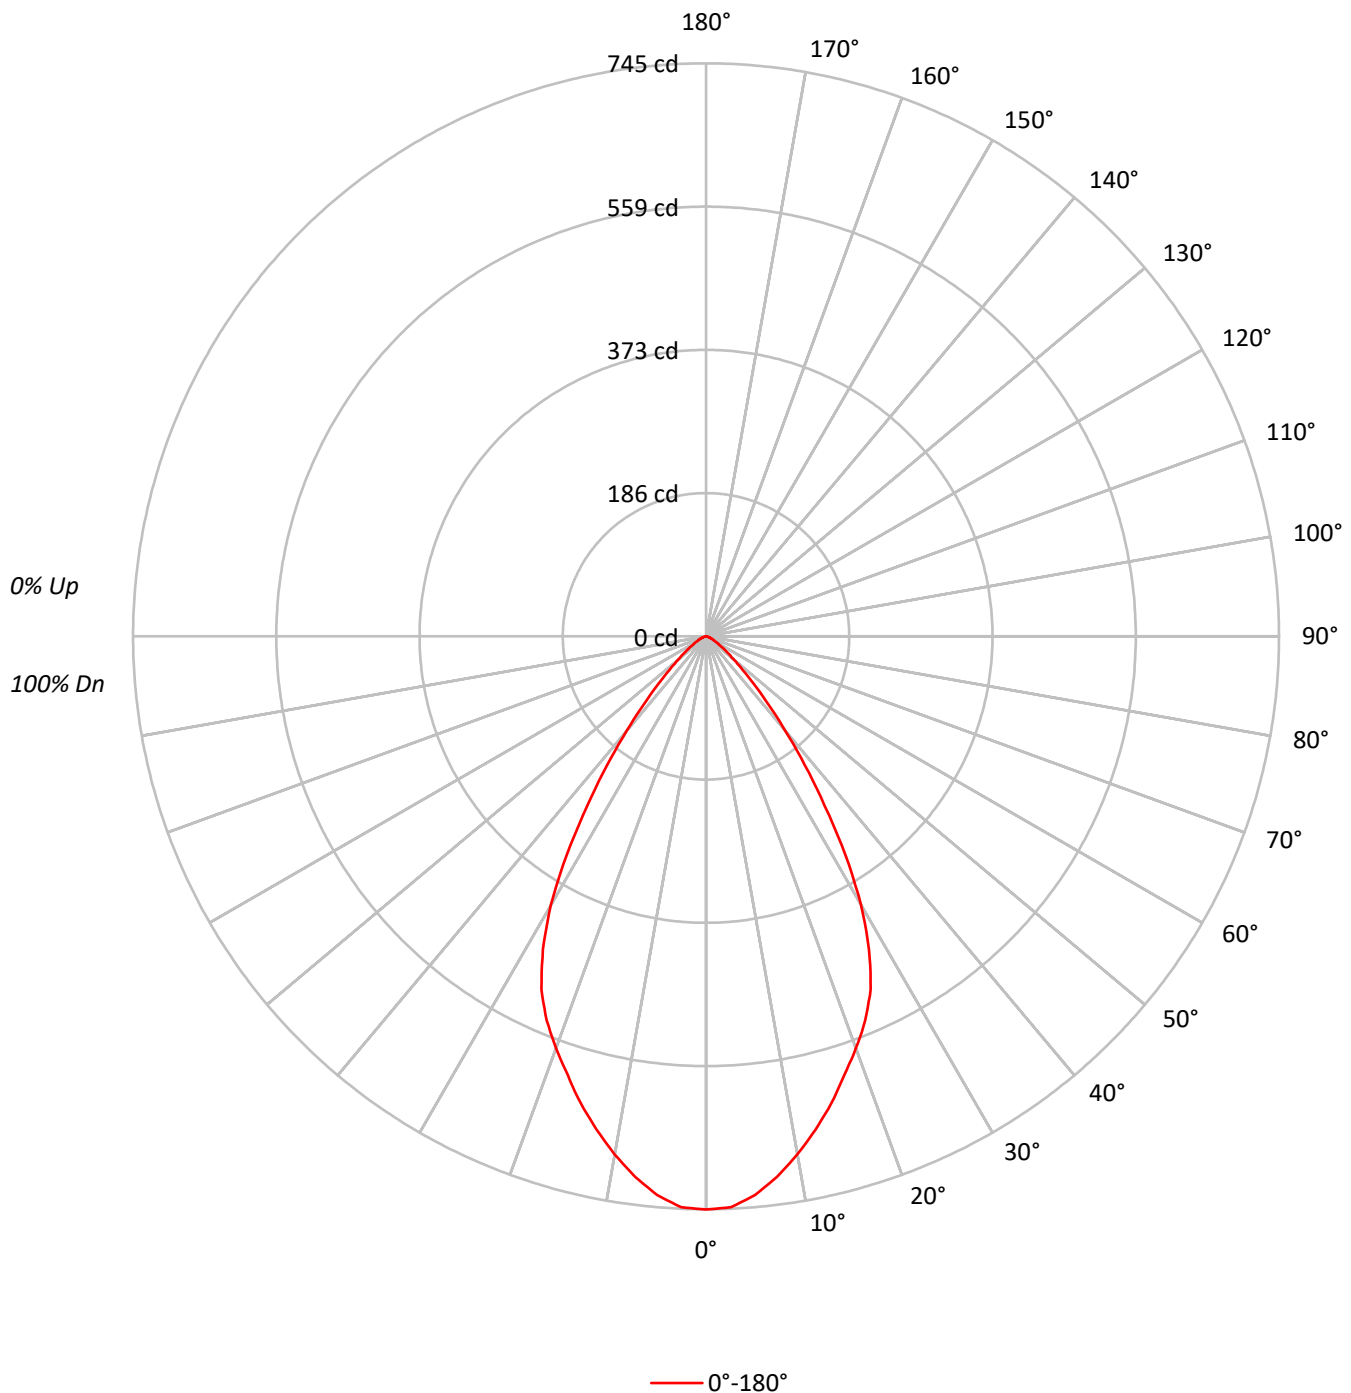



TEST NUMBER: P697254

CATALOG NUMBER: MRI-FEU6C-10-L930 F6X-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	113	110	107	105	111	108	105	103	104	102	100		100	99	97		92
2	107	102	97	93	105	100	96	92	97	93	90		94	91	88		85
3	101	94	88	84	99	92	87	83	90	86	82		87	84	81		78
4	95	87	81	76	93	86	80	76	84	79	75		82	78	74		72
5	90	81	75	70	88	80	74	70	78	73	69		76	72	68		66
6	85	75	69	64	83	75	69	64	73	68	64		72	67	63		61
7	80	70	64	59	79	70	64	59	68	63	59		67	62	59		57
8	76	66	60	55	75	65	59	55	64	59	55		63	58	55		53
9	72	62	56	51	71	61	55	51	60	55	51		60	55	51		49
10	69	58	52	48	68	58	52	48	57	52	48		56	51	48		46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	40852
5°	40122
10°	38070
15°	35698
20°	33247
25°	30637
30°	25523
35°	17989
40°	11464
45°	6838
50°	4034
55°	2571
60°	1765
65°	1258
70°	866
75°	678
80°	347
85°	0



TEST NUMBER: P697254
 CATALOG NUMBER: MRI-FEU6C-10-L930 F6X-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	68.1	9.0
10°-20°	176.3	23.4
20°-30°	228.4	30.3
30°-40°	169.6	22.5
40°-50°	71.6	9.5
50°-60°	25.4	3.4
60°-70°	9.8	1.3
70°-80°	3.4	0.5
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	472.8	62.8
0°-40°	642.3	85.3
0°-60°	739.3	98.2
0°-90°	753.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	753.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	745	
5°	729	68
15°	629	176
25°	506	228
35°	269	170
45°	88	72
55°	27	25
65°	10	10
75°	3	3
85°	0	0
90°	0	

TEST NUMBER: P697254

CATALOG NUMBER: MRI-FEU6C-10-L930 F6X-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	745.2
2.5°	743.0
5°	729.1
7.5°	708.6
10°	683.9
12.5°	657.0
15°	629.0
17.5°	597.9
20°	569.9
22.5°	540.9
25°	506.5
27.5°	459.1
30°	403.2
32.5°	337.6
35°	268.8
37.5°	210.8
40°	160.2
42.5°	119.3
45°	88.2
47.5°	64.5
50°	47.3
52.5°	35.5
55°	26.9
57.5°	20.4
60°	16.1
62.5°	11.8
65°	9.7
67.5°	7.5
70°	5.4
72.5°	4.3
75°	3.2
77.5°	2.2
80°	1.1
82.5°	1.1
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)