

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697364

Luminaire Tested: **MRI-FEU6C-10-L935 F6X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697364
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-10-L935 F6X-W-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1056.0 lumens
Efficiency: N/A
Efficacy: 108.3 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697364
CATALOG NUMBER: MRI-FEU6C-10-L935 F6X-W-X-LI

Luminous Intensity Polar Plot

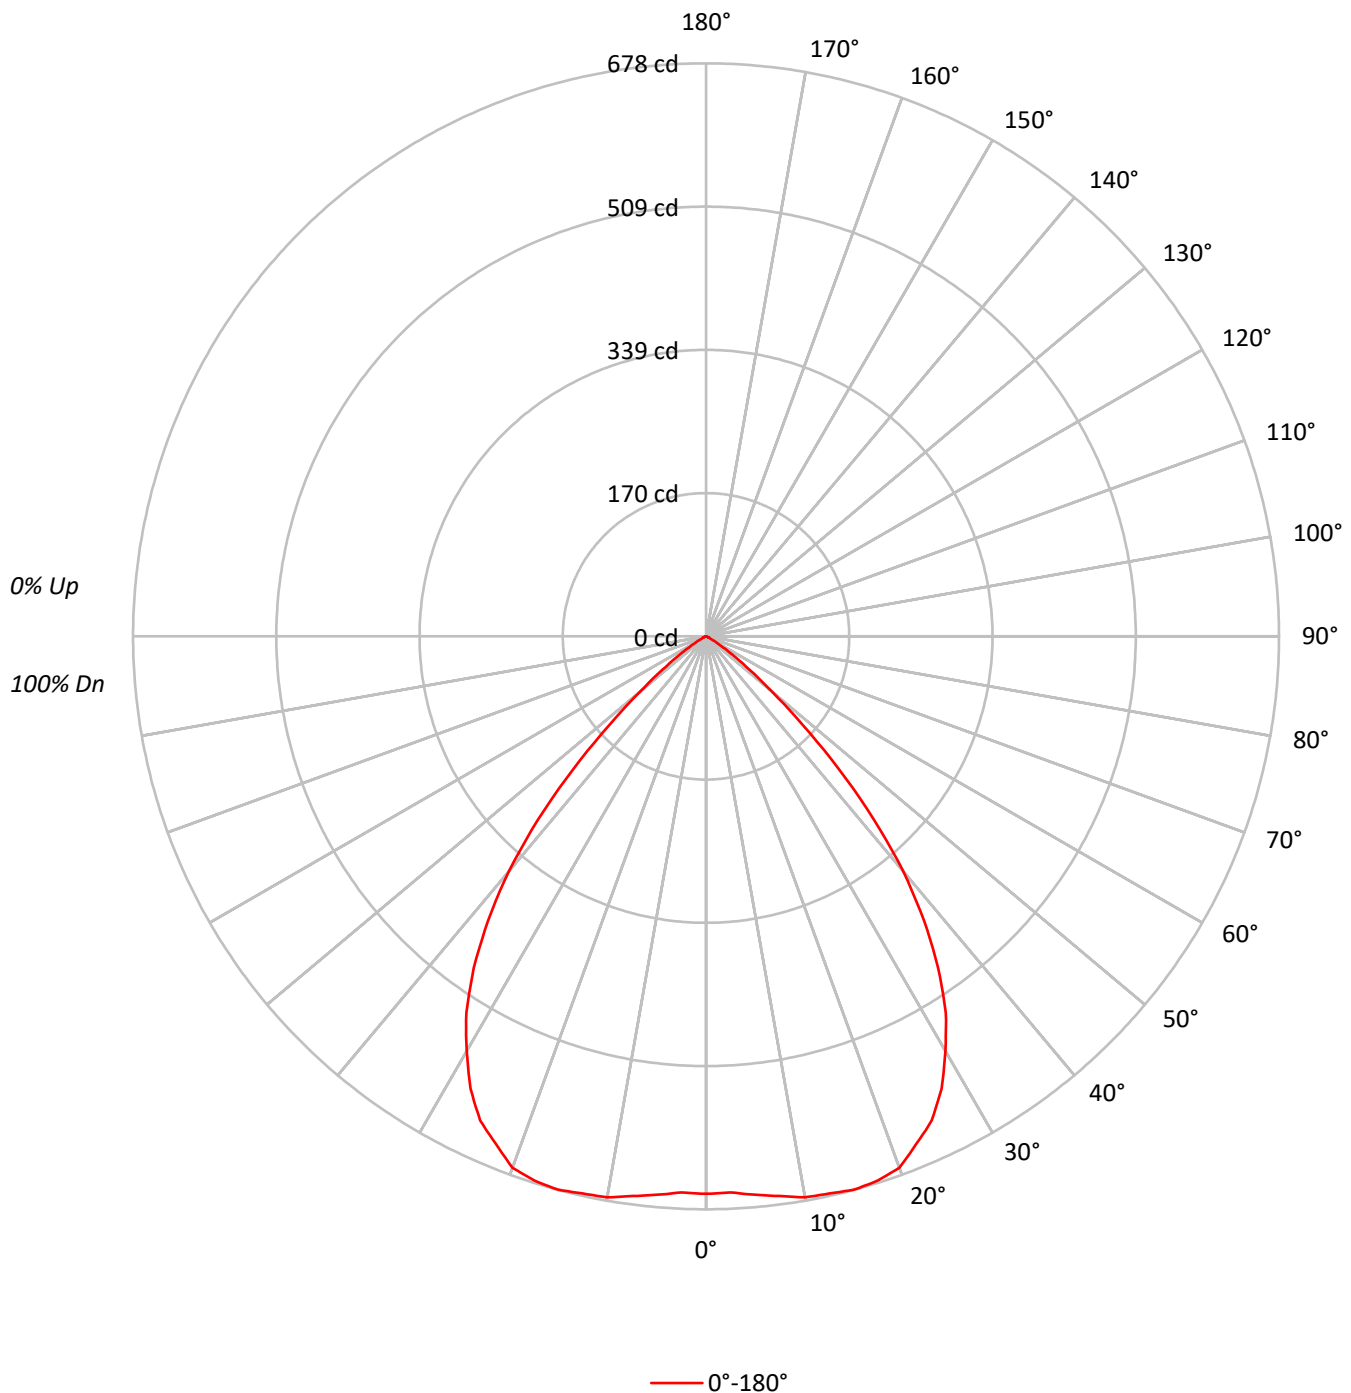



TEST NUMBER: P697364

CATALOG NUMBER: MRI-FEU6C-10-L935 F6X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92	92	92
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83	83	83
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76	76	76
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69	69	69
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63	63	63
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57	57	57
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52	52	52
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48	48	48
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44	44	44
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41	41	41

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	36165
5°	36501
10°	37519
15°	38462
20°	39046
25°	38240
30°	35847
35°	32049
40°	25963
45°	17172
50°	8682
55°	3661
60°	1184
65°	467
70°	385
75°	254
80°	0
85°	0



TEST NUMBER: P697364
 CATALOG NUMBER: MRI-FEU6C-10-L935 F6X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.6	6.0
10°-20°	191.3	18.1
20°-30°	288.4	27.3
30°-40°	295.1	27.9
40°-50°	171.9	16.3
50°-60°	39.5	3.7
60°-70°	4.9	0.5
70°-80°	1.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	543.3	51.4
0°-40°	838.4	79.4
0°-60°	1049.9	99.4
0°-90°	1056.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1056.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	660	
5°	663	64
15°	678	191
25°	632	288
35°	479	295
45°	222	172
55°	38	40
65°	4	5
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P697364
CATALOG NUMBER: MRI-FEU6C-10-L935 F6X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	659.7
2.5°	658.5
5°	663.3
7.5°	668.1
10°	674.0
12.5°	675.3
15°	677.7
17.5°	675.3
20°	669.3
22.5°	650.1
25°	632.2
27.5°	603.4
30°	566.3
32.5°	528.0
35°	478.9
37.5°	423.8
40°	362.8
42.5°	294.5
45°	221.5
47.5°	154.4
50°	101.8
52.5°	64.7
55°	38.3
57.5°	20.4
60°	10.8
62.5°	6.0
65°	3.6
67.5°	3.6
70°	2.4
72.5°	1.2
75°	1.2
77.5°	1.2
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)