

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697494

Luminaire Tested: **MRI-FEU6C-15-L927 F6X-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697494
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203254)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-15-L927 F6X-M-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 6LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1110.0 lumens
Efficiency: N/A
Efficacy: 70.3 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697494
CATALOG NUMBER: MRI-FEU6C-15-L927 F6X-M-X-H

Luminous Intensity Polar Plot

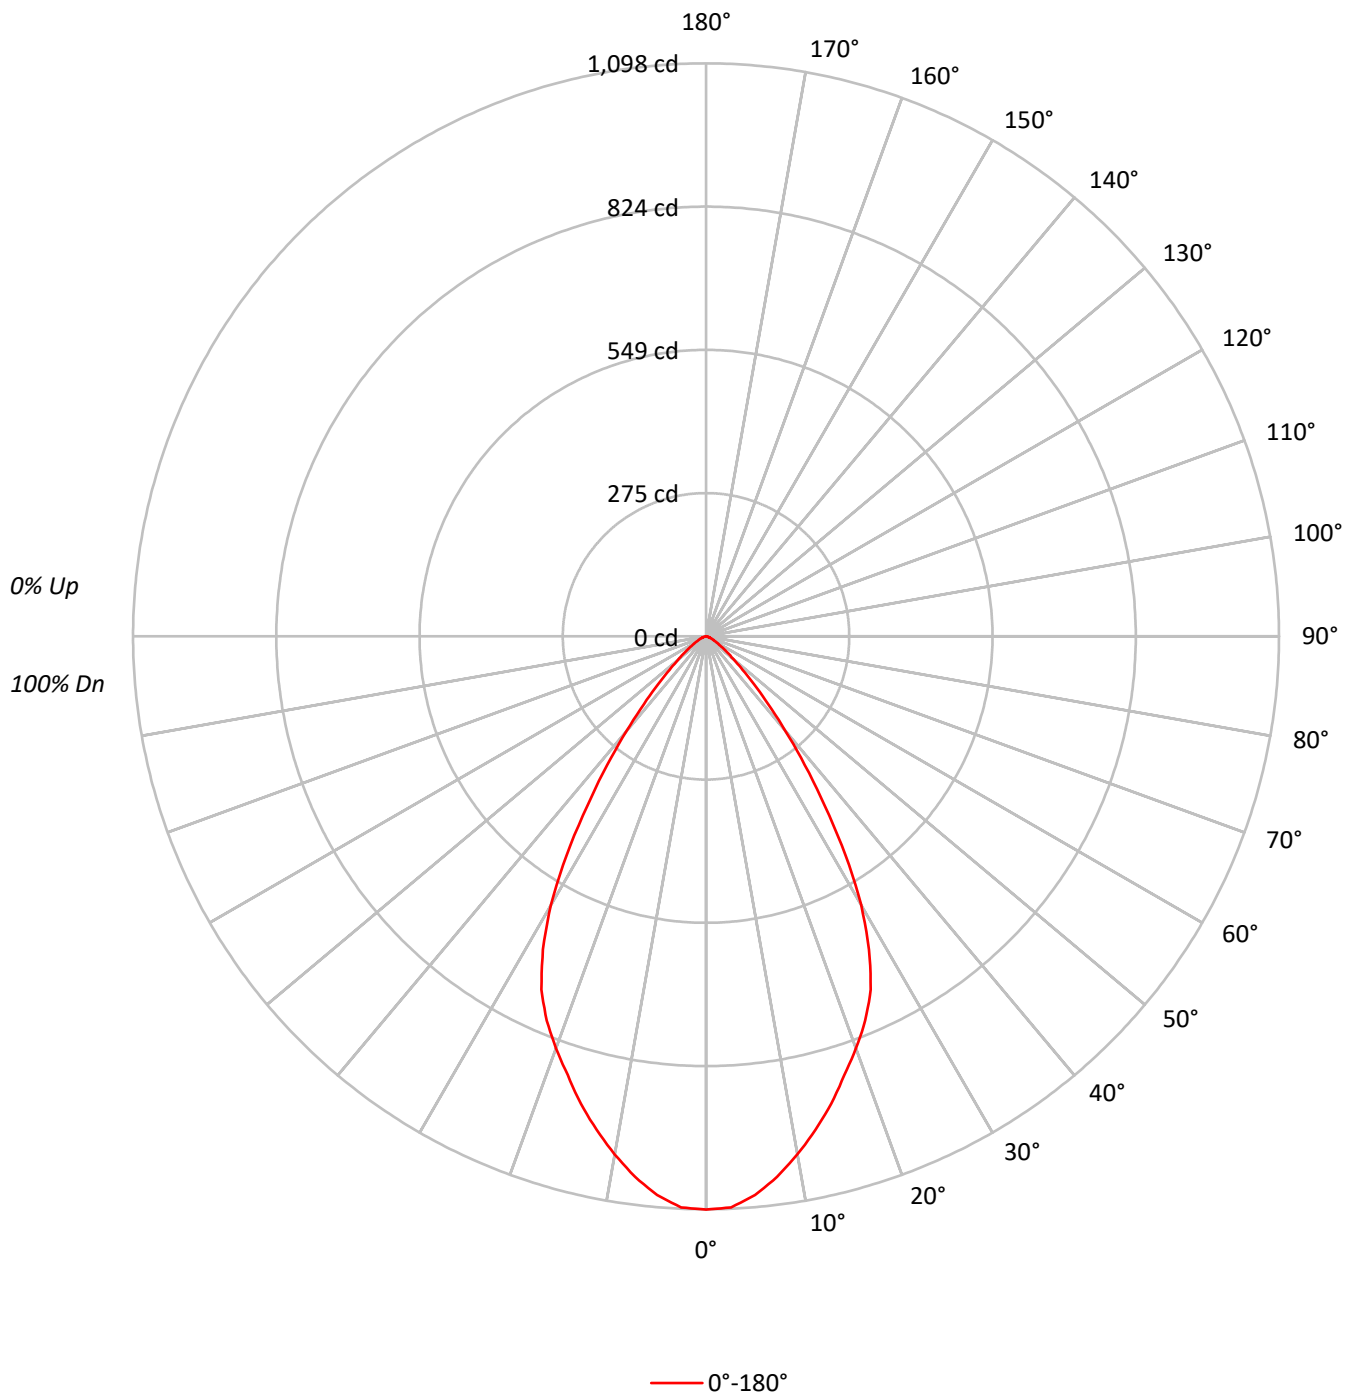



TEST NUMBER: P697494

CATALOG NUMBER: MRI-FEU6C-15-L927 F6X-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92		
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85		
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78		
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72		
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66		
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61		
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57		
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53		
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49		
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	60220
5°	59140
10°	56122
15°	52628
20°	49010
25°	45160
30°	37626
35°	26522
40°	16903
45°	10079
50°	5953
55°	3785
60°	2609
65°	1855
70°	1266
75°	1017
80°	505
85°	0



TEST NUMBER: P697494
 CATALOG NUMBER: MRI-FEU6C-15-L927 F6X-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	100.4	9.0
10°-20°	259.8	23.4
20°-30°	336.7	30.3
30°-40°	250.0	22.5
40°-50°	105.5	9.5
50°-60°	37.5	3.4
60°-70°	14.5	1.3
70°-80°	5.0	0.5
80°-90°	0.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	697.0	62.8
0°-40°	946.9	85.3
0°-60°	1089.9	98.2
0°-90°	1110.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1110.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1098	
5°	1075	100
15°	927	260
25°	747	337
35°	396	250
45°	130	106
55°	40	37
65°	14	14
75°	5	5
85°	0	1
90°	0	



TEST NUMBER: P697494
CATALOG NUMBER: MRI-FEU6C-15-L927 F6X-M-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1098.5
2.5°	1095.3
5°	1074.7
7.5°	1044.6
10°	1008.2
12.5°	968.5
15°	927.3
17.5°	881.4
20°	840.1
22.5°	797.3
25°	746.6
27.5°	676.8
30°	594.4
32.5°	497.7
35°	396.3
37.5°	310.7
40°	236.2
42.5°	175.9
45°	130.0
47.5°	95.1
50°	69.8
52.5°	52.3
55°	39.6
57.5°	30.1
60°	23.8
62.5°	17.5
65°	14.3
67.5°	11.1
70°	7.9
72.5°	6.3
75°	4.8
77.5°	3.2
80°	1.6
82.5°	1.6
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)