

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697754

Luminaire Tested: **MRI-FEU6C-15-L950 F6X-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697754
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-15-L950 F6X-N-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1029.0 lumens
Efficiency: N/A
Efficacy: 65.1 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697754

CATALOG NUMBER: MRI-FEU6C-15-L950 F6X-N-X-H

Luminous Intensity Polar Plot

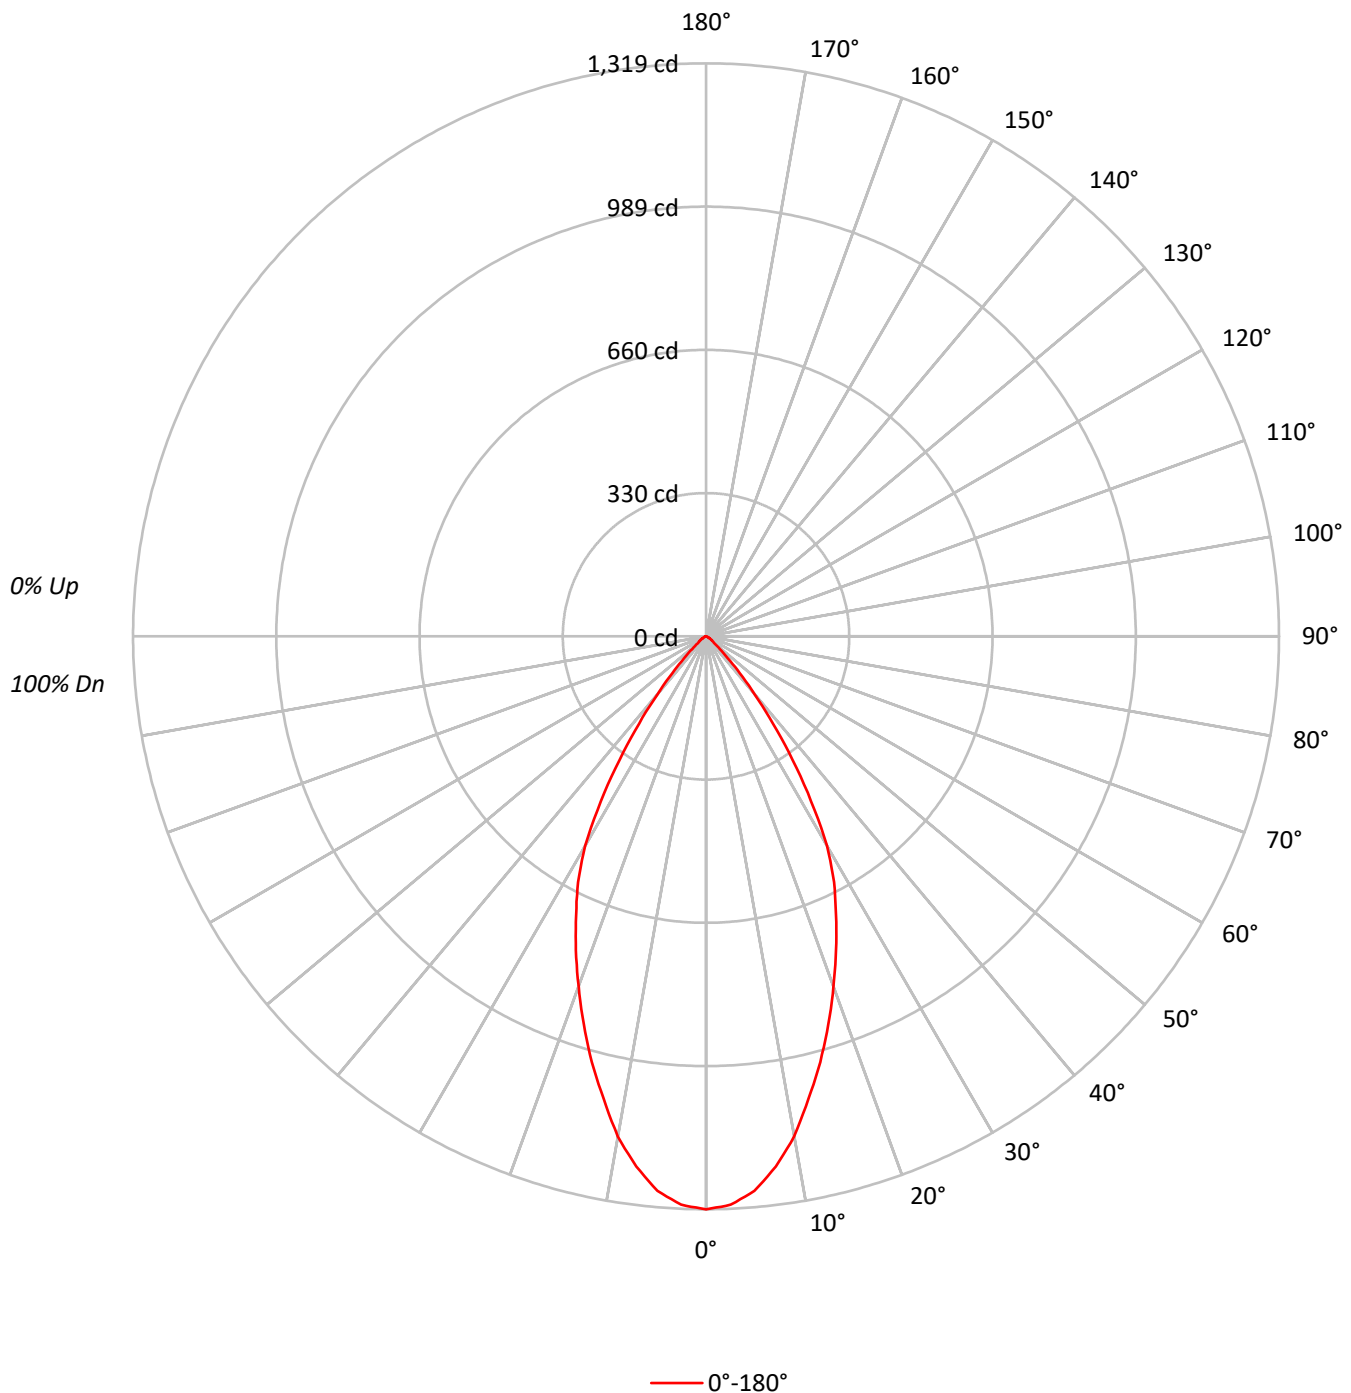



TEST NUMBER: P697754

CATALOG NUMBER: MRI-FEU6C-15-L950 F6X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					30					10					0
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	113	111	108	106		111	109	106	104		104	103	101		101	99	98		97	96	95
2	108	103	99	96		106	101	98	94		98	95	92		95	93	90		92	90	89
3	102	96	91	87		100	95	90	86		92	88	85		90	86	84		87	85	82
4	97	90	84	80		95	89	83	79		86	82	78		84	81	78		83	79	77
5	92	84	78	74		91	83	78	73		81	76	73		80	75	72		78	74	72
6	88	79	73	69		86	78	72	68		77	72	68		75	71	67		74	70	67
7	83	74	68	64		82	73	68	64		72	67	63		71	66	63		70	66	63
8	79	70	64	60		78	69	64	60		68	63	59		67	63	59		66	62	59
9	76	66	60	56		75	66	60	56		65	59	56		64	59	56		63	59	55
10	72	62	57	53		71	62	57	53		61	56	53		60	56	52		60	55	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	72313
5°	70520
10°	65073
15°	57611
20°	50025
25°	42789
30°	35278
35°	23229
40°	12488
45°	5528
50°	2243
55°	1615
60°	1031
65°	739
70°	609
75°	402
80°	600
85°	0



TEST NUMBER: P697754

CATALOG NUMBER: MRI-FEU6C-15-L950 F6X-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	118.6	11.5
10°-20°	282.9	27.5
20°-30°	324.1	31.5
30°-40°	217.7	21.2
40°-50°	62.2	6.0
50°-60°	15.2	1.5
60°-70°	5.8	0.6
70°-80°	2.3	0.2
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	725.6	70.5
0°-40°	943.3	91.7
0°-60°	1020.7	99.2
0°-90°	1029.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1029.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1319	
5°	1282	119
15°	1015	283
25°	707	324
35°	347	218
45°	71	62
55°	17	15
65°	6	6
75°	2	2
85°	0	0
90°	0	

TEST NUMBER: P697754

CATALOG NUMBER: MRI-FEU6C-15-L950 F6X-N-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1319.1
2.5°	1309.7
5°	1281.5
7.5°	1230.8
10°	1169.0
12.5°	1090.1
15°	1015.1
17.5°	936.3
20°	857.5
22.5°	782.4
25°	707.4
27.5°	637.9
30°	557.3
32.5°	450.3
35°	347.1
37.5°	253.3
40°	174.5
42.5°	114.4
45°	71.3
47.5°	43.1
50°	26.3
52.5°	20.6
55°	16.9
57.5°	13.1
60°	9.4
62.5°	7.5
65°	5.7
67.5°	3.8
70°	3.8
72.5°	1.9
75°	1.9
77.5°	1.9
80°	1.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)