

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697914

Luminaire Tested: **MRI-FEU6C-20-L935 F6X-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697914
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203254)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-20-L935 F6X-M-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 6LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1509.0 lumens
Efficiency: N/A
Efficacy: 69.2 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.93
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697914
CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-M-X-H

Luminous Intensity Polar Plot

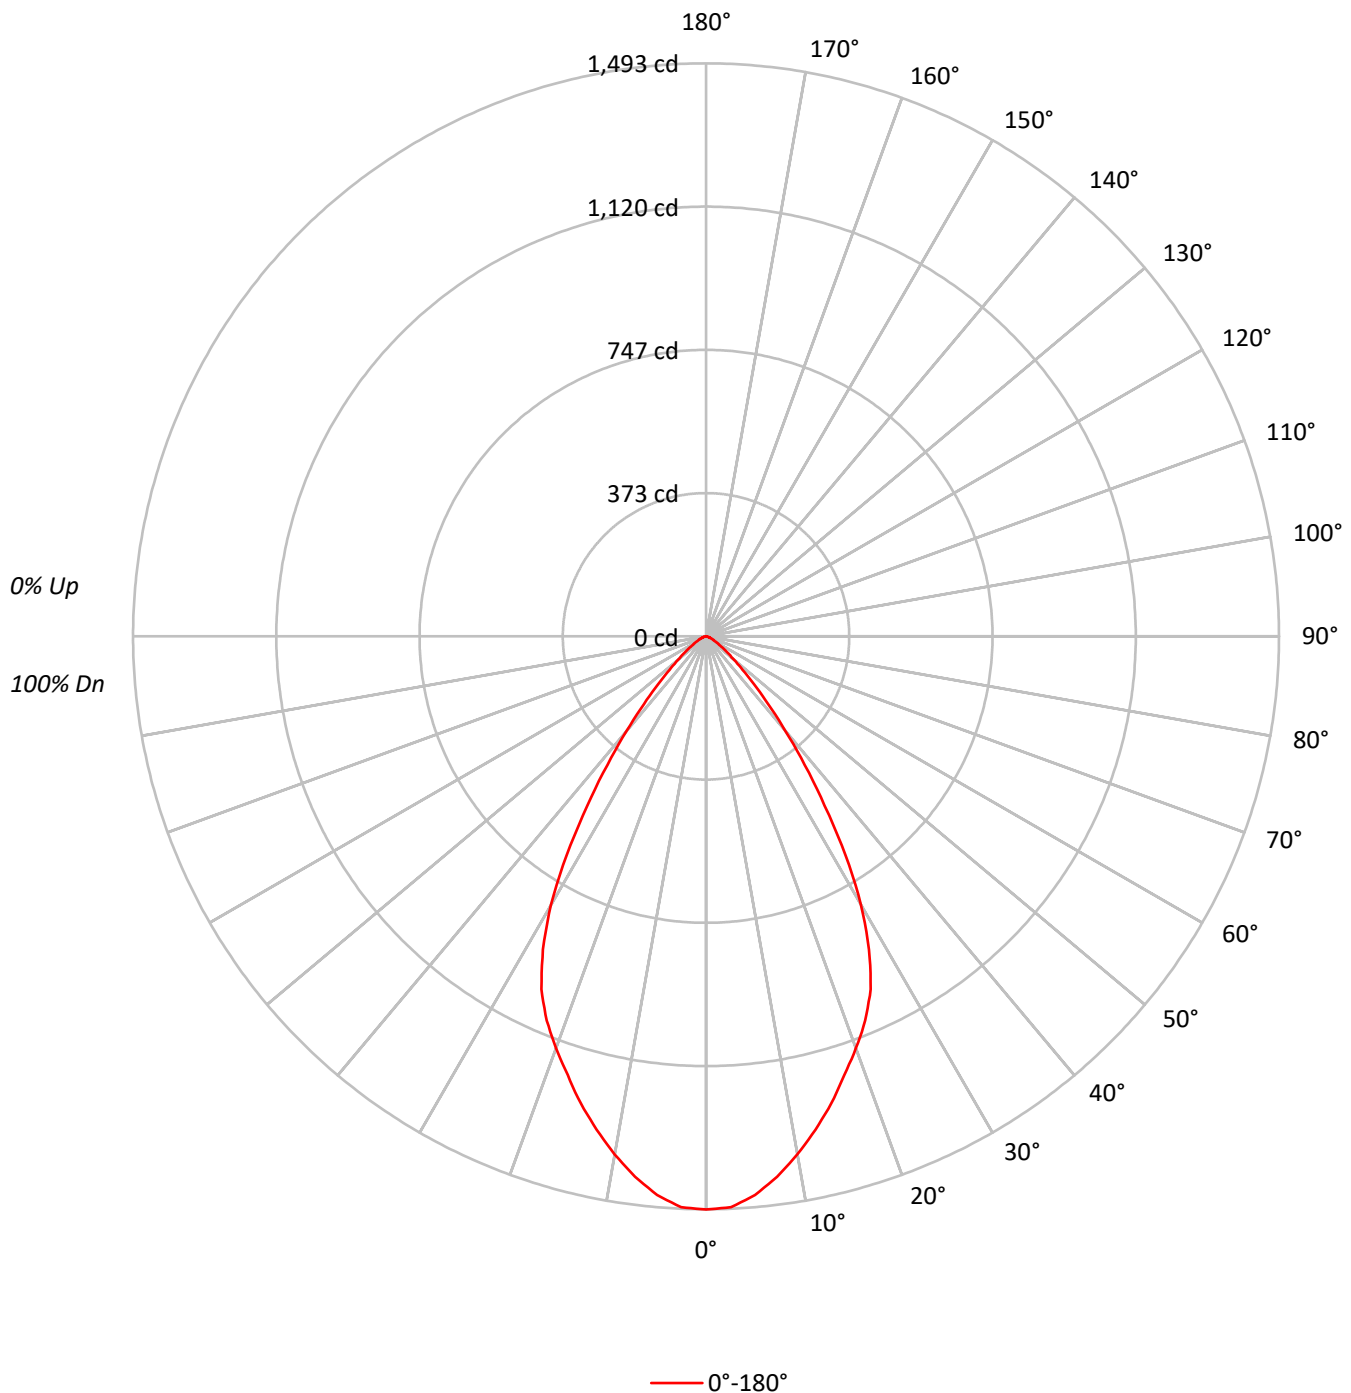



TEST NUMBER: P697914

CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	92		
2	107	102	97	93	105	100	96	92	97	93	90	94	91	88	91	89	87	85		
3	101	94	88	84	99	92	88	84	90	86	82	87	84	81	85	82	80	78		
4	95	87	81	76	93	86	80	76	84	79	75	82	78	74	80	76	73	72		
5	90	81	75	70	88	80	74	70	78	73	69	76	72	68	75	71	68	66		
6	85	75	69	64	83	75	69	64	73	68	64	72	67	63	70	66	63	61		
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57		
8	76	66	60	55	75	65	59	55	64	59	55	63	58	55	62	58	54	53		
9	72	62	56	51	71	61	55	51	60	55	51	60	55	51	59	54	51	49		
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	55	51	48	46		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	81868
5°	80404
10°	76296
15°	71544
20°	66628
25°	61395
30°	51153
35°	36051
40°	22979
45°	13699
50°	8085
55°	5142
60°	3541
65°	2516
70°	1731
75°	1377
80°	663
85°	0



TEST NUMBER: P697914
 CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	136.5	9.0
10°-20°	353.2	23.4
20°-30°	457.7	30.3
30°-40°	339.8	22.5
40°-50°	143.4	9.5
50°-60°	50.9	3.4
60°-70°	19.7	1.3
70°-80°	6.8	0.5
80°-90°	0.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	947.5	62.8
0°-40°	1287.3	85.3
0°-60°	1481.6	98.2
0°-90°	1509.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1509.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1493	
5°	1461	137
15°	1261	353
25°	1015	458
35°	539	340
45°	177	143
55°	54	51
65°	19	20
75°	6	7
85°	0	1
90°	0	



TEST NUMBER: P697914
CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-M-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1493.4
2.5°	1489.1
5°	1461.1
7.5°	1420.1
10°	1370.6
12.5°	1316.6
15°	1260.6
17.5°	1198.2
20°	1142.1
22.5°	1083.9
25°	1015.0
27.5°	920.1
30°	808.1
32.5°	676.6
35°	538.7
37.5°	422.4
40°	321.1
42.5°	239.2
45°	176.7
47.5°	129.3
50°	94.8
52.5°	71.1
55°	53.8
57.5°	40.9
60°	32.3
62.5°	23.7
65°	19.4
67.5°	15.1
70°	10.8
72.5°	8.6
75°	6.5
77.5°	4.3
80°	2.1
82.5°	2.1
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)