

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P697934

Luminaire Tested: **MRI-FEU6C-20-L935 F6X-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P697934
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-20-L935 F6X-N-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1299.0 lumens
Efficiency: N/A
Efficacy: 59.6 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P697934

CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-N-X-H

Luminous Intensity Polar Plot

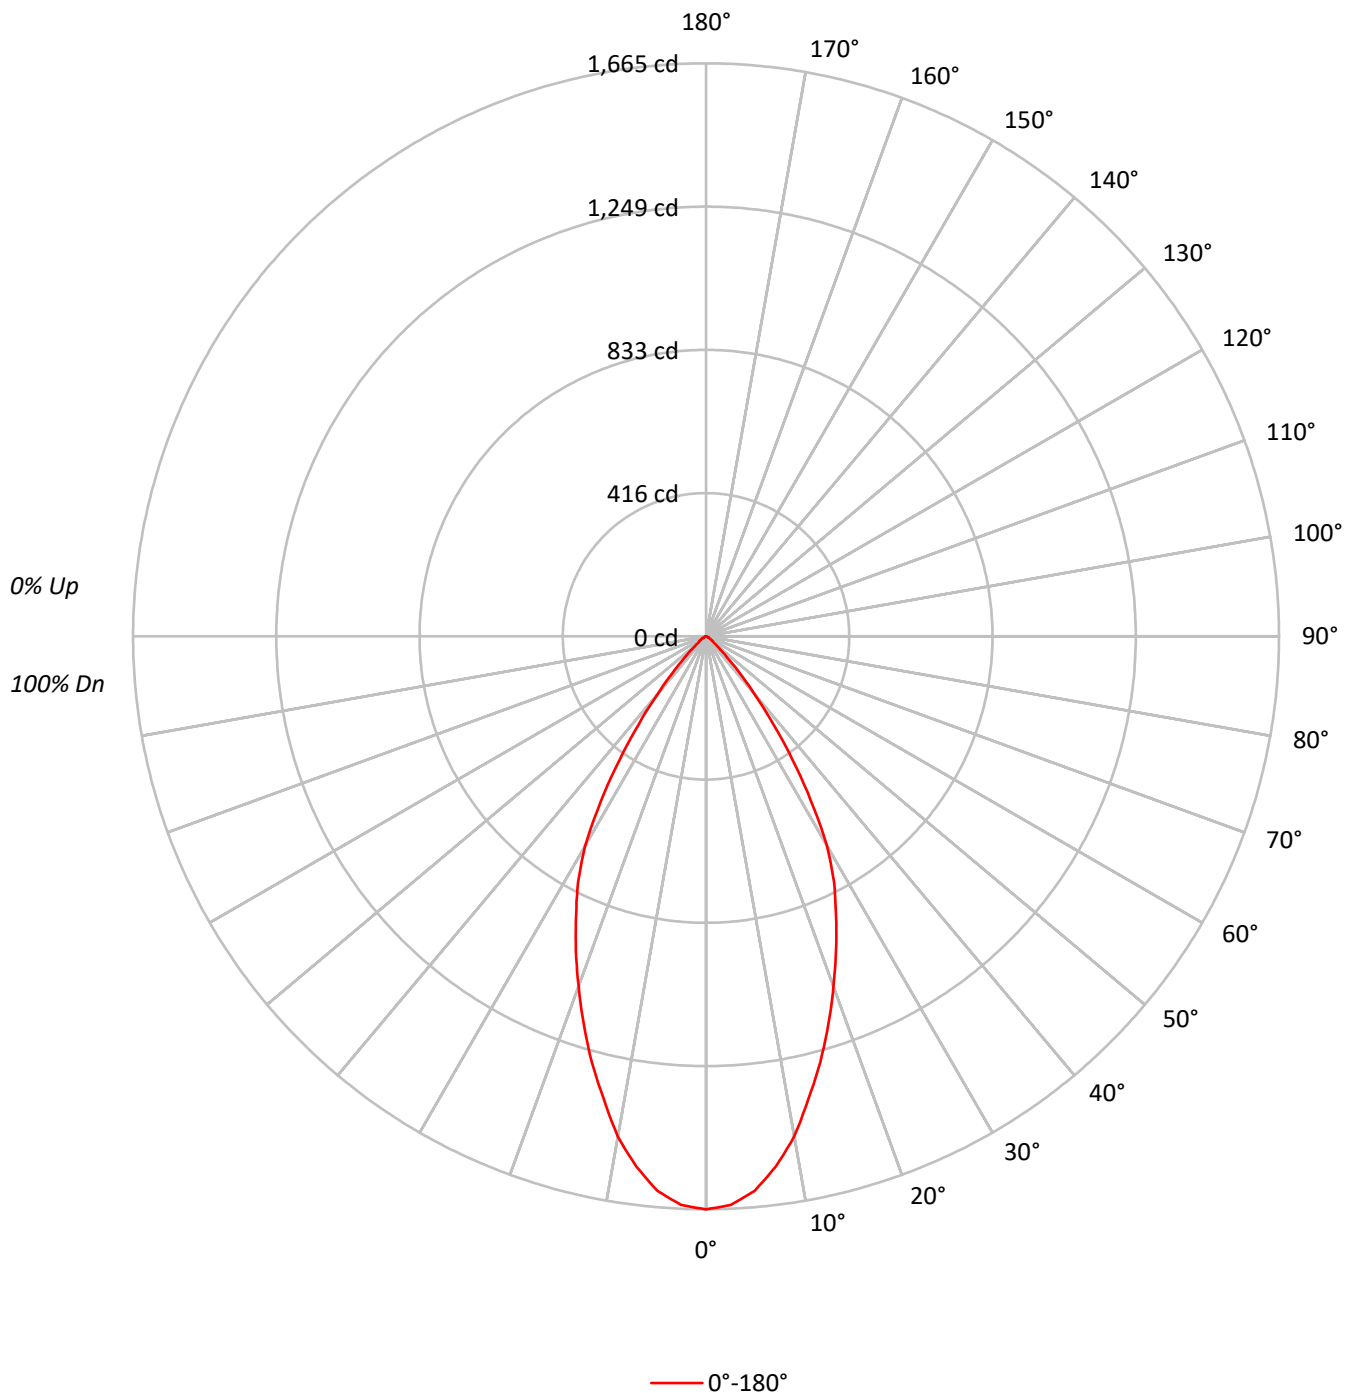



TEST NUMBER: P697934

CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75		
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70		
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65		
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61		
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58		
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54		
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	91287
5°	89027
10°	82146
15°	72730
20°	63145
25°	54015
30°	44532
35°	29326
40°	15765
45°	6977
50°	2831
55°	2045
60°	1294
65°	921
70°	769
75°	508
80°	758
85°	0



TEST NUMBER: P697934

CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.7	11.5
10°-20°	357.1	27.5
20°-30°	409.1	31.5
30°-40°	274.8	21.2
40°-50°	78.5	6.0
50°-60°	19.2	1.5
60°-70°	7.3	0.6
70°-80°	2.9	0.2
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	915.9	70.5
0°-40°	1190.8	91.7
0°-60°	1288.5	99.2
0°-90°	1299.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1299.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1665	
5°	1618	150
15°	1282	357
25°	893	409
35°	438	275
45°	90	79
55°	21	19
65°	7	7
75°	2	3
85°	0	0
90°	0	



TEST NUMBER: P697934

CATALOG NUMBER: MRI-FEU6C-20-L935 F6X-N-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1665.2
2.5°	1653.4
5°	1617.8
7.5°	1553.8
10°	1475.7
12.5°	1376.2
15°	1281.5
17.5°	1182.0
20°	1082.4
22.5°	987.7
25°	893.0
27.5°	805.3
30°	703.5
32.5°	568.4
35°	438.2
37.5°	319.7
40°	220.3
42.5°	144.5
45°	90.0
47.5°	54.5
50°	33.2
52.5°	26.0
55°	21.4
57.5°	16.6
60°	11.8
62.5°	9.4
65°	7.1
67.5°	4.8
70°	4.8
72.5°	2.4
75°	2.4
77.5°	2.4
80°	2.4
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)