

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698074

Luminaire Tested: **MRI-FEU6C-20-L950 F6X-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698074
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-20-L950 F6X-W-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1867.0 lumens
Efficiency: N/A
Efficacy: 85.6 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698074
CATALOG NUMBER: MRI-FEU6C-20-L950 F6X-W-X-H

Luminous Intensity Polar Plot

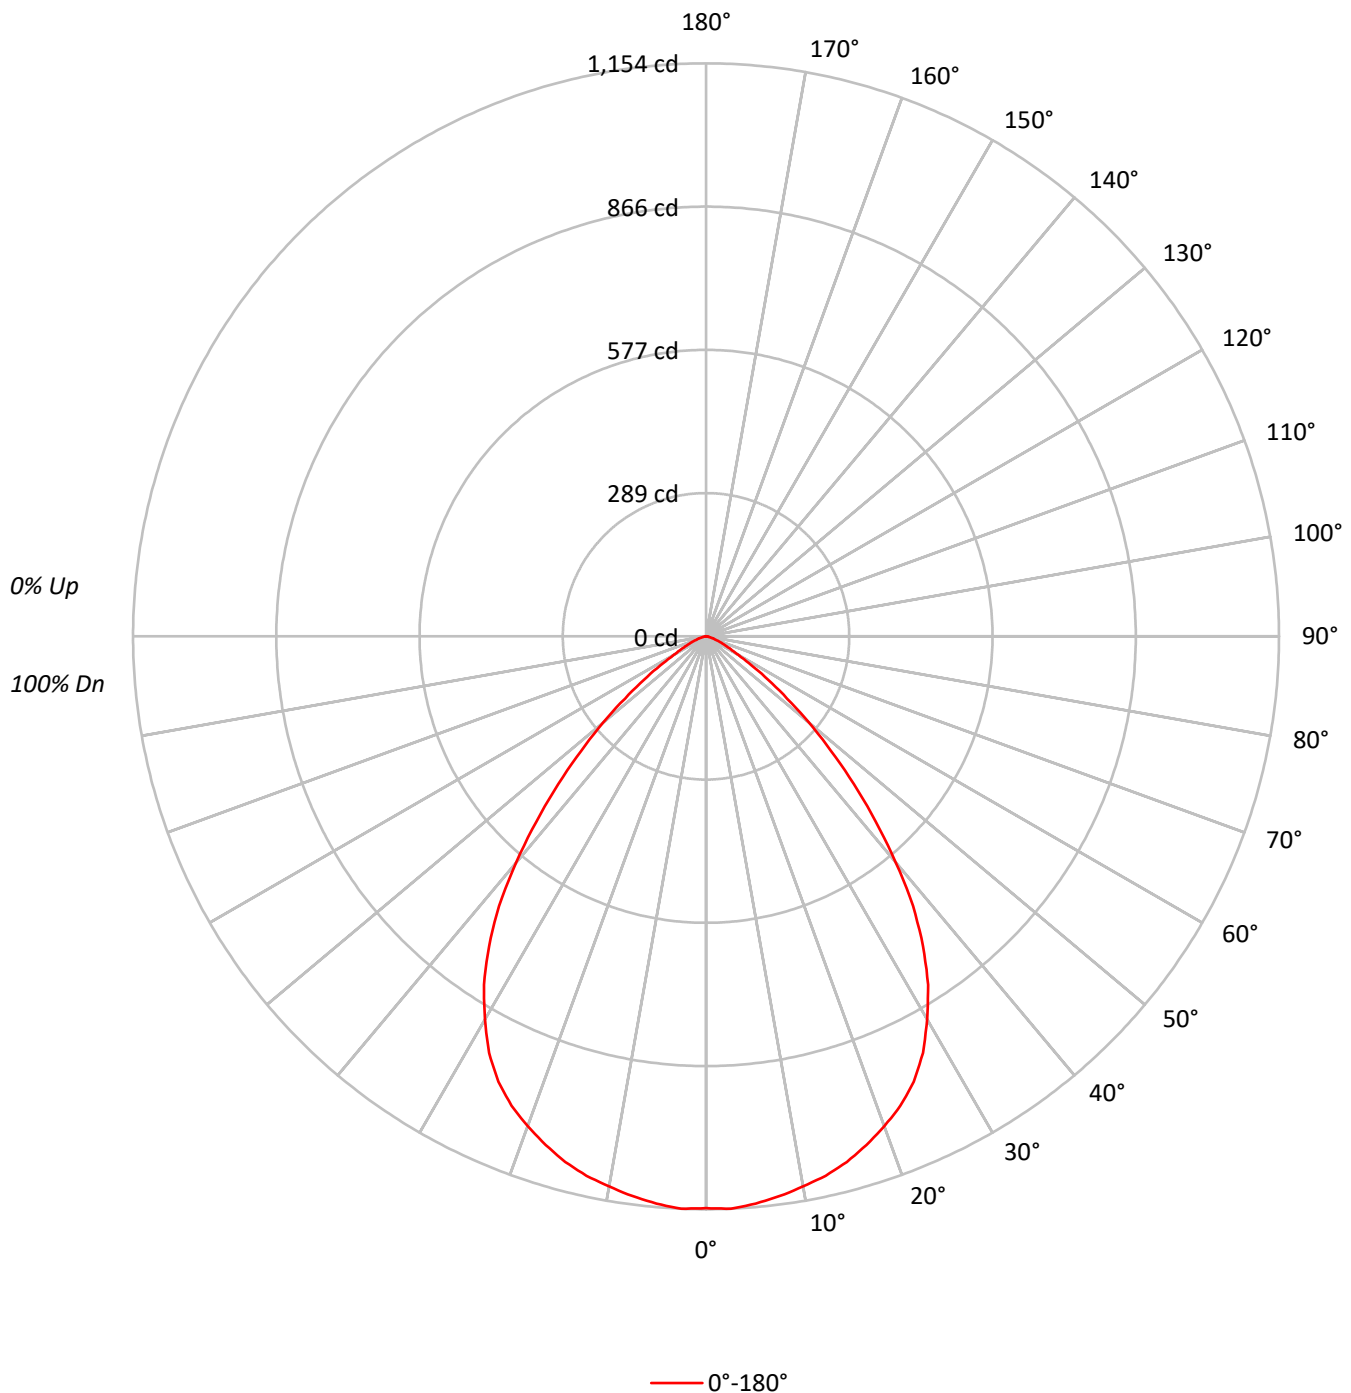



TEST NUMBER: P698074

CATALOG NUMBER: MRI-FEU6C-20-L950 F6X-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	101	103	100	98		99	97	95		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		81
4	92	82	75	70	90	81	75	70	79	73	69		77	72	68		75
5	86	75	68	63	84	74	68	63	72	66	62		71	65	61		69
6	80	69	62	57	78	68	61	56	67	61	56		65	60	56		64
7	75	64	56	51	73	63	56	51	62	55	51		60	55	51		59
8	70	59	52	47	69	58	51	47	57	51	46		56	50	46		55
9	66	55	48	43	65	54	47	43	53	47	43		52	47	42		51
10	62	51	44	40	61	50	44	39	50	43	39		49	43	39		48

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	63125
5°	63102
10°	62619
15°	62197
20°	61249
25°	59852
30°	56357
35°	51002
40°	42587
45°	32631
50°	23112
55°	14566
60°	8223
65°	5331
70°	3478
75°	2563
80°	1547
85°	1510



TEST NUMBER: P698074
 CATALOG NUMBER: MRI-FEU6C-20-L950 F6X-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	108.8	5.8
10°-20°	308.6	16.5
20°-30°	452.5	24.2
30°-40°	470.9	25.2
40°-50°	325.8	17.5
50°-60°	141.9	7.6
60°-70°	43.5	2.3
70°-80°	13.0	0.7
80°-90°	2.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	869.9	46.6
0°-40°	1340.8	71.8
0°-60°	1808.5	96.9
0°-90°	1867.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1867.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1152	
5°	1147	109
15°	1096	309
25°	990	452
35°	762	471
45°	421	326
55°	152	142
65°	41	44
75°	12	13
85°	2	2
90°	0	

TEST NUMBER: P698074

CATALOG NUMBER: MRI-FEU6C-20-L950 F6X-W-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1151.5
2.5°	1153.9
5°	1146.7
7.5°	1137.1
10°	1124.9
12.5°	1112.8
15°	1095.9
17.5°	1074.1
20°	1049.9
22.5°	1023.3
25°	989.5
27.5°	945.9
30°	890.3
32.5°	832.2
35°	762.1
37.5°	684.7
40°	595.1
42.5°	505.6
45°	420.9
47.5°	341.1
50°	271.0
52.5°	205.7
55°	152.4
57.5°	108.9
60°	75.0
62.5°	55.7
65°	41.1
67.5°	31.5
70°	21.7
72.5°	17.0
75°	12.1
77.5°	7.2
80°	4.9
82.5°	2.4
85°	2.4
87.5°	0.0
90°	0.0

(END OF REPORT)