

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698174

Luminaire Tested: **MRI-FEU6C-25-L930 F6X-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698174
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-25-L930 F6X-N-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBNH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1607.9 lumens
Efficiency: N/A
Efficacy: 51.0 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698174
CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-N-X-H

Luminous Intensity Polar Plot

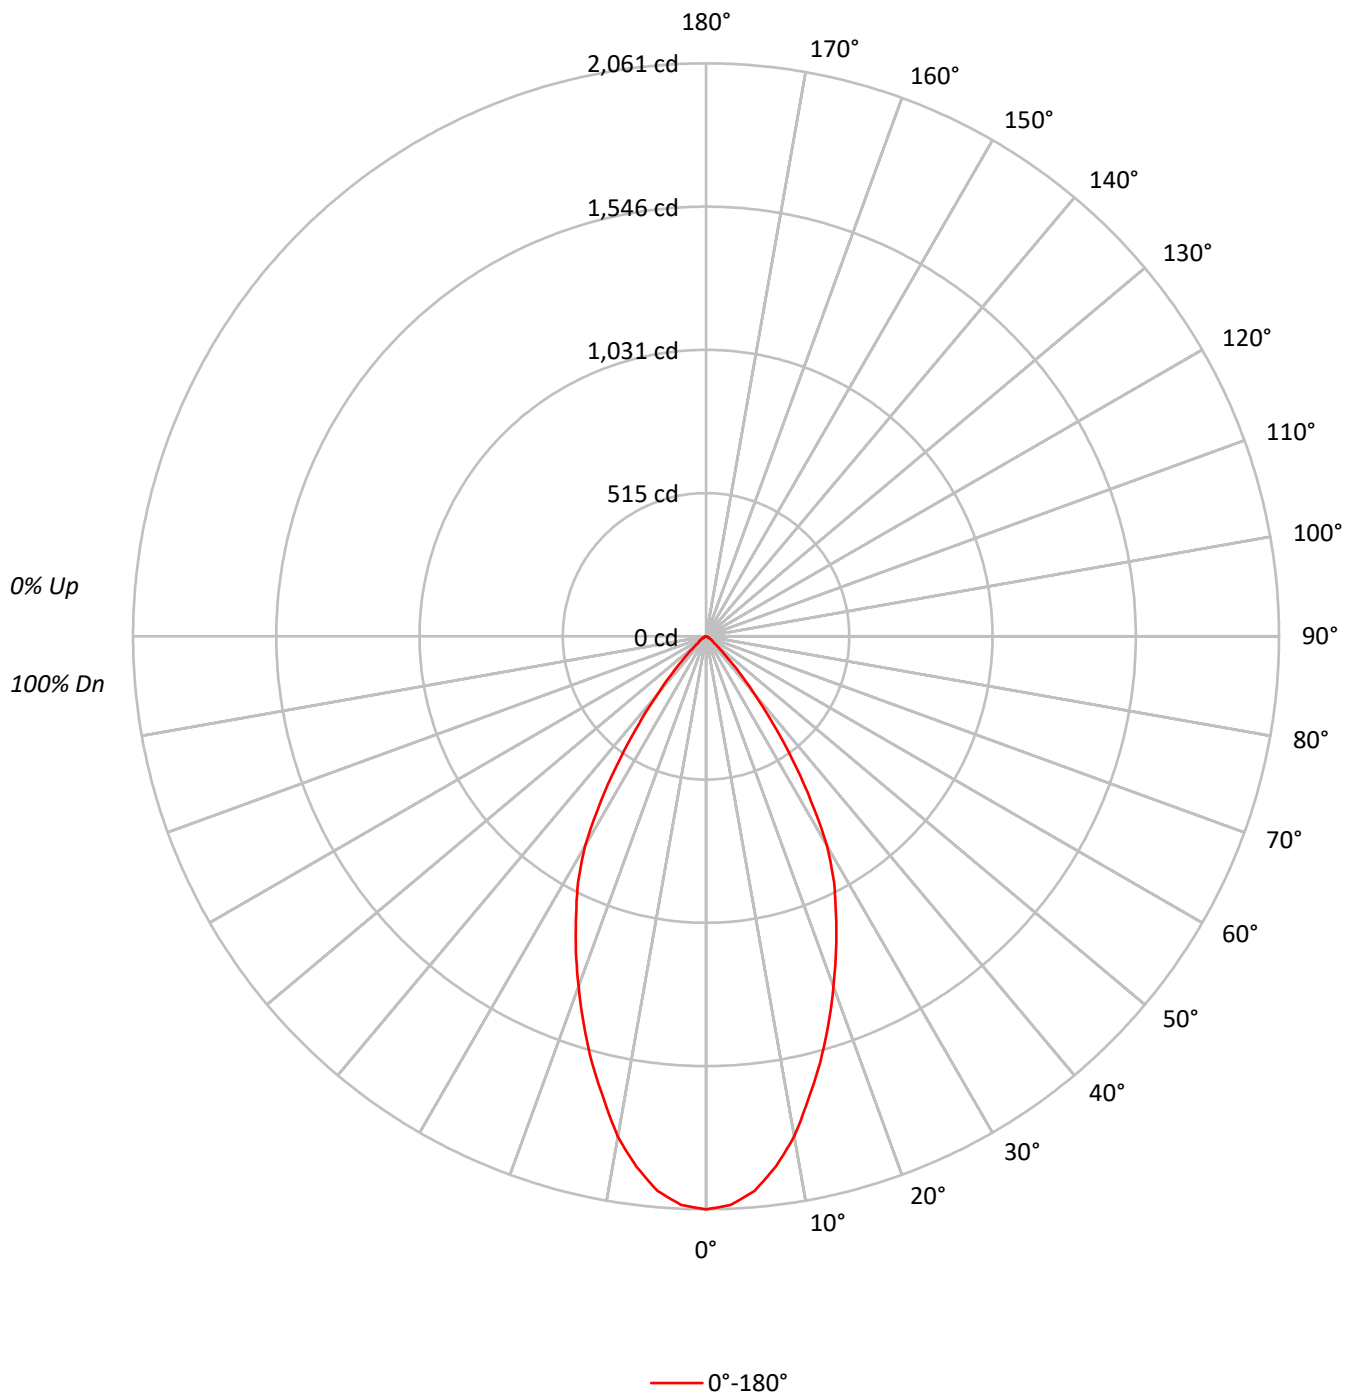



TEST NUMBER: P698174

CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75		
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70		
6	88	79	73	69	86	78	72	68	77	72	68	75	71	67	74	70	67	65		
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61		
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58		
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	55	54		
10	72	62	57	53	71	62	57	53	61	56	53	60	56	52	60	55	52	51		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	113001
5°	110202
10°	101685
15°	90029
20°	78168
25°	66863
30°	55122
35°	36299
40°	19515
45°	8637
50°	3505
55°	2523
60°	1601
65°	1141
70°	946
75°	614
80°	916
85°	0



TEST NUMBER: P698174

CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	185.4	11.5
10°-20°	442.0	27.5
20°-30°	506.4	31.5
30°-40°	340.2	21.2
40°-50°	97.2	6.0
50°-60°	23.8	1.5
60°-70°	9.0	0.6
70°-80°	3.5	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1133.8	70.5
0°-40°	1474.1	91.7
0°-60°	1595.0	99.2
0°-90°	1607.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1607.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2061	
5°	2003	185
15°	1586	442
25°	1105	506
35°	542	340
45°	111	97
55°	26	24
65°	9	9
75°	3	3
85°	0	0
90°	0	



TEST NUMBER: P698174

CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-N-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	2061.3
2.5°	2046.7
5°	2002.6
7.5°	1923.4
10°	1826.7
12.5°	1703.5
15°	1586.3
17.5°	1463.2
20°	1339.9
22.5°	1222.7
25°	1105.4
27.5°	996.9
30°	870.8
32.5°	703.7
35°	542.4
37.5°	395.8
40°	272.7
42.5°	178.8
45°	111.4
47.5°	67.4
50°	41.1
52.5°	32.2
55°	26.4
57.5°	20.5
60°	14.6
62.5°	11.7
65°	8.8
67.5°	5.9
70°	5.9
72.5°	2.9
75°	2.9
77.5°	2.9
80°	2.9
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)