

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698204

Luminaire Tested: **MRI-FEU6C-25-L930 F6X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698204
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-25-L930 F6X-W-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2585.0 lumens
Efficiency: N/A
Efficacy: 82.1 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698204
CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-W-X-LI

Luminous Intensity Polar Plot

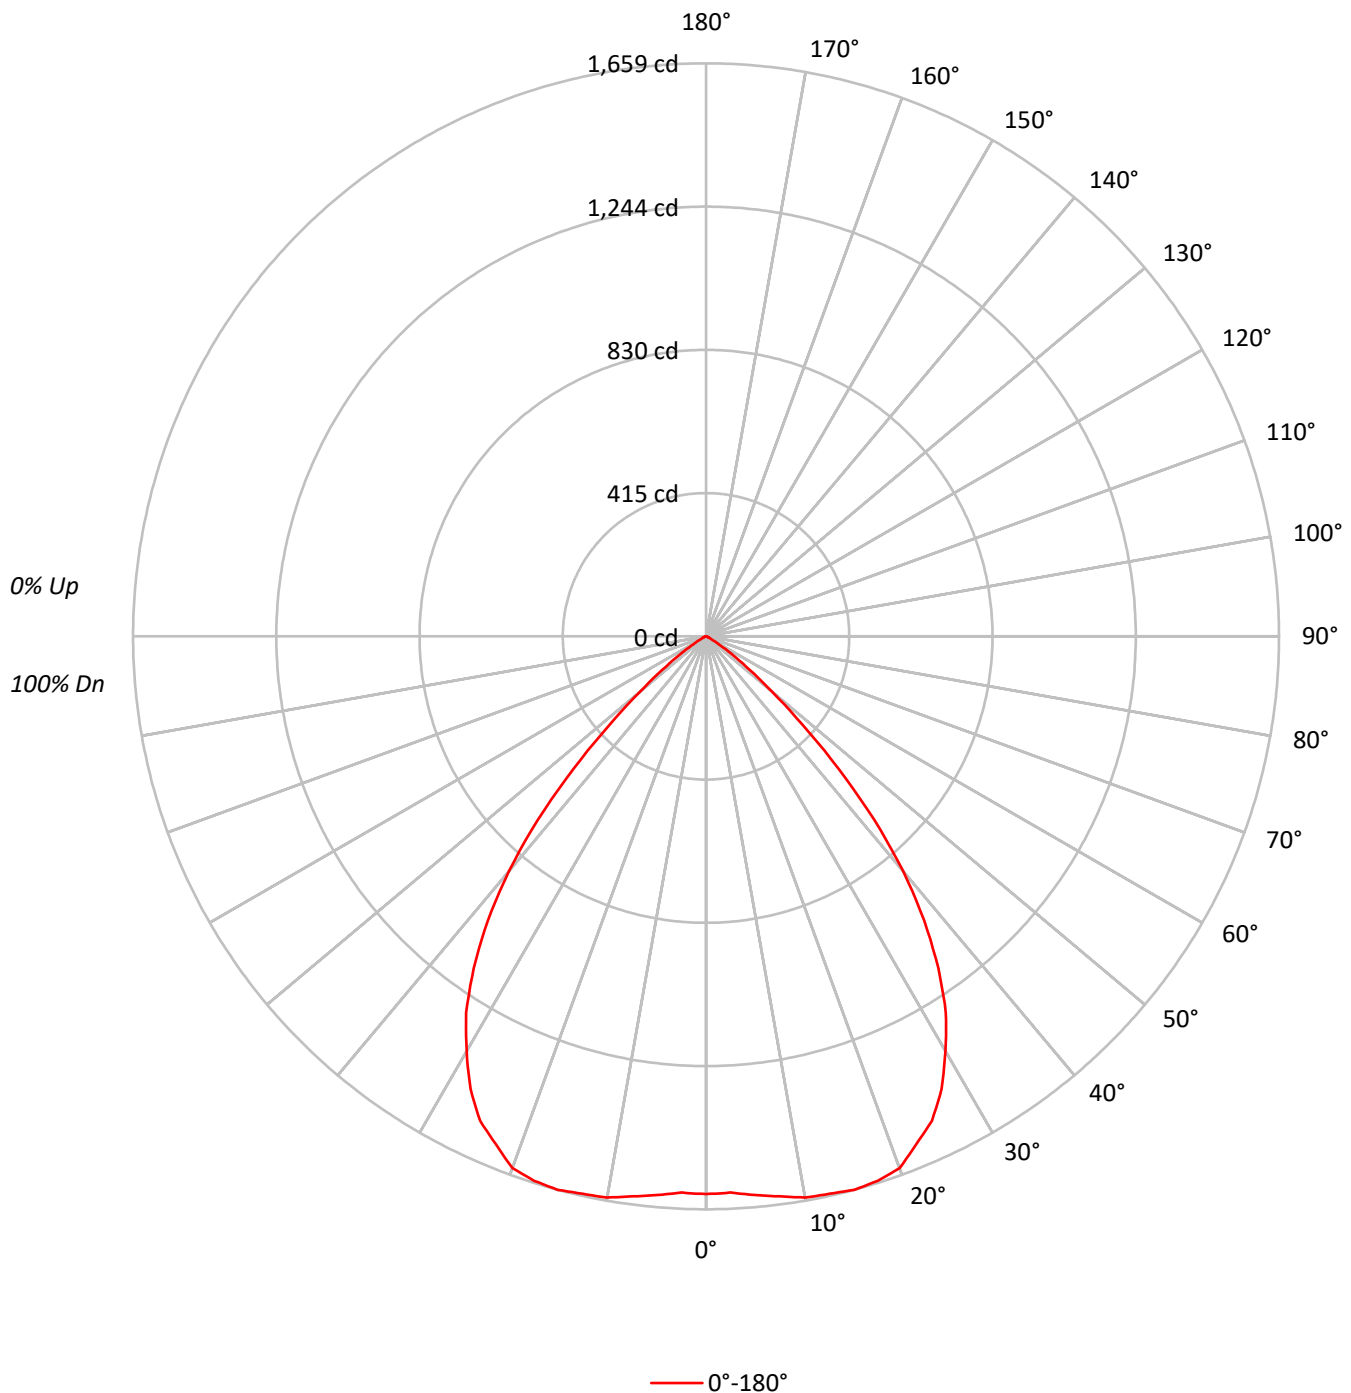



TEST NUMBER: P698204

CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	104	110	107	105	103	103	101	99		100	98	97		96
2	106	101	96	92	104	99	95	91	95	92	89		92	90	87		90
3	100	92	87	82	97	91	86	81	88	84	80		86	82	79		83
4	93	85	78	73	92	84	78	73	81	76	72		79	75	71		77
5	88	78	71	66	86	77	71	66	75	70	65		73	69	65		72
6	82	72	65	60	81	71	65	60	70	64	59		68	63	59		67
7	77	67	60	55	76	66	59	55	65	59	54		63	58	54		62
8	73	62	55	50	71	61	55	50	60	54	50		59	54	50		58
9	69	57	51	46	67	57	50	46	56	50	46		55	50	46		54
10	65	54	47	43	64	53	47	42	52	46	42		51	46	42		51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	88529
5°	89352
10°	91849
15°	94149
20°	95576
25°	93604
30°	87754
35°	78461
40°	63548
45°	42035
50°	21245
55°	8965
60°	2884
65°	1129
70°	946
75°	635
80°	0
85°	0



TEST NUMBER: P698204
 CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	155.8	6.0
10°-20°	468.3	18.1
20°-30°	705.9	27.3
30°-40°	722.5	27.9
40°-50°	420.9	16.3
50°-60°	96.7	3.7
60°-70°	11.8	0.5
70°-80°	3.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1329.9	51.4
0°-40°	2052.4	79.4
0°-60°	2570.0	99.4
0°-90°	2585.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2585.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1615	
5°	1624	156
15°	1659	468
25°	1548	706
35°	1172	722
45°	542	421
55°	94	97
65°	9	12
75°	3	3
85°	0	0
90°	0	



TEST NUMBER: P698204
CATALOG NUMBER: MRI-FEU6C-25-L930 F6X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1614.9
2.5°	1612.0
5°	1623.7
7.5°	1635.4
10°	1650.0
12.5°	1653.0
15°	1658.9
17.5°	1653.0
20°	1638.3
22.5°	1591.4
25°	1547.5
27.5°	1477.2
30°	1386.3
32.5°	1292.5
35°	1172.4
37.5°	1037.5
40°	888.0
42.5°	721.0
45°	542.2
47.5°	378.0
50°	249.1
52.5°	158.3
55°	93.8
57.5°	49.9
60°	26.3
62.5°	14.6
65°	8.7
67.5°	8.7
70°	5.9
72.5°	3.0
75°	3.0
77.5°	3.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)