

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698254

Luminaire Tested: **MRI-FEU6C-25-L935 F6X-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698254
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-25-L935 F6X-W-X-H
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2294.1 lumens
Efficiency: N/A
Efficacy: 72.8 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698254
CATALOG NUMBER: MRI-FEU6C-25-L935 F6X-W-X-H

Luminous Intensity Polar Plot

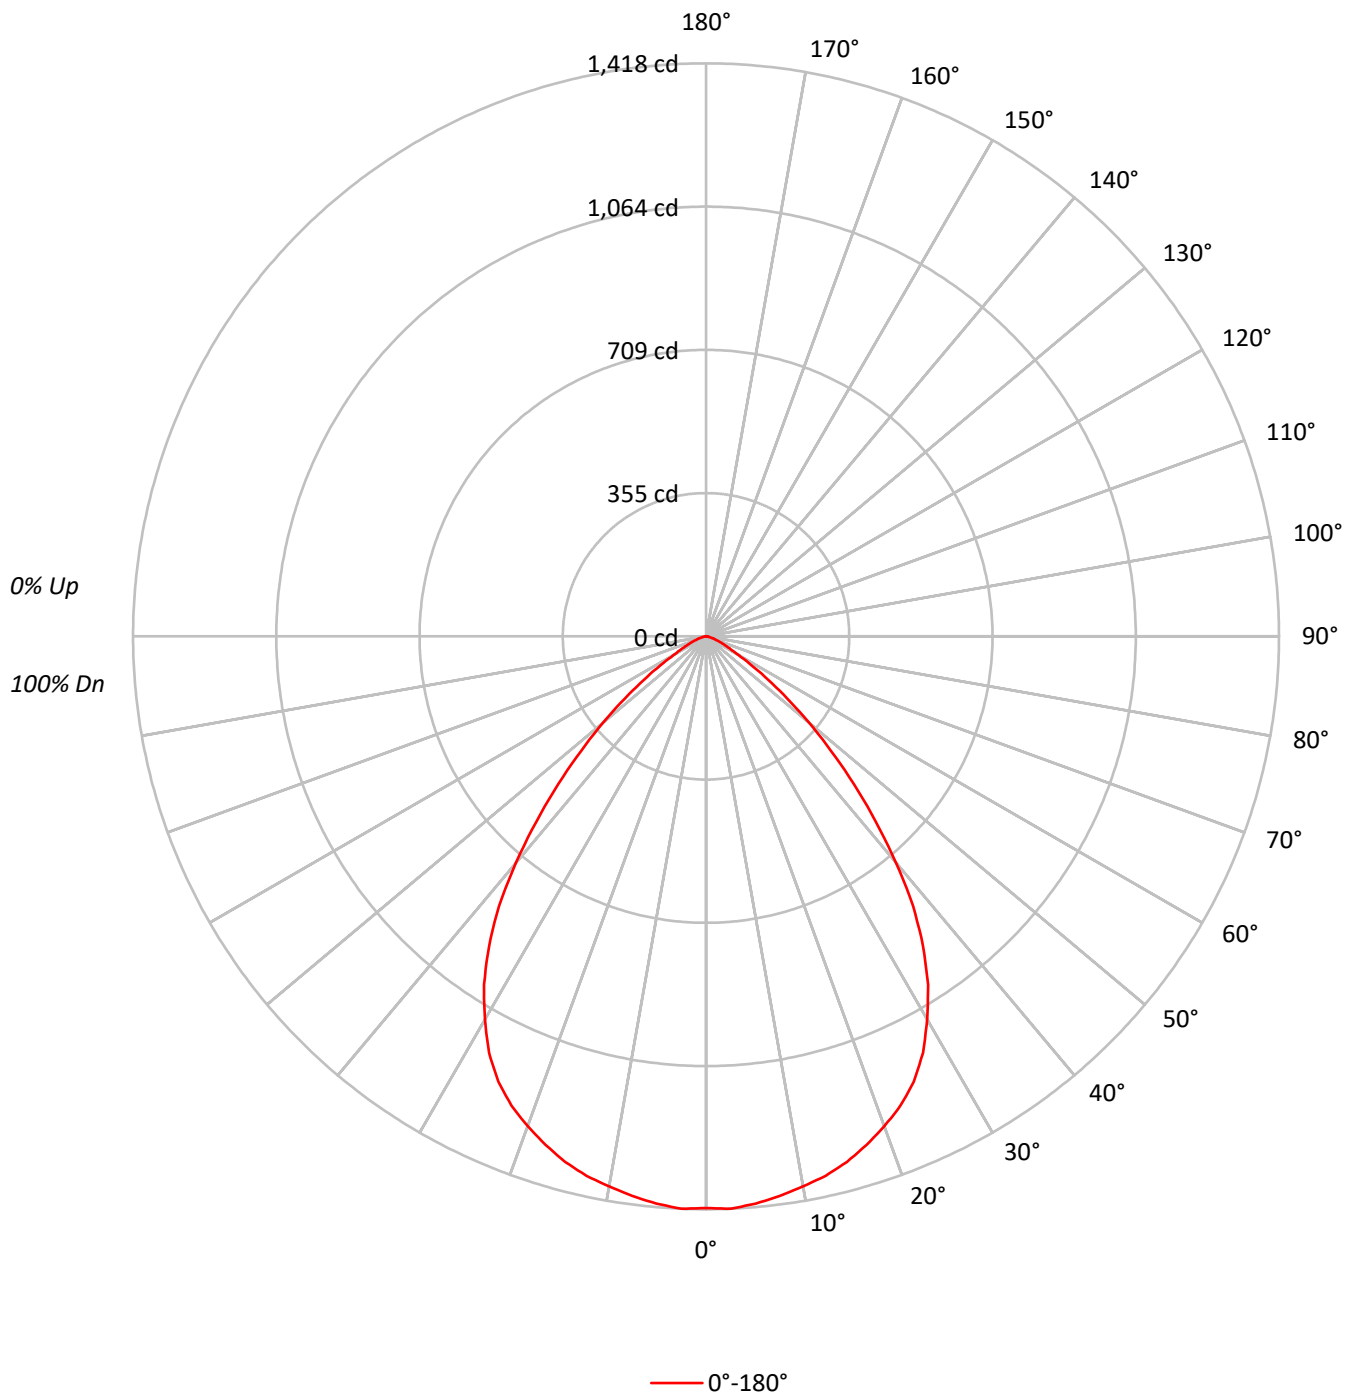



TEST NUMBER: P698254

CATALOG NUMBER: MRI-FEU6C-25-L935 F6X-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	112	109	106	103	110	107	104	101	103	100	98		99	97	95		95
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		88
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		81
4	92	82	75	70	90	81	75	70	79	73	69		77	72	68		75
5	86	75	68	63	84	74	68	63	72	66	62		71	65	61		69
6	80	69	62	57	78	68	61	56	67	61	56		65	60	56		64
7	75	64	56	51	73	63	56	51	62	55	51		60	55	51		59
8	70	59	52	47	69	58	51	47	57	51	46		56	50	46		55
9	66	55	48	43	65	54	47	43	53	47	43		52	47	42		51
10	62	51	44	40	61	50	44	39	50	43	39		49	43	39		48

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	77565
5°	77537
10°	76941
15°	76425
20°	75257
25°	73541
30°	69245
35°	62667
40°	52327
45°	40097
50°	28400
55°	17901
60°	10098
65°	6551
70°	4280
75°	3156
80°	1894
85°	1887



TEST NUMBER: P698254
 CATALOG NUMBER: MRI-FEU6C-25-L935 F6X-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.6	5.8
10°-20°	379.2	16.5
20°-30°	556.0	24.2
30°-40°	578.7	25.2
40°-50°	400.3	17.5
50°-60°	174.3	7.6
60°-70°	53.4	2.3
70°-80°	16.0	0.7
80°-90°	2.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1068.8	46.6
0°-40°	1647.5	71.8
0°-60°	2222.1	96.9
0°-90°	2294.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2294.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1415	
5°	1409	134
15°	1347	379
25°	1216	556
35°	936	579
45°	517	400
55°	187	174
65°	50	53
75°	15	16
85°	3	2
90°	0	



TEST NUMBER: P698254
CATALOG NUMBER: MRI-FEU6C-25-L935 F6X-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1414.9
2.5°	1417.8
5°	1409.0
7.5°	1397.1
10°	1382.2
12.5°	1367.3
15°	1346.6
17.5°	1319.8
20°	1290.0
22.5°	1257.4
25°	1215.8
27.5°	1162.3
30°	1093.9
32.5°	1022.5
35°	936.4
37.5°	841.3
40°	731.2
42.5°	621.2
45°	517.2
47.5°	419.1
50°	333.0
52.5°	252.7
55°	187.3
57.5°	133.8
60°	92.1
62.5°	68.4
65°	50.5
67.5°	38.7
70°	26.7
72.5°	20.8
75°	14.9
77.5°	8.9
80°	6.0
82.5°	3.0
85°	3.0
87.5°	0.0
90°	0.0

(END OF REPORT)