

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698364

Luminaire Tested: **MRI-FEU6C-25-L950 F6X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698364
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-25-L950 F6X-N-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 6LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2108.1 lumens
Efficiency: N/A
Efficacy: 66.9 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698364
CATALOG NUMBER: MRI-FEU6C-25-L950 F6X-N-X-LI

Luminous Intensity Polar Plot

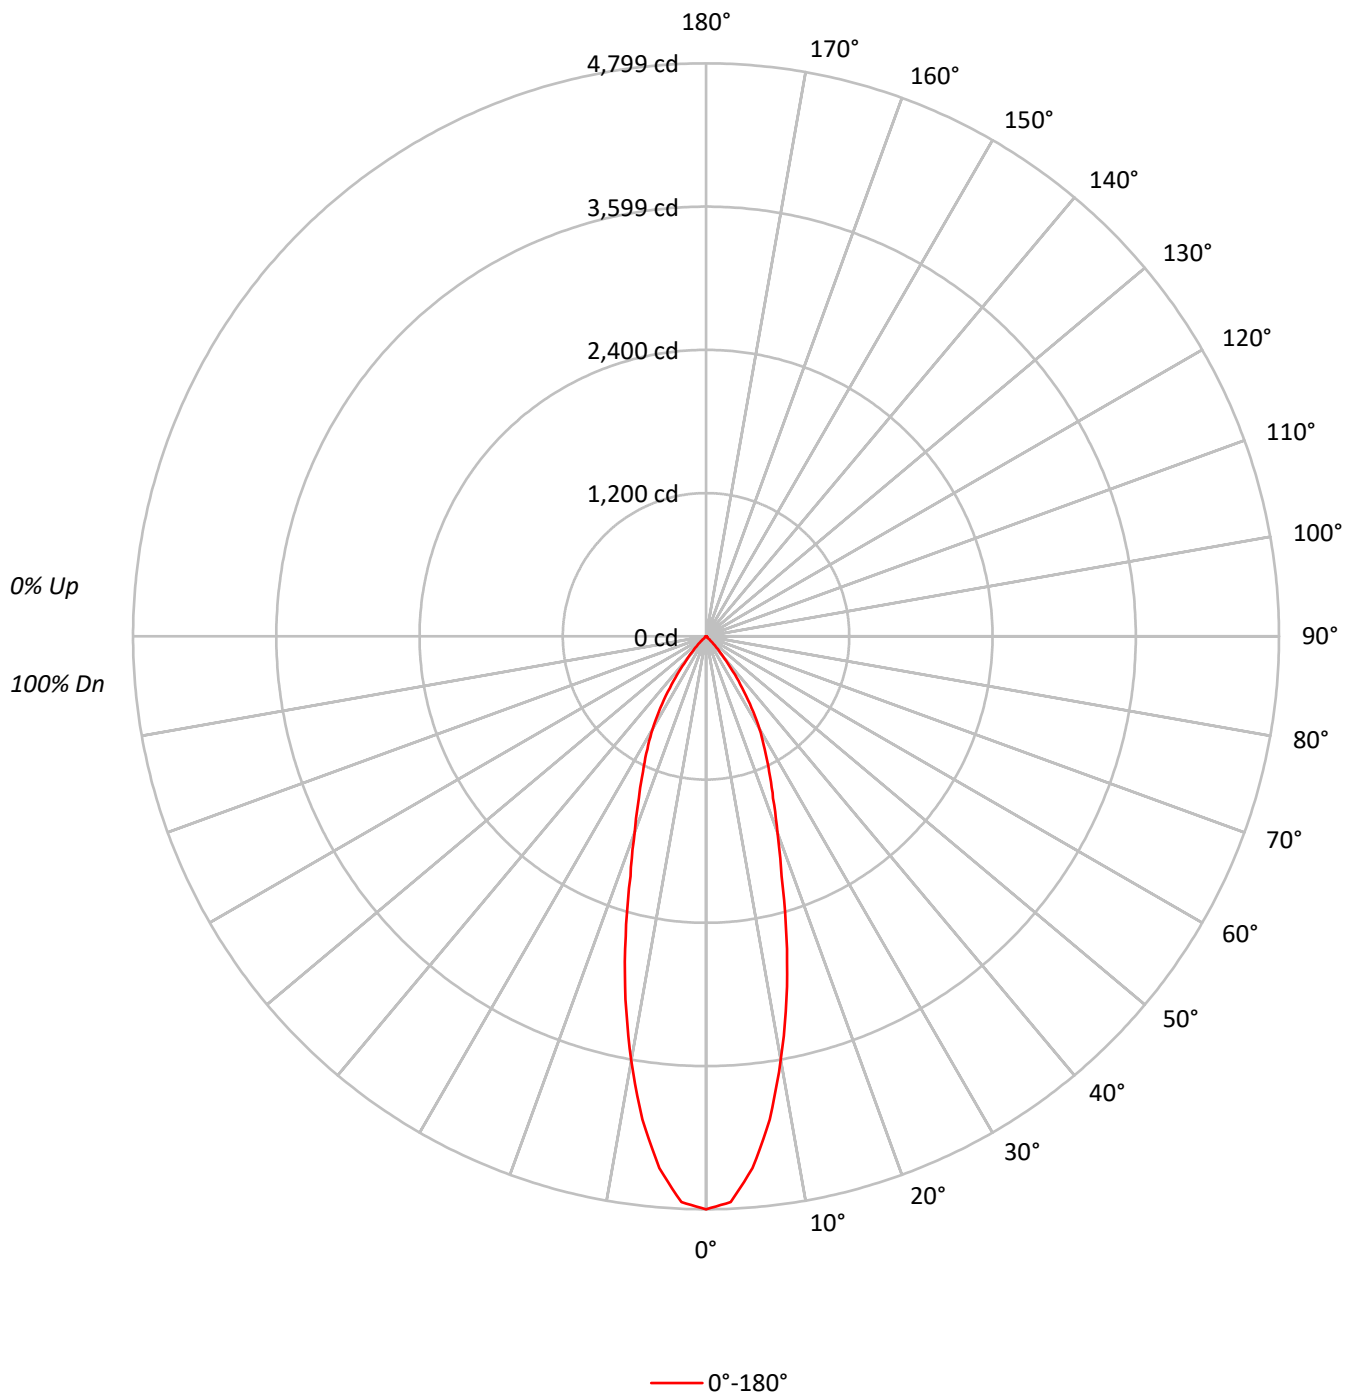



TEST NUMBER: P698364

CATALOG NUMBER: MRI-FEU6C-25-L950 F6X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		0			
RCR																						
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102	100
1	114	112	109	107		112	109	107	106		105	104	102		102	101	99		98	97	96	95
2	109	105	101	98		107	103	100	97		100	97	95		97	95	93		94	93	91	89
3	105	99	94	91		103	97	93	90		95	91	89		93	90	87		90	88	86	85
4	100	93	88	85		98	92	88	84		90	86	83		88	85	82		86	84	81	80
5	96	88	83	79		94	87	83	79		86	82	78		84	81	78		83	80	77	76
6	92	84	79	75		90	83	78	75		82	77	74		80	76	74		79	76	73	72
7	88	80	74	71		87	79	74	71		78	73	70		77	73	70		76	72	69	68
8	84	76	71	67		83	75	70	67		74	70	67		73	69	66		73	69	66	65
9	81	73	67	64		80	72	67	64		71	67	63		70	66	63		70	66	63	62
10	78	69	64	61		77	69	64	61		68	64	61		67	63	60		67	63	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	263104
5°	246048
10°	200670
15°	147668
20°	101783
25°	75561
30°	56756
35°	35396
40°	17182
45°	5892
50°	776
55°	583
60°	340
65°	402
70°	497
75°	0
80°	0
85°	0



TEST NUMBER: P698364
 CATALOG NUMBER: MRI-FEU6C-25-L950 F6X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	399.0	18.9
10°-20°	716.2	34.0
20°-30°	579.1	27.5
30°-40°	333.6	15.8
40°-50°	70.5	3.3
50°-60°	6.1	0.3
60°-70°	3.1	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1694.4	80.4
0°-40°	2028.0	96.2
0°-60°	2104.6	99.8
0°-90°	2108.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2108.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4799	
5°	4471	399
15°	2602	716
25°	1249	579
35°	529	334
45°	76	71
55°	6	6
65°	3	3
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P698364

CATALOG NUMBER: MRI-FEU6C-25-L950 F6X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4799.4
2.5°	4741.7
5°	4471.2
7.5°	4082.1
10°	3604.9
12.5°	3115.6
15°	2601.9
17.5°	2106.4
20°	1744.7
22.5°	1468.1
25°	1249.2
27.5°	1063.9
30°	896.6
32.5°	711.3
35°	528.9
37.5°	367.8
40°	240.1
42.5°	145.9
45°	76.0
47.5°	30.4
50°	9.1
52.5°	9.1
55°	6.1
57.5°	6.1
60°	3.1
62.5°	3.1
65°	3.1
67.5°	3.1
70°	3.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)