

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698504

Luminaire Tested: **MRI-FEU6C-30-L930 F6X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698504
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-30-L930 F6X-W-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3034.0 lumens
Efficiency: N/A
Efficacy: 96.0 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698504
CATALOG NUMBER: MRI-FEU6C-30-L930 F6X-W-X-LI

Luminous Intensity Polar Plot

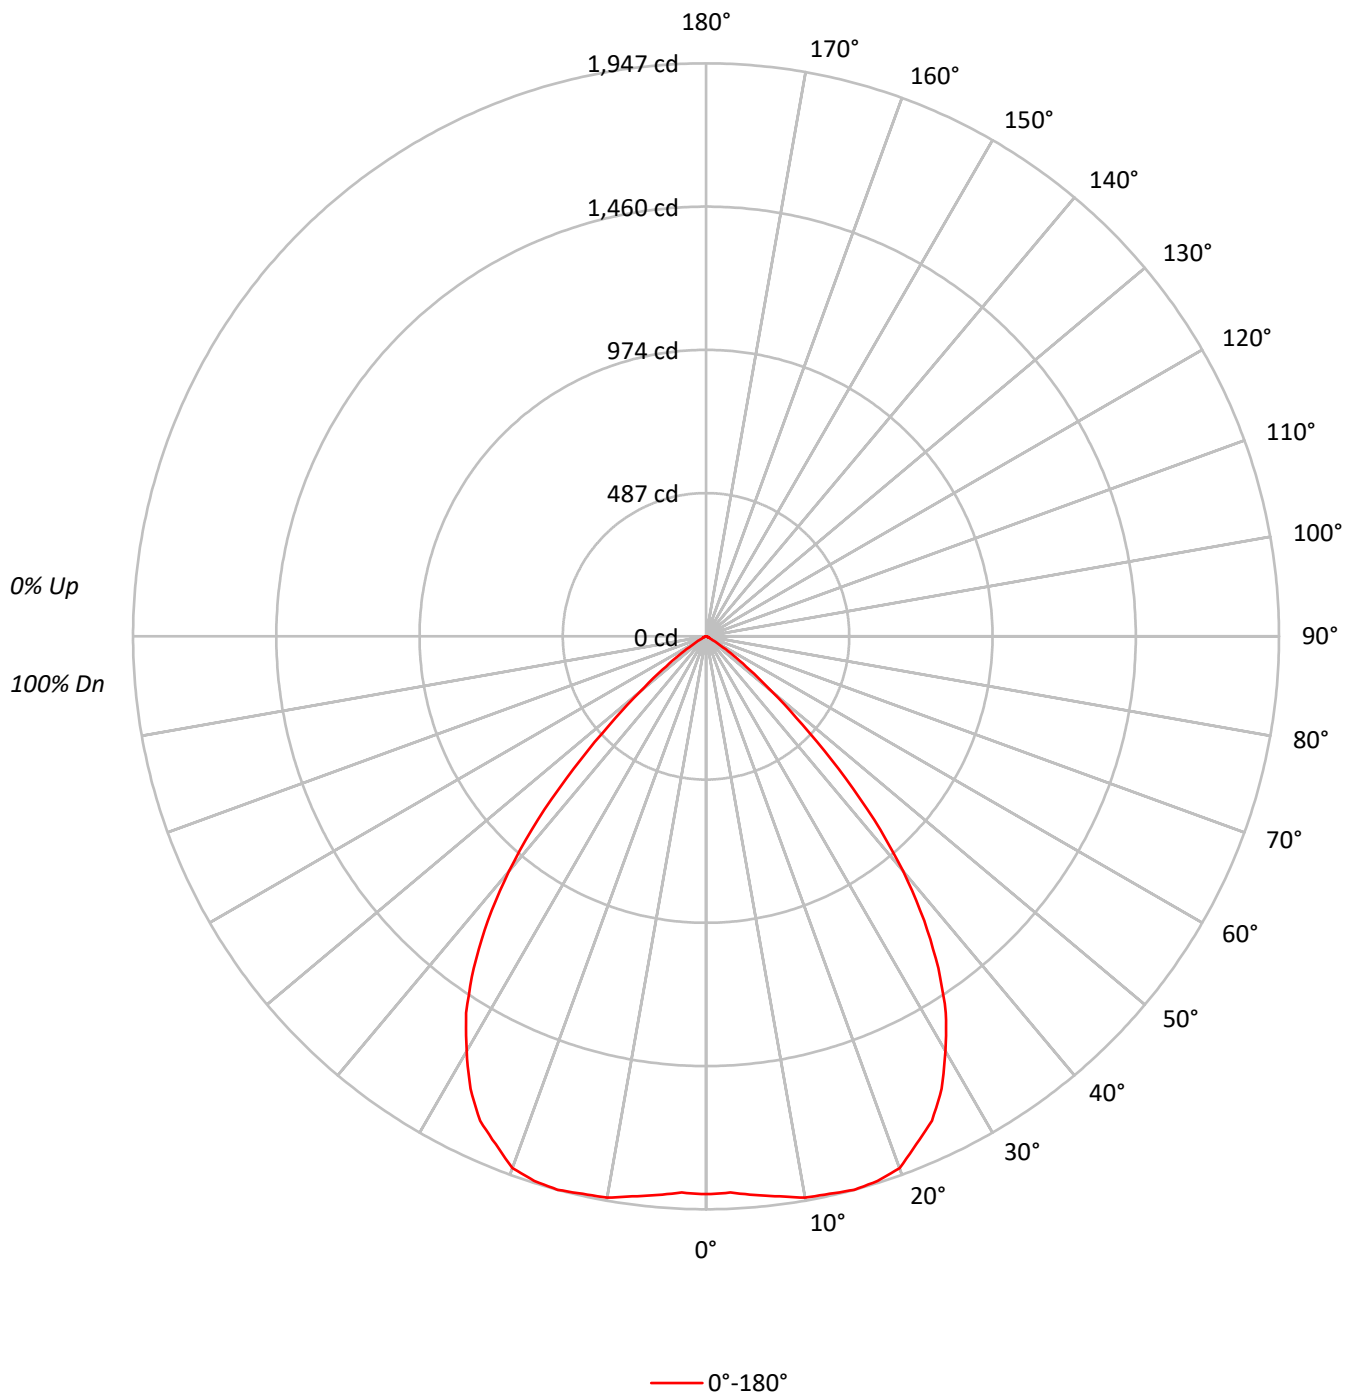



TEST NUMBER: P698504

CATALOG NUMBER: MRI-FEU6C-30-L930 F6X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	104	110	107	105	103	103	101	99		100	98	97		96
2	106	101	96	92	104	99	95	91	95	92	89		92	90	87		90
3	100	92	87	82	97	91	86	81	88	84	80		86	82	79		83
4	93	85	78	73	92	84	78	73	81	76	72		79	75	71		77
5	88	78	71	66	86	77	71	66	75	70	65		73	69	65		72
6	82	72	65	60	81	71	65	60	70	64	59		68	63	59		67
7	77	67	60	55	76	66	59	55	65	59	54		63	58	54		62
8	73	62	55	50	71	61	55	50	60	54	50		59	54	50		58
9	69	57	51	46	67	57	50	46	56	50	46		55	50	46		54
10	65	54	47	43	64	53	47	42	52	46	42		51	46	42		51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	103906
5°	104870
10°	107803
15°	110500
20°	112179
25°	109863
30°	102997
35°	92086
40°	74590
45°	49338
50°	24937
55°	10523
60°	3388
65°	1336
70°	1106
75°	741
80°	0
85°	0



TEST NUMBER: P698504
 CATALOG NUMBER: MRI-FEU6C-30-L930 F6X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.8	6.0
10°-20°	549.6	18.1
20°-30°	828.5	27.3
30°-40°	848.0	27.9
40°-50°	494.0	16.3
50°-60°	113.5	3.7
60°-70°	13.9	0.5
70°-80°	3.7	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1560.9	51.4
0°-40°	2408.9	79.4
0°-60°	3016.4	99.4
0°-90°	3034.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3034.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1895	
5°	1906	183
15°	1947	550
25°	1816	828
35°	1376	848
45°	636	494
55°	110	114
65°	10	14
75°	4	4
85°	0	0
90°	0	



TEST NUMBER: P698504
CATALOG NUMBER: MRI-FEU6C-30-L930 F6X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1895.4
2.5°	1892.0
5°	1905.7
7.5°	1919.4
10°	1936.6
12.5°	1940.1
15°	1947.0
17.5°	1940.1
20°	1922.9
22.5°	1867.8
25°	1816.3
27.5°	1733.7
30°	1627.1
32.5°	1517.0
35°	1376.0
37.5°	1217.7
40°	1042.3
42.5°	846.2
45°	636.4
47.5°	443.7
50°	292.4
52.5°	185.8
55°	110.1
57.5°	58.5
60°	30.9
62.5°	17.2
65°	10.3
67.5°	10.3
70°	6.9
72.5°	3.5
75°	3.5
77.5°	3.5
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)