

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698744

Luminaire Tested: **MRI-FEU6C-35-L927 F6X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698744
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-35-L927 F6X-W-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3445.0 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698744
CATALOG NUMBER: MRI-FEU6C-35-L927 F6X-W-X-LI

Luminous Intensity Polar Plot

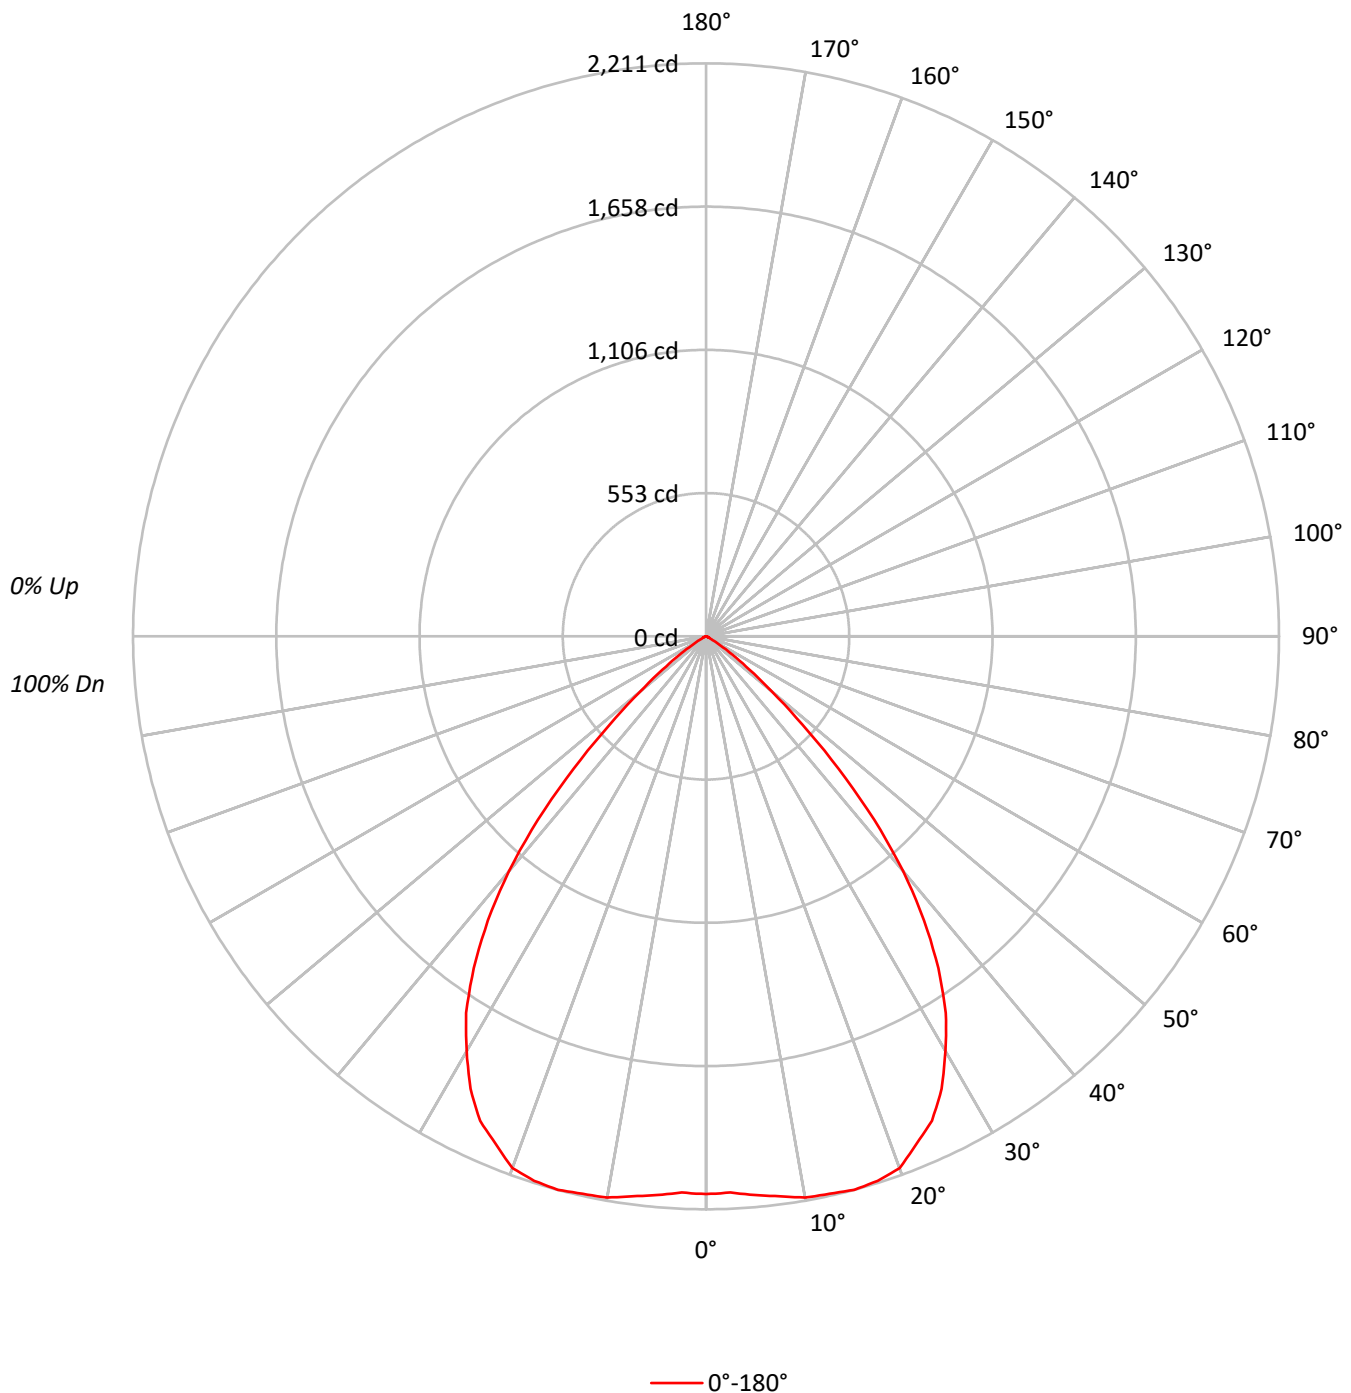



TEST NUMBER: P698744

CATALOG NUMBER: MRI-FEU6C-35-L927 F6X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	104	110	107	105	103	103	101	99		100	98	97		96
2	106	101	96	92	104	99	95	91	95	92	89		92	90	87		90
3	100	92	87	82	97	91	86	81	88	84	80		86	82	79		83
4	93	85	78	73	92	84	78	73	81	76	72		79	75	71		77
5	88	78	71	66	86	77	71	66	75	70	65		73	69	65		72
6	82	72	65	60	81	71	65	60	70	64	59		68	63	59		67
7	77	67	60	55	76	66	59	55	65	59	54		63	58	54		62
8	73	62	55	50	71	61	55	50	60	54	50		59	54	50		58
9	69	57	51	46	67	57	50	46	56	50	46		55	50	46		54
10	65	54	47	43	64	53	47	42	52	46	42		51	46	42		51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	117984
5°	119073
10°	122409
15°	125472
20°	127376
25°	124743
30°	116948
35°	104561
40°	84694
45°	56021
50°	28315
55°	11947
60°	3848
65°	1518
70°	1266
75°	826
80°	0
85°	0



TEST NUMBER: P698744
 CATALOG NUMBER: MRI-FEU6C-35-L927 F6X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.6	6.0
10°-20°	624.0	18.1
20°-30°	940.7	27.3
30°-40°	962.8	27.9
40°-50°	560.9	16.3
50°-60°	128.9	3.7
60°-70°	15.8	0.5
70°-80°	4.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1772.4	51.4
0°-40°	2735.2	79.4
0°-60°	3425.0	99.4
0°-90°	3445.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3445.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2152	
5°	2164	208
15°	2211	624
25°	2062	941
35°	1562	963
45°	723	561
55°	125	129
65°	12	16
75°	4	4
85°	0	0
90°	0	

TEST NUMBER: P698744

CATALOG NUMBER: MRI-FEU6C-35-L927 F6X-W-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2152.2
2.5°	2148.2
5°	2163.8
7.5°	2179.4
10°	2199.0
12.5°	2202.9
15°	2210.8
17.5°	2202.9
20°	2183.4
22.5°	2120.9
25°	2062.3
27.5°	1968.6
30°	1847.5
32.5°	1722.5
35°	1562.4
37.5°	1382.6
40°	1183.5
42.5°	960.8
45°	722.6
47.5°	503.8
50°	332.0
52.5°	211.0
55°	125.0
57.5°	66.4
60°	35.1
62.5°	19.5
65°	11.7
67.5°	11.7
70°	7.9
72.5°	3.9
75°	3.9
77.5°	3.9
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)