

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698804

Luminaire Tested: **MRI-FEU6C-35-L930 F6X-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698804
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-35-L930 F6X-W-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3581.0 lumens
Efficiency: N/A
Efficacy: 88.6 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698804
CATALOG NUMBER: MRI-FEU6C-35-L930 F6X-W-X-LI

Luminous Intensity Polar Plot

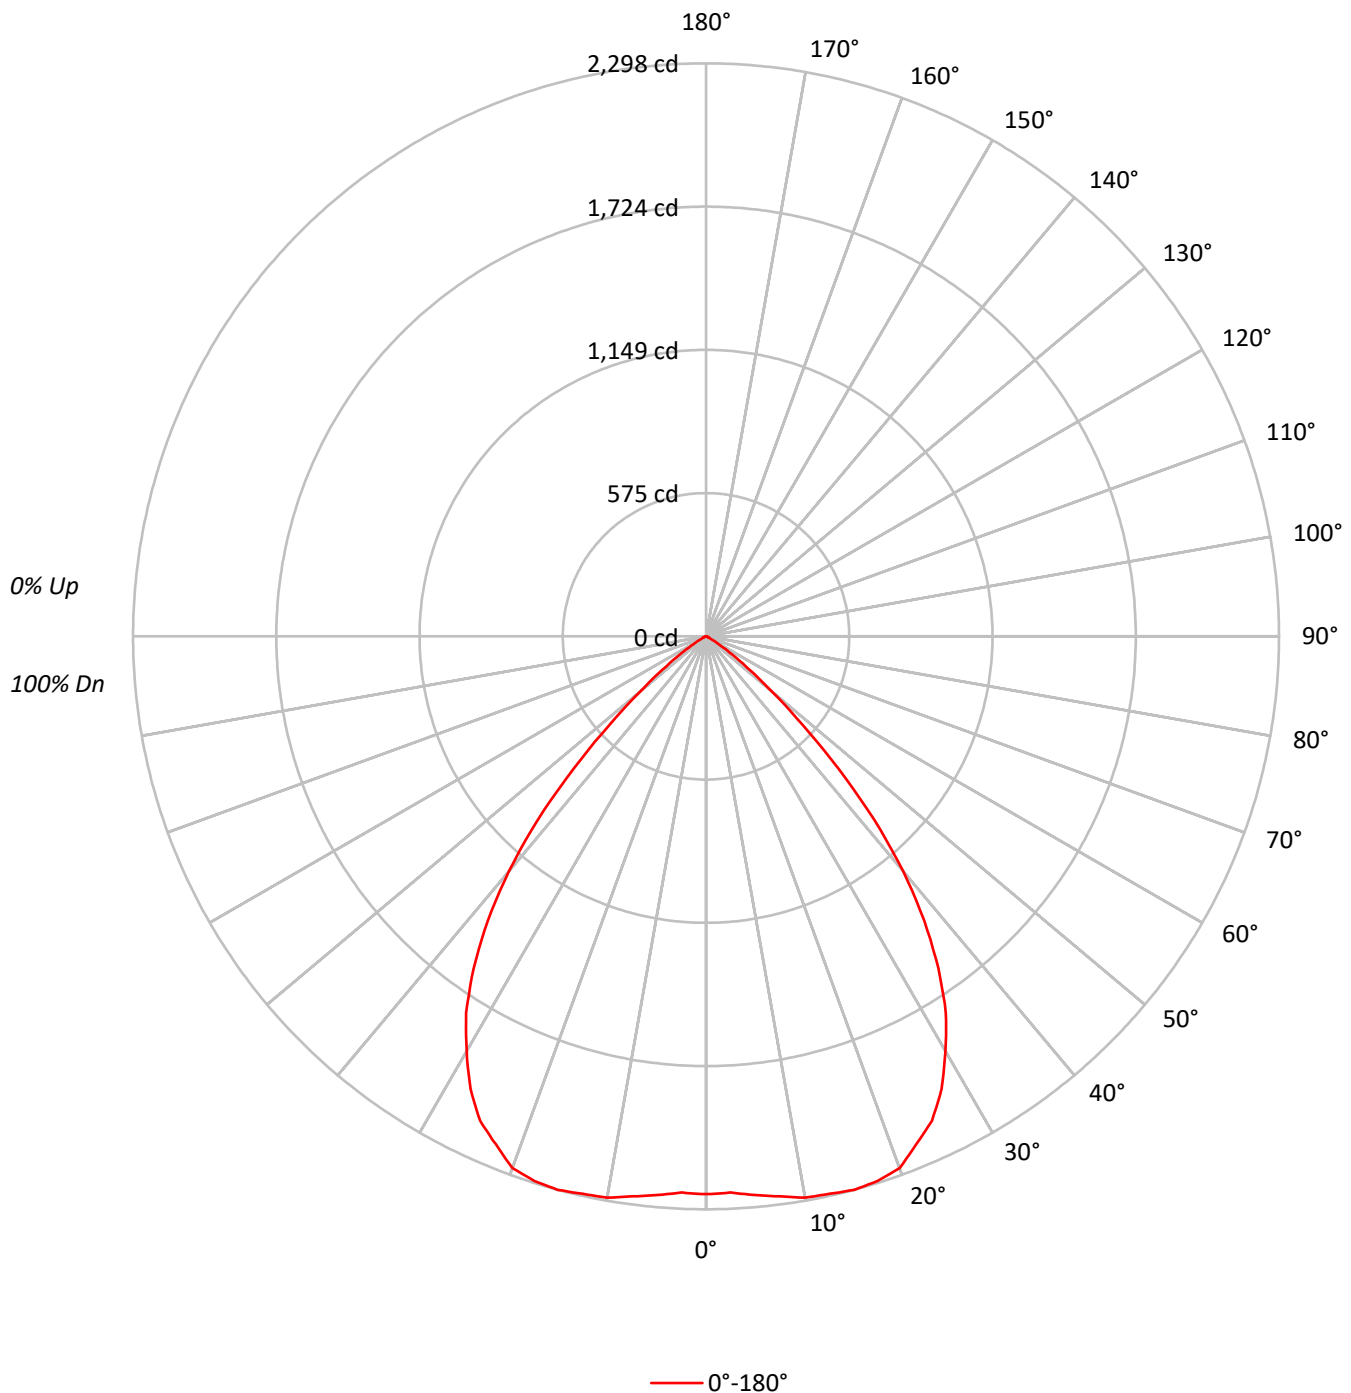



TEST NUMBER: P698804

CATALOG NUMBER: MRI-FEU6C-35-L930 F6X-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92		
2	106	101	96	92	104	99	95	91	95	92	89	92	90	87	90	87	85	83		
3	100	92	87	82	97	91	86	81	88	84	80	86	82	79	83	80	77	76		
4	93	85	78	73	92	84	78	73	81	76	72	79	75	71	77	74	70	69		
5	88	78	71	66	86	77	71	66	75	70	65	73	69	65	72	68	64	63		
6	82	72	65	60	81	71	65	60	70	64	59	68	63	59	67	62	59	57		
7	77	67	60	55	76	66	59	55	65	59	54	63	58	54	62	57	54	52		
8	73	62	55	50	71	61	55	50	60	54	50	59	54	50	58	53	49	48		
9	69	57	51	46	67	57	50	46	56	50	46	55	50	46	54	49	46	44		
10	65	54	47	43	64	53	47	42	52	46	42	51	46	42	51	46	42	41		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	122638
5°	123778
10°	127241
15°	130421
20°	132405
25°	129667
30°	121569
35°	108690
40°	88036
45°	58239
50°	29432
55°	12415
60°	4002
65°	1570
70°	1314
75°	868
80°	0
85°	0



TEST NUMBER: P698804
 CATALOG NUMBER: MRI-FEU6C-35-L930 F6X-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	215.8	6.0
10°-20°	648.7	18.1
20°-30°	977.8	27.3
30°-40°	1000.9	27.9
40°-50°	583.1	16.3
50°-60°	134.0	3.7
60°-70°	16.4	0.5
70°-80°	4.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1842.3	51.4
0°-40°	2843.2	79.4
0°-60°	3560.3	99.4
0°-90°	3581.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3581.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2237	
5°	2249	216
15°	2298	649
25°	2144	978
35°	1624	1001
45°	751	583
55°	130	134
65°	12	16
75°	4	4
85°	0	0
90°	0	



TEST NUMBER: P698804
CATALOG NUMBER: MRI-FEU6C-35-L930 F6X-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	2237.1
2.5°	2233.1
5°	2249.3
7.5°	2265.5
10°	2285.8
12.5°	2289.8
15°	2298.0
17.5°	2289.8
20°	2269.6
22.5°	2204.6
25°	2143.7
27.5°	2046.3
30°	1920.5
32.5°	1790.5
35°	1624.1
37.5°	1437.2
40°	1230.2
42.5°	998.8
45°	751.2
47.5°	523.7
50°	345.1
52.5°	219.3
55°	129.9
57.5°	69.1
60°	36.5
62.5°	20.3
65°	12.1
67.5°	12.1
70°	8.2
72.5°	4.1
75°	4.1
77.5°	4.1
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)