

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698824

Luminaire Tested: **MRI-FEU6C-35-L935 F6X-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698824
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-35-L935 F6X-M-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 6LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3214.9 lumens
Efficiency: N/A
Efficacy: 79.6 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698824
CATALOG NUMBER: MRI-FEU6C-35-L935 F6X-M-X-LI

Luminous Intensity Polar Plot

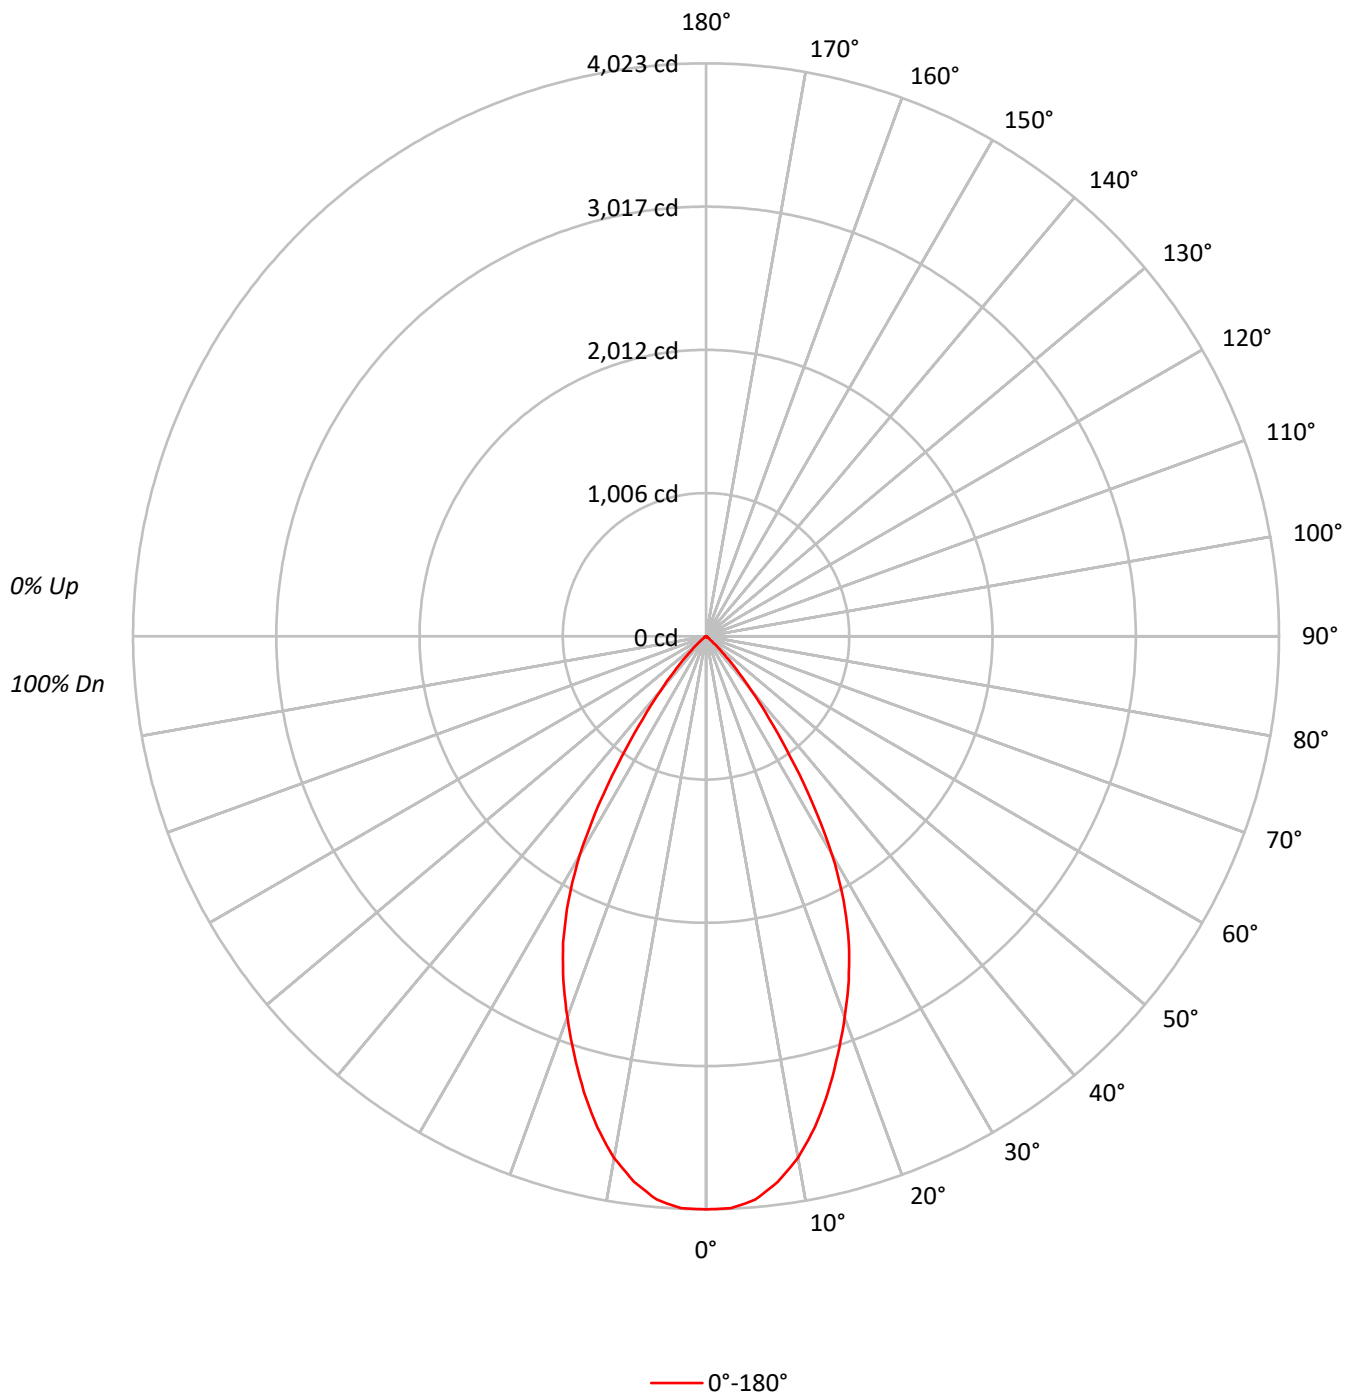



TEST NUMBER: P698824

CATALOG NUMBER: MRI-FEU6C-35-L935 F6X-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	109	106	111	109	107	105	105	103	101		101	100	98		98
2	108	103	100	96	106	102	98	95	99	96	93		96	93	91		93
3	103	97	92	88	101	95	91	87	93	89	86		90	87	85		88
4	98	91	85	81	96	89	84	81	87	83	80		85	82	79		83
5	93	85	79	75	91	84	79	75	82	78	74		81	77	73		79
6	89	80	74	70	87	79	74	70	78	73	69		76	72	69		75
7	84	75	69	65	83	75	69	65	73	68	65		72	68	64		71
8	80	71	65	61	79	70	65	61	69	64	61		68	64	60		67
9	77	67	61	57	75	67	61	57	66	61	57		65	60	57		64
10	73	64	58	54	72	63	58	54	62	57	54		62	57	54		61

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	220563
5°	218467
10°	207016
15°	187952
20°	166084
25°	143585
30°	112239
35°	68830
40°	35330
45°	14032
50°	4554
55°	1567
60°	1349
65°	1077
70°	657
75°	868
80°	0
85°	0



TEST NUMBER: P698824
 CATALOG NUMBER: MRI-FEU6C-35-L935 F6X-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	370.6	11.5
10°-20°	922.8	28.7
20°-30°	1072.7	33.4
30°-40°	656.9	20.4
40°-50°	163.1	5.1
50°-60°	19.0	0.6
60°-70°	7.1	0.2
70°-80°	2.7	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2366.1	73.6
0°-40°	3023.0	94.0
0°-60°	3205.1	99.7
0°-90°	3214.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3214.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4023	
5°	3970	371
15°	3312	923
25°	2374	1073
35°	1028	657
45°	181	163
55°	16	19
65°	8	7
75°	4	3
85°	0	0
90°	0	



TEST NUMBER: P698824
CATALOG NUMBER: MRI-FEU6C-35-L935 F6X-M-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4023.4
2.5°	4019.3
5°	3970.0
7.5°	3863.0
10°	3718.9
12.5°	3529.7
15°	3311.7
17.5°	3077.2
20°	2846.9
22.5°	2616.4
25°	2373.8
27.5°	2094.0
30°	1773.1
32.5°	1398.7
35°	1028.5
37.5°	724.0
40°	493.7
42.5°	308.5
45°	181.0
47.5°	102.9
50°	53.4
52.5°	24.7
55°	16.4
57.5°	12.3
60°	12.3
62.5°	8.3
65°	8.3
67.5°	4.1
70°	4.1
72.5°	4.1
75°	4.1
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)