

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P698904

Luminaire Tested: **MRI-FEU6C-35-L940 F6X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P698904
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-35-L940 F6X-N-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 4000K, 90 CRI LEDS, 6LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2862.0 lumens
Efficiency: N/A
Efficacy: 70.8 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P698904
CATALOG NUMBER: MRI-FEU6C-35-L940 F6X-N-X-LI

Luminous Intensity Polar Plot

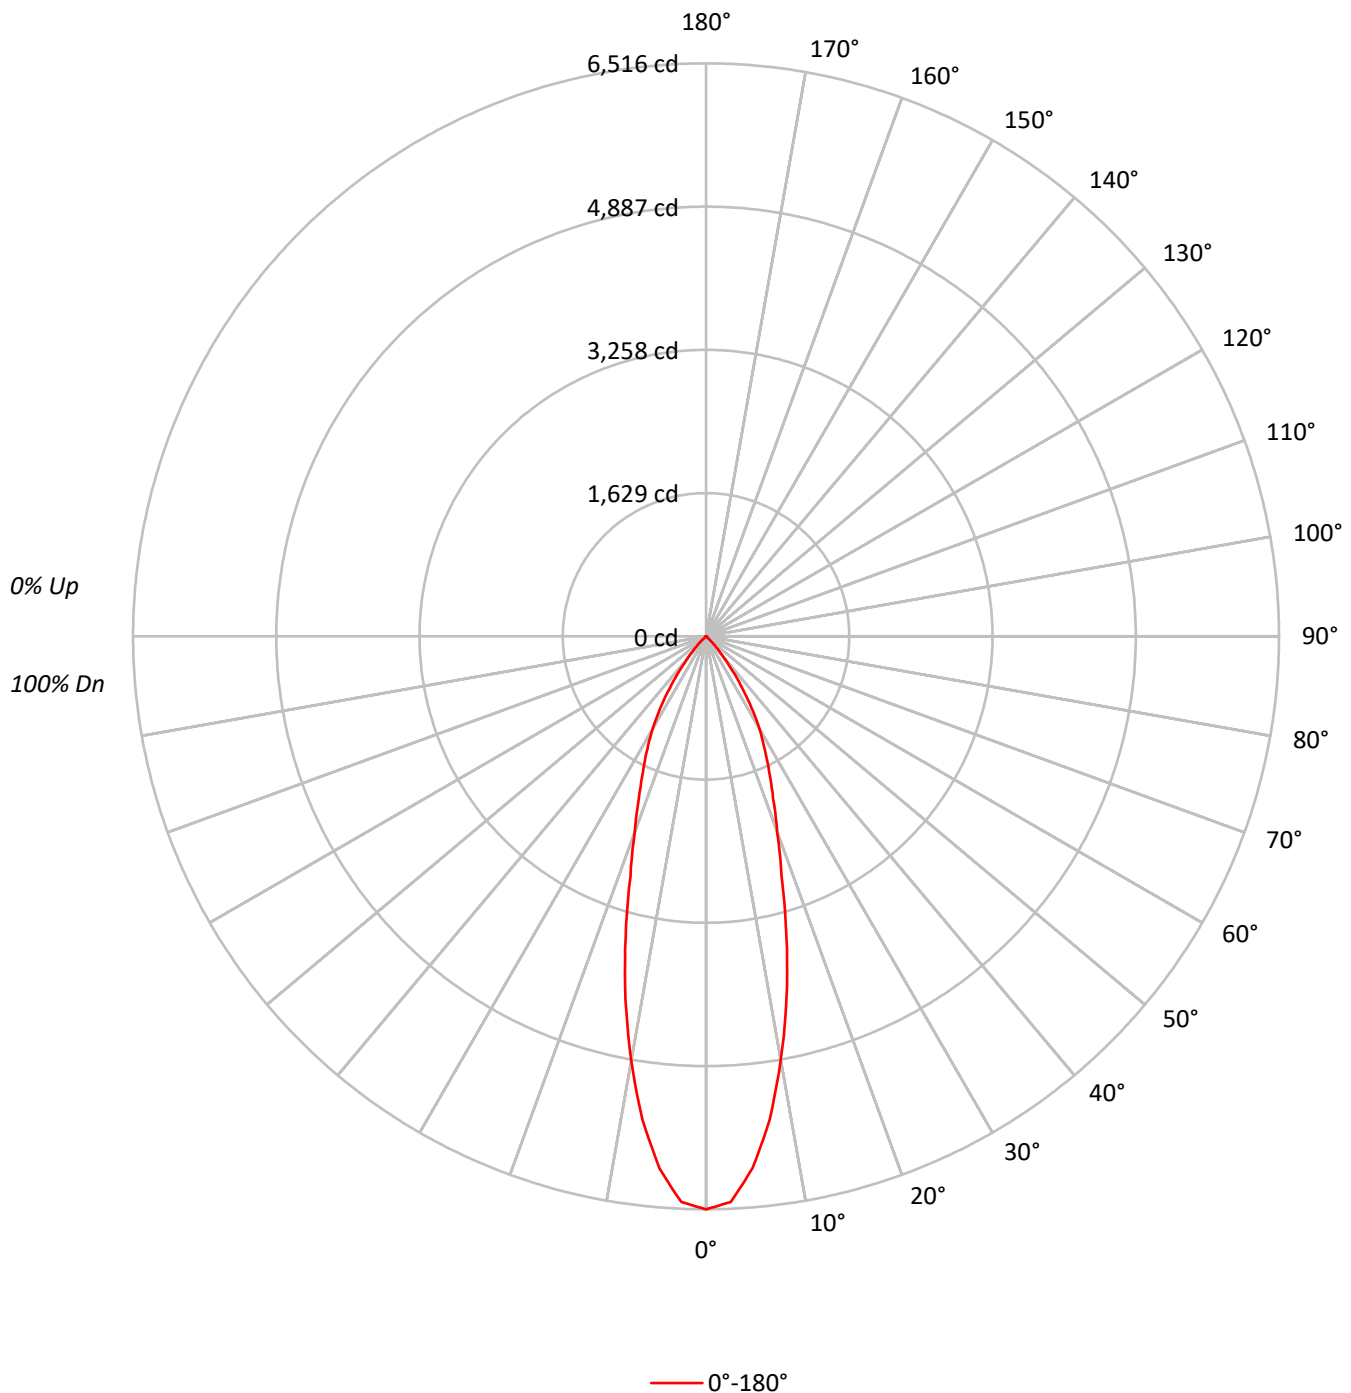



TEST NUMBER: P698904

CATALOG NUMBER: MRI-FEU6C-35-L940 F6X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	112	109	107	112	109	107	106	105	104	102		102	101	99		98
2	109	105	101	98	107	103	100	97	100	97	95		97	95	93		94
3	105	99	94	91	103	97	93	90	95	91	89		93	90	87		90
4	100	93	88	85	98	92	88	84	90	86	83		88	85	82		86
5	96	88	83	79	94	87	83	79	86	82	78		84	81	78		83
6	92	84	79	75	90	83	78	75	82	77	74		80	76	74		79
7	88	80	74	71	87	79	74	71	78	73	70		77	73	70		76
8	84	76	71	67	83	75	70	67	74	70	67		73	69	66		73
9	81	73	67	64	80	72	67	64	71	67	63		70	66	63		70
10	78	69	64	61	77	69	64	61	68	64	61		67	63	60		67

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	357214
5°	334057
10°	272445
15°	200484
20°	138186
25°	102593
30°	77062
35°	48051
40°	23329
45°	8001
50°	1049
55°	793
60°	460
65°	545
70°	673
75°	0
80°	0
85°	0



TEST NUMBER: P698904
 CATALOG NUMBER: MRI-FEU6C-35-L940 F6X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	541.8	18.9
10°-20°	972.4	34.0
20°-30°	786.2	27.5
30°-40°	452.9	15.8
40°-50°	95.7	3.3
50°-60°	8.3	0.3
60°-70°	4.2	0.1
70°-80°	0.5	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2300.4	80.4
0°-40°	2753.3	96.2
0°-60°	2857.3	99.8
0°-90°	2862.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2862.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6516	
5°	6070	542
15°	3532	972
25°	1696	786
35°	718	453
45°	103	96
55°	8	8
65°	4	4
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P698904

CATALOG NUMBER: MRI-FEU6C-35-L940 F6X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	6516.1
2.5°	6437.8
5°	6070.5
7.5°	5542.2
10°	4894.3
12.5°	4230.0
15°	3532.5
17.5°	2859.9
20°	2368.7
22.5°	1993.2
25°	1696.1
27.5°	1444.4
30°	1217.4
32.5°	965.7
35°	718.0
37.5°	499.3
40°	326.0
42.5°	198.1
45°	103.2
47.5°	41.2
50°	12.3
52.5°	12.3
55°	8.3
57.5°	8.3
60°	4.2
62.5°	4.2
65°	4.2
67.5°	4.2
70°	4.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)