

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P699064

Luminaire Tested: **MRI-FEU6C-40-L930 F6X-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P699064
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-40-L930 F6X-M-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3680.0 lumens
Efficiency: N/A
Efficacy: 78.3 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P699064
CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-M-X-LI

Luminous Intensity Polar Plot

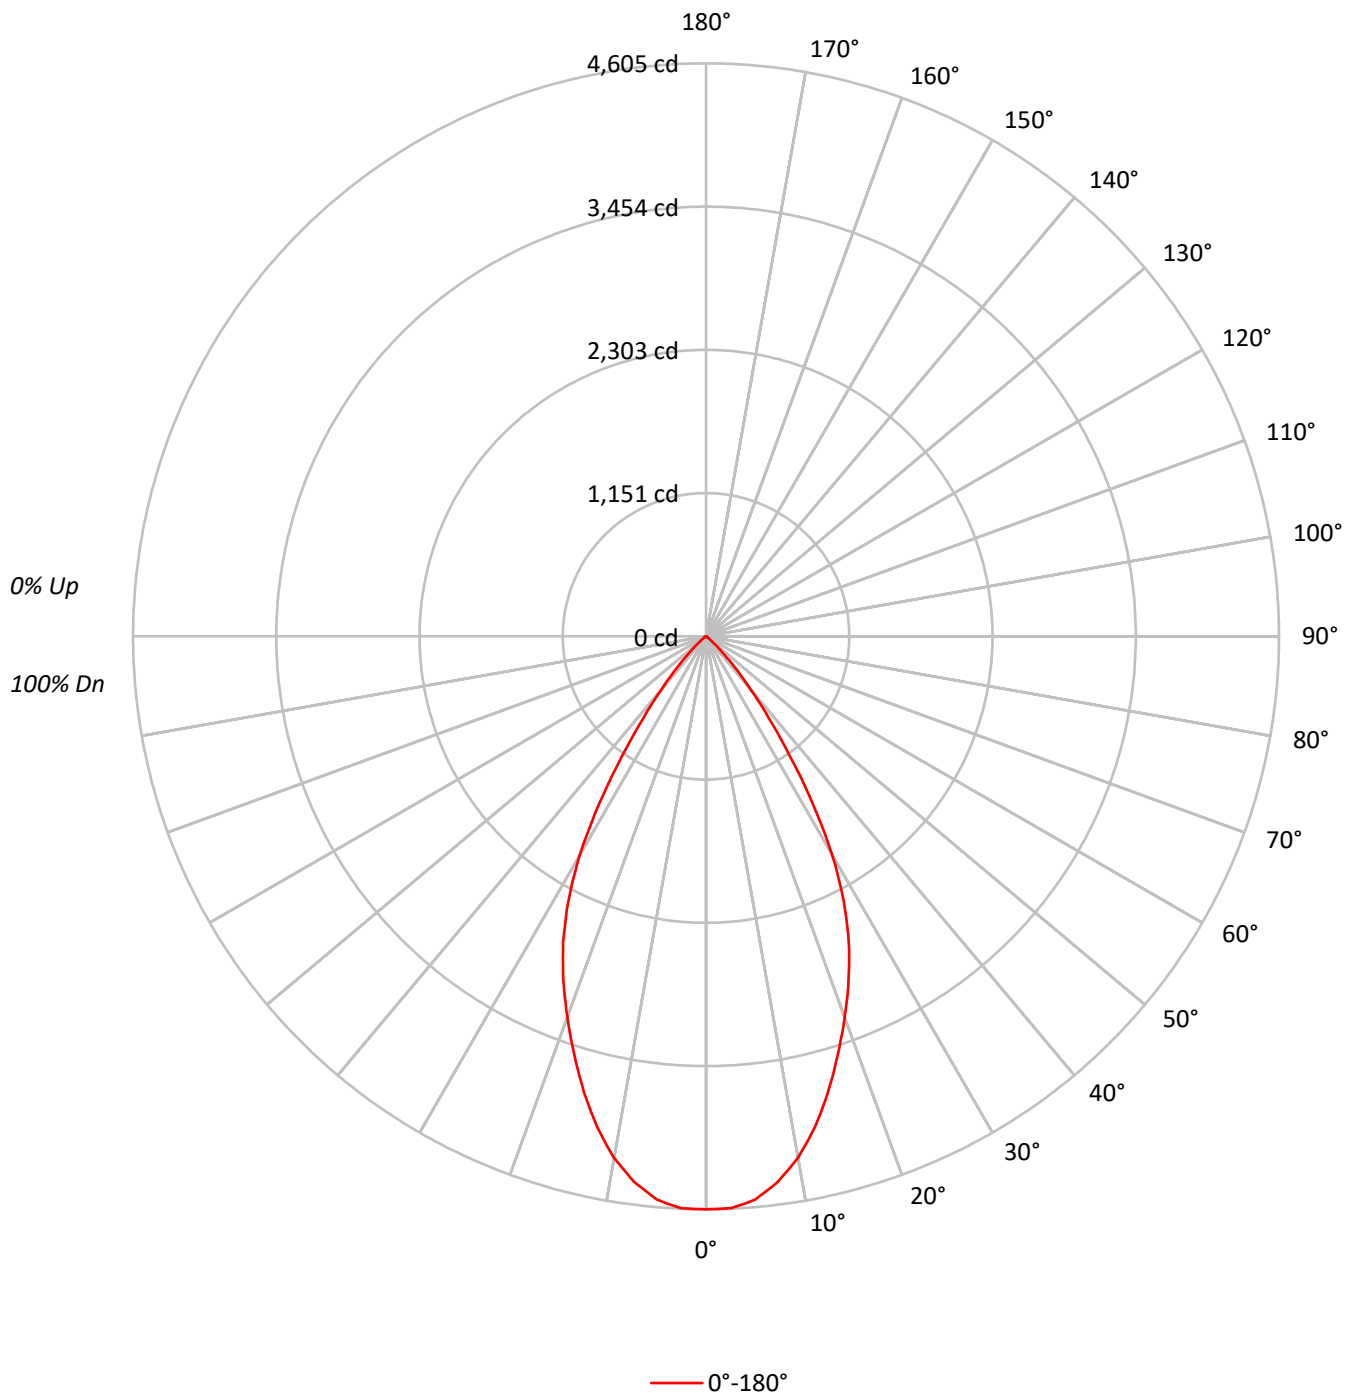



TEST NUMBER: P699064

CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94		
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88		
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82		
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76		
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71		
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67		
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63		
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	252463
5°	250065
10°	236958
15°	215137
20°	190102
25°	164350
30°	128469
35°	78789
40°	40440
45°	16064
50°	5219
55°	1797
60°	1546
65°	1232
70°	753
75°	996
80°	0
85°	0



TEST NUMBER: P699064
 CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	424.3	11.5
10°-20°	1056.2	28.7
20°-30°	1227.8	33.4
30°-40°	751.9	20.4
40°-50°	186.7	5.1
50°-60°	21.8	0.6
60°-70°	8.2	0.2
70°-80°	3.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2708.3	73.6
0°-40°	3460.2	94.0
0°-60°	3668.7	99.7
0°-90°	3680.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3680.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4605	
5°	4544	424
15°	3791	1056
25°	2717	1228
35°	1177	752
45°	207	187
55°	19	22
65°	10	8
75°	5	3
85°	0	0
90°	0	



TEST NUMBER: P699064
CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-M-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4605.3
2.5°	4600.6
5°	4544.2
7.5°	4421.7
10°	4256.8
12.5°	4040.3
15°	3790.7
17.5°	3522.3
20°	3258.6
22.5°	2994.8
25°	2717.1
27.5°	2396.9
30°	2029.5
32.5°	1601.0
35°	1177.3
37.5°	828.7
40°	565.1
42.5°	353.1
45°	207.2
47.5°	117.8
50°	61.2
52.5°	28.3
55°	18.8
57.5°	14.1
60°	14.1
62.5°	9.5
65°	9.5
67.5°	4.7
70°	4.7
72.5°	4.7
75°	4.7
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)