

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P699084

Luminaire Tested: **MRI-FEU6C-40-L930 F6X-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P699084
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-40-L930 F6X-N-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 3000K, 90 CRI LEDS, 6LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3270.0 lumens
Efficiency: N/A
Efficacy: 69.6 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P699084
CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-N-X-LI

Luminous Intensity Polar Plot

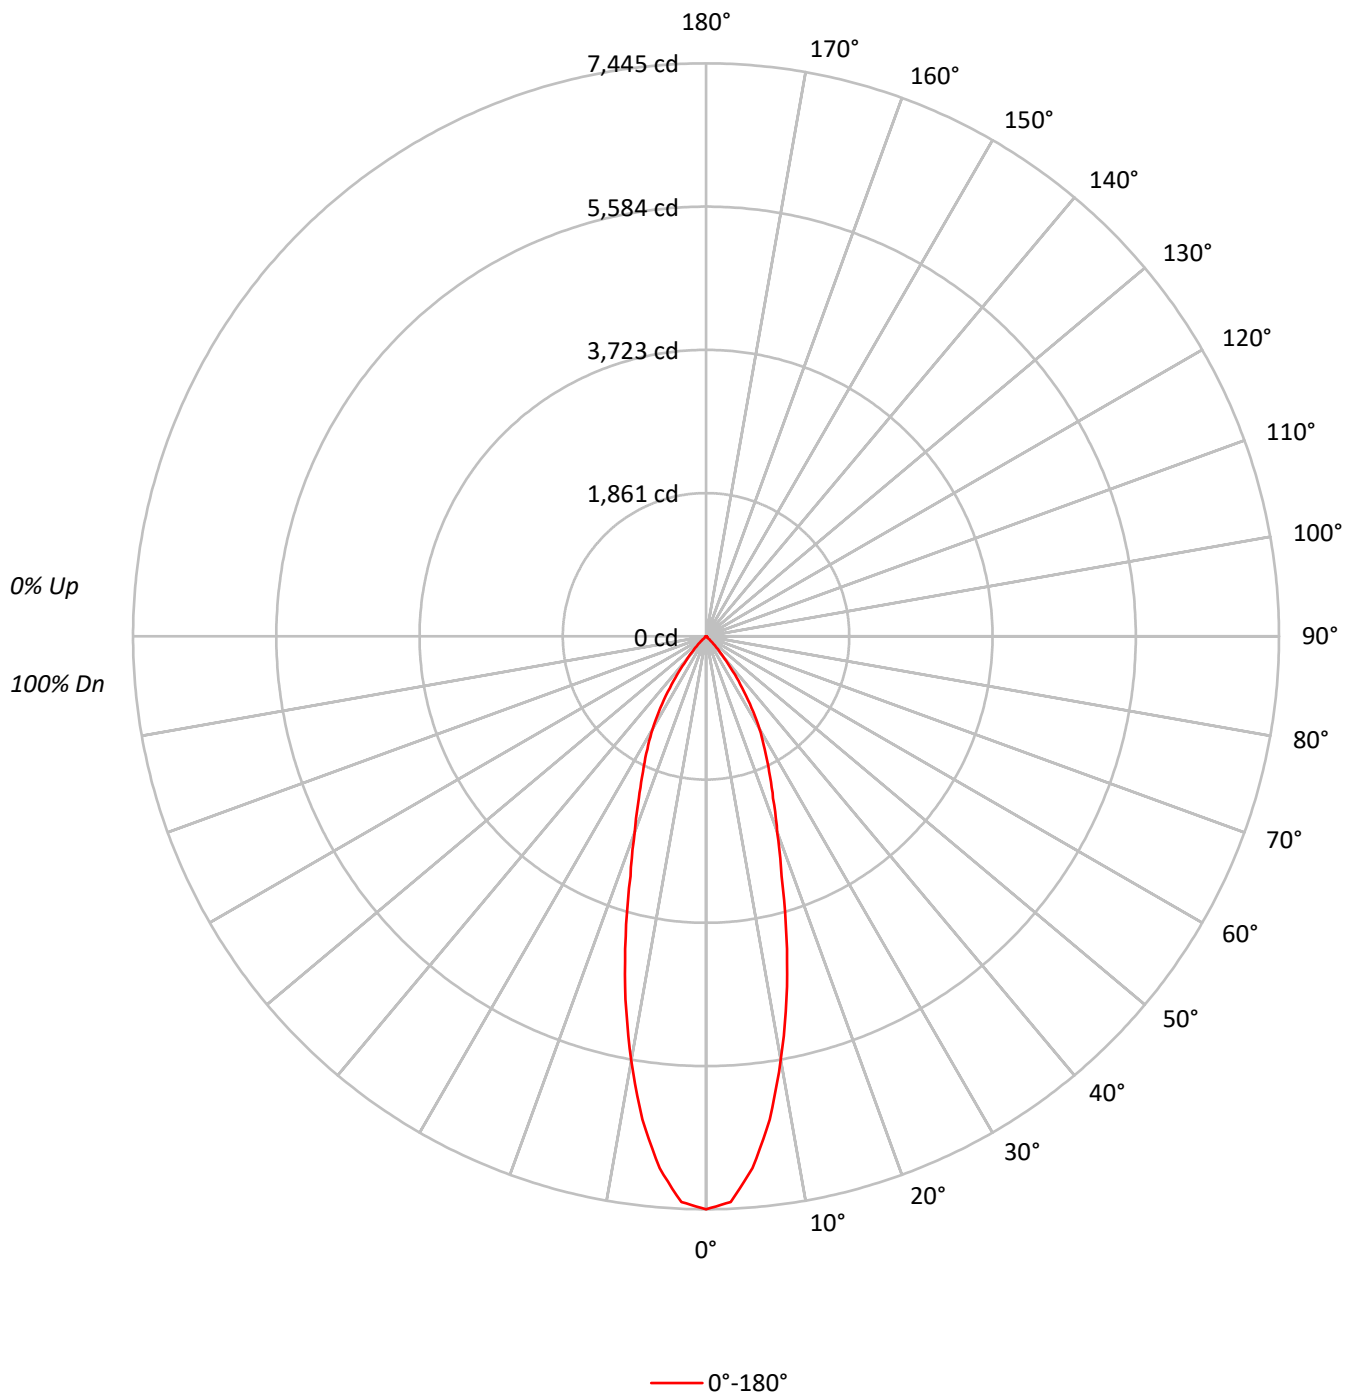



TEST NUMBER: P699084

CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	96	96	95
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	91	91	89
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	86	86	85
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	81	81	80
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	77	77	76
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	73	73	72
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	69	69	68
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	66	66	65
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	63	63	62
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	60	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	408136
5°	381680
10°	311289
15°	229065
20°	157887
25°	117212
30°	88045
35°	54904
40°	26650
45°	9140
50°	1203
55°	908
60°	515
65°	610
70°	753
75°	0
80°	0
85°	0



TEST NUMBER: P699084
 CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	619.0	18.9
10°-20°	1111.1	34.0
20°-30°	898.3	27.5
30°-40°	517.5	15.8
40°-50°	109.4	3.3
50°-60°	9.5	0.3
60°-70°	4.7	0.1
70°-80°	0.6	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2628.4	80.4
0°-40°	3145.8	96.2
0°-60°	3264.7	99.8
0°-90°	3270.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3270.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7445	
5°	6936	619
15°	4036	1111
25°	1938	898
35°	820	517
45°	118	109
55°	10	9
65°	5	5
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P699084
CATALOG NUMBER: MRI-FEU6C-40-L930 F6X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	7445.0
2.5°	7355.6
5°	6935.9
7.5°	6332.3
10°	5592.1
12.5°	4833.0
15°	4036.1
17.5°	3267.6
20°	2706.4
22.5°	2277.4
25°	1937.8
27.5°	1650.3
30°	1390.9
32.5°	1103.4
35°	820.4
37.5°	570.5
40°	372.4
42.5°	226.4
45°	117.9
47.5°	47.1
50°	14.1
52.5°	14.1
55°	9.5
57.5°	9.5
60°	4.7
62.5°	4.7
65°	4.7
67.5°	4.7
70°	4.7
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)