

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P699244

Luminaire Tested: **MRI-FEU6C-40-L950 F6X-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P699244
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-FEU6C-40-L950 F6X-M-X-LI
Description: 6 INCH FAIL-SAFE MRI LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 6LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3814.0 lumens
Efficiency: N/A
Efficacy: 81.1 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 47
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P699244
CATALOG NUMBER: MRI-FEU6C-40-L950 F6X-M-X-LI

Luminous Intensity Polar Plot

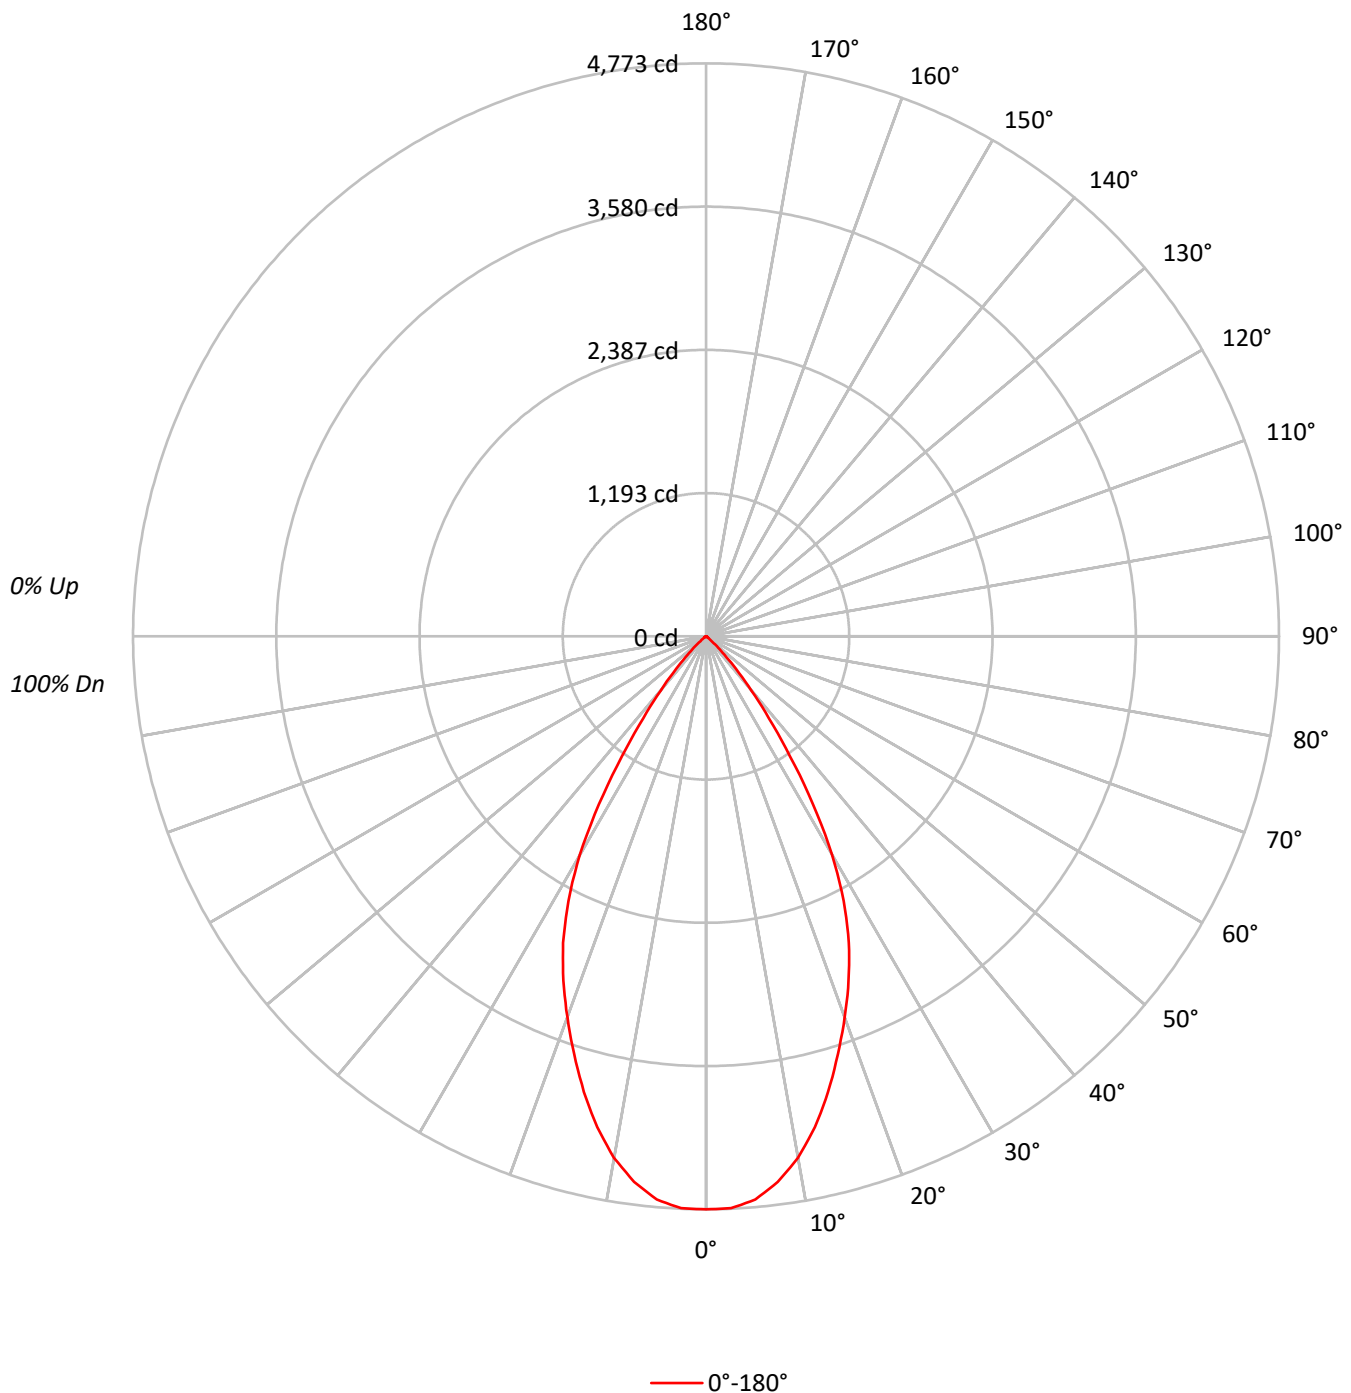



TEST NUMBER: P699244

CATALOG NUMBER: MRI-FEU6C-40-L950 F6X-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94		
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88		
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82		
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76		
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71		
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67		
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63		
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	261657
5°	259167
10°	245587
15°	222970
20°	197026
25°	170338
30°	133147
35°	81653
40°	41914
45°	16653
50°	5407
55°	1864
60°	1601
65°	1271
70°	785
75°	1038
80°	0
85°	0



TEST NUMBER: P699244
 CATALOG NUMBER: MRI-FEU6C-40-L950 F6X-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	439.7	11.5
10°-20°	1094.7	28.7
20°-30°	1272.5	33.4
30°-40°	779.3	20.4
40°-50°	193.5	5.1
50°-60°	22.6	0.6
60°-70°	8.4	0.2
70°-80°	3.2	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2806.9	73.6
0°-40°	3586.2	94.0
0°-60°	3802.3	99.7
0°-90°	3814.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3814.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4773	
5°	4710	440
15°	3929	1095
25°	2816	1273
35°	1220	779
45°	215	194
55°	20	23
65°	10	8
75°	5	3
85°	0	0
90°	0	

TEST NUMBER: P699244

CATALOG NUMBER: MRI-FEU6C-40-L950 F6X-M-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4773.0
2.5°	4768.1
5°	4709.6
7.5°	4582.7
10°	4411.8
12.5°	4187.4
15°	3928.7
17.5°	3650.5
20°	3377.3
22.5°	3103.9
25°	2816.1
27.5°	2484.2
30°	2103.4
32.5°	1659.3
35°	1220.1
37.5°	858.9
40°	585.7
42.5°	366.0
45°	214.8
47.5°	122.0
50°	63.4
52.5°	29.3
55°	19.5
57.5°	14.6
60°	14.6
62.5°	9.8
65°	9.8
67.5°	4.9
70°	4.9
72.5°	4.9
75°	4.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)