

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581504

Luminaire Tested: **HCC4W07D010BZ-HM40525930-41NDC**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581504
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-1)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W07D010BZ-HM40525930-41NDC
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 743.6 lumens
Efficiency: N/A
Efficacy: 93.0 lumens/watt
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581504

CATALOG NUMBER: HCC4W07D010BZ-HM40525930-41NDC

Luminous Intensity Polar Plot

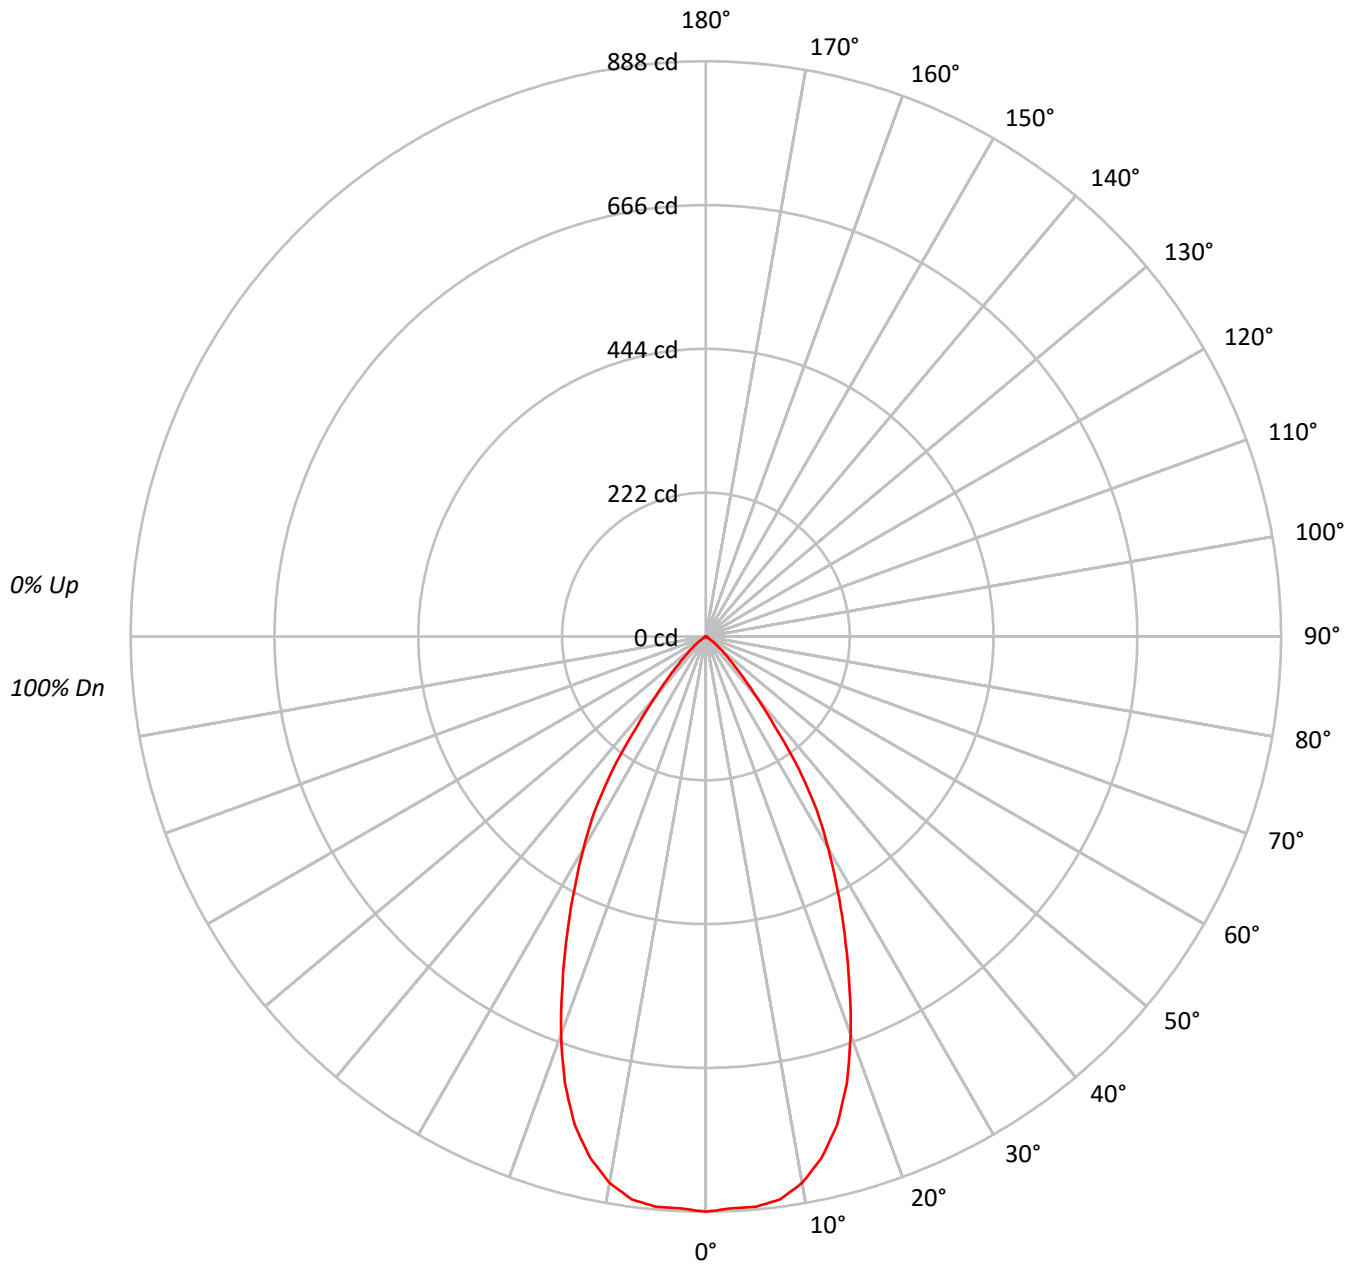

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P581504

CATALOG NUMBER: HCC4W07D010BZ-HM40525930-41NDC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	100	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	93	91	89	87		
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81		
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76		
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71		
6	88	79	73	69	87	78	73	69	77	72	68	76	71	68	74	70	67	66		
7	84	75	69	64	82	74	68	64	73	68	64	71	67	64	70	66	63	62		
8	80	70	64	60	78	70	64	60	69	64	60	68	63	60	67	62	59	58		
9	76	66	61	57	75	66	60	57	65	60	56	64	59	56	63	59	56	55		
10	72	63	57	53	71	62	57	53	62	57	53	61	56	53	60	56	53	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	109543
5°	109417
10°	107275
15°	99744
20°	85793
25°	68919
30°	53795
35°	37659
40°	19338
45°	9803
50°	4912
55°	1828
60°	740
65°	584
70°	361
75°	238
80°	355
85°	0



TEST NUMBER: P581504

CATALOG NUMBER: HCC4W07D010BZ-HM40525930-41NDC

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	83.5	11.2
10°-20°	215.6	29.0
20°-30°	232.3	31.2
30°-40°	152.6	20.5
40°-50°	47.4	6.4
50°-60°	9.3	1.2
60°-70°	2.0	0.3
70°-80°	0.7	0.1
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	531.5	71.5
0°-40°	684.0	92.0
0°-60°	740.7	99.6
0°-90°	743.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	743.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	888	
5°	884	84
15°	781	216
25°	506	232
35°	250	153
45°	56	47
55°	8	9
65°	2	2
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P581504

CATALOG NUMBER: HCC4W07D010BZ-HM40525930-41NDC

CANDELA DISTRIBUTION (FULL):

	0°
0°	888.1
2.5°	883.7
5°	883.7
7.5°	876.6
10°	856.5
12.5°	824.4
15°	781.1
17.5°	723.3
20°	653.6
22.5°	578.2
25°	506.4
27.5°	439.5
30°	377.7
32.5°	319.4
35°	250.1
37.5°	174.3
40°	120.1
42.5°	82.8
45°	56.2
47.5°	38.1
50°	25.6
52.5°	16.0
55°	8.5
57.5°	3.5
60°	3.0
62.5°	2.5
65°	2.0
67.5°	1.5
70°	1.0
72.5°	1.0
75°	0.5
77.5°	0.5
80°	0.5
82.5°	0.5
85°	0.0
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)