

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581498

Luminaire Tested: **HCC4S07D010SL-HM40525930-41WDWB**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581498
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-10)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4S07D010SL-HM40525930-41WDWB
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" WIDE DISTRIBUTION, WHITE BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 811.1 lumens
Efficiency: N/A
Efficacy: 101.4 lumens/watt
Spacing Criteria (0/90/45): 1.14 / 1.14 / 1.07
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581498

CATALOG NUMBER: HCC4S07D010SL-HM40525930-41WDWB

Luminous Intensity Polar Plot

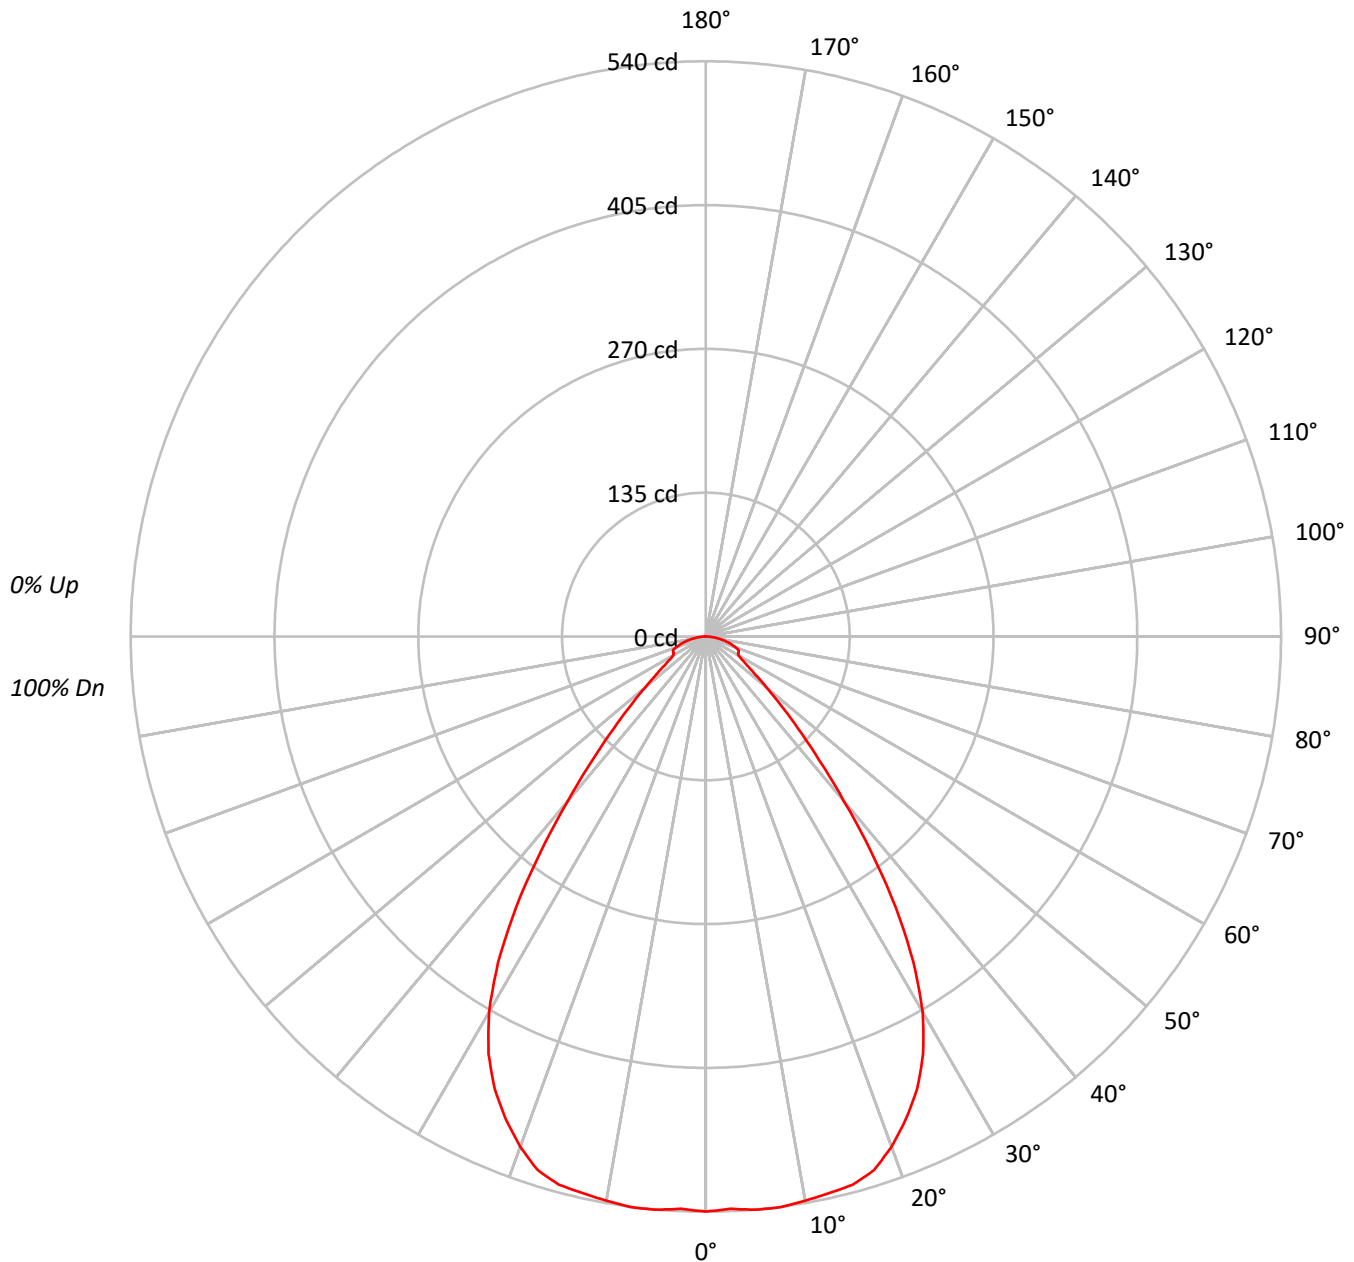



TEST NUMBER: P581498

CATALOG NUMBER: HCC4S07D010SL-HM40525930-41WDWB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20							
RC	80				70				50				30				10				0			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0			
RCR																								
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	92	90						
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	84	82	80						
3	98	89	83	78	95	88	82	78	85	80	76	83	78	75	80	77	74	72						
4	91	82	75	70	89	81	74	69	78	73	69	76	72	68	74	70	67	65						
5	86	75	68	63	84	74	68	63	72	67	62	71	65	61	69	64	61	59						
6	80	70	62	57	79	69	62	57	67	61	57	66	60	56	64	59	56	54						
7	76	64	57	52	74	64	57	52	62	56	52	61	56	51	60	55	51	49						
8	71	60	53	48	70	59	53	48	58	52	48	57	51	47	56	51	47	46						
9	67	56	49	44	66	55	49	44	54	48	44	53	48	44	52	47	44	42						
10	64	52	46	41	62	52	45	41	51	45	41	50	45	41	49	44	41	39						

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	66594
5°	66898
10°	67359
15°	68037
20°	66904
25°	63829
30°	57996
35°	46784
40°	32445
45°	21299
50°	14277
55°	10150
60°	8684
65°	9952
70°	10711
75°	10294
80°	9305
85°	8491

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P581498

CATALOG NUMBER: HCC4S07D010SL-HM40525930-41WDWB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.5	6.3
10°-20°	149.7	18.5
20°-30°	213.9	26.4
30°-40°	191.0	23.6
40°-50°	98.0	12.1
50°-60°	44.5	5.5
60°-70°	33.2	4.1
70°-80°	22.6	2.8
80°-90°	6.7	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	415.0	51.2
0°-40°	606.1	74.7
0°-60°	748.6	92.3
0°-90°	811.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	811.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	540	
5°	540	51
15°	533	150
25°	469	214
35°	311	191
45°	122	98
55°	47	45
65°	34	33
75°	22	23
85°	6	7
90°	0	



TEST NUMBER: P581498

CATALOG NUMBER: HCC4S07D010SL-HM40525930-41WDWB

CANDELA DISTRIBUTION (FULL):

	0°
0°	539.9
2.5°	537.8
5°	540.3
7.5°	540.3
10°	537.8
12.5°	535.3
15°	532.8
17.5°	525.3
20°	509.7
22.5°	490.6
25°	469.0
27.5°	441.8
30°	407.2
32.5°	362.9
35°	310.7
37.5°	254.8
40°	201.5
42.5°	157.4
45°	122.1
47.5°	95.5
50°	74.4
52.5°	58.3
55°	47.2
57.5°	39.7
60°	35.2
62.5°	34.1
65°	34.1
67.5°	33.2
70°	29.7
72.5°	25.6
75°	21.6
77.5°	17.1
80°	13.1
82.5°	9.6
85°	6.0
87.5°	2.5
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)