

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P581507

Luminaire Tested: **HCC4W07D010MW-HM40525930-41NDW**

Issue Date: 9/9/2021

Test Information

Test Method: LM-41-14
Report Number: P581507
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2106-266-3)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC4W07D010MW-HM40525930-41NDW
Description: HALO COMMERCIAL 4" ROUND, NEW CONSTRUCTION FRAME, WITH 4" NARROW DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 691.5 lumens
Efficiency: N/A
Efficacy: 86.4 lumens/watt
Spacing Criteria (0/90/45): 1.03 / 1.03 / 1.01
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct


Input Watts (W): 8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P581507

CATALOG NUMBER: HCC4W07D010MW-HM40525930-41NDW

Luminous Intensity Polar Plot

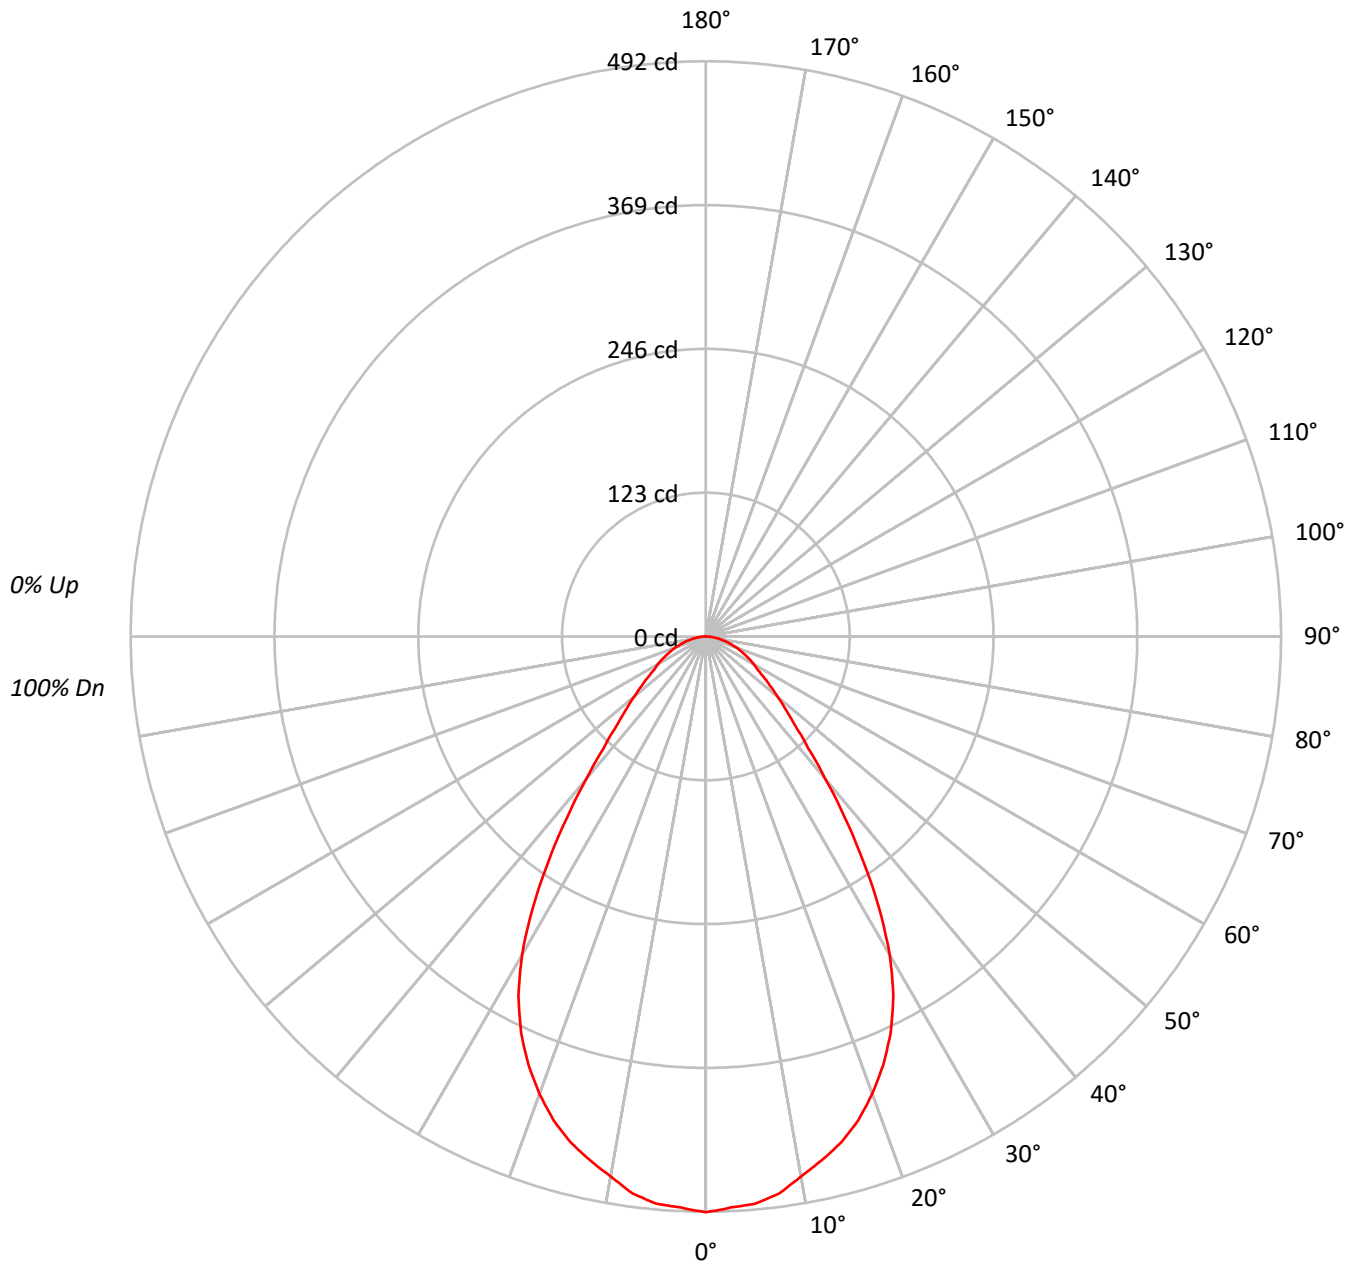

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P581507

CATALOG NUMBER: HCC4W07D010MW-HM40525930-41NDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	111	108	104	101		109	105	102	100		101	99	97		98	96	94		94	92	91
2	104	97	92	88		101	96	91	87		92	88	85		89	86	83		86	83	81
3	97	88	82	77		95	87	81	76		84	79	75		82	77	74		79	76	73
4	90	81	74	68		88	80	73	68		77	72	67		75	70	66		73	69	65
5	85	74	67	61		83	73	66	61		71	65	60		69	64	60		68	63	59
6	79	68	61	56		78	67	60	55		66	60	55		64	59	55		63	58	54
7	75	63	56	51		73	62	56	51		61	55	50		60	54	50		59	53	50
8	70	59	52	47		69	58	51	46		57	51	46		56	50	46		55	50	46
9	66	55	48	43		65	54	47	43		53	47	43		52	47	43		51	46	42
10	63	51	44	40		62	51	44	40		50	44	40		49	43	39		48	43	39

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	60748
5°	60299
10°	58729
15°	57183
20°	54631
25°	50887
30°	44822
35°	35340
40°	25650
45°	18857
50°	15332
55°	12881
60°	11644
65°	10682
70°	9990
75°	9103
80°	8240
85°	7076



TEST NUMBER: P581507

CATALOG NUMBER: HCC4W07D010MW-HM40525930-41NDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	45.9	6.6
10°-20°	125.6	18.2
20°-30°	170.3	24.6
30°-40°	146.1	21.1
40°-50°	86.3	12.5
50°-60°	54.7	7.9
60°-70°	36.7	5.3
70°-80°	20.3	2.9
80°-90°	5.7	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	341.8	49.4
0°-40°	487.9	70.6
0°-60°	628.8	90.9
0°-90°	691.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	691.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	492	
5°	487	46
15°	448	126
25°	374	170
35°	235	146
45°	108	86
55°	60	55
65°	37	37
75°	19	20
85°	5	6
90°	0	



TEST NUMBER: P581507

CATALOG NUMBER: HCC4W07D010MW-HM40525930-41NDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	492.5
2.5°	489.0
5°	487.0
7.5°	480.5
10°	468.9
12.5°	458.8
15°	447.8
17.5°	433.7
20°	416.2
22.5°	396.5
25°	373.9
27.5°	347.3
30°	314.7
32.5°	276.0
35°	234.7
37.5°	195.1
40°	159.3
42.5°	129.6
45°	108.1
47.5°	92.5
50°	79.9
52.5°	69.3
55°	59.9
57.5°	52.2
60°	47.2
62.5°	42.2
65°	36.6
67.5°	32.2
70°	27.7
72.5°	23.1
75°	19.1
77.5°	15.0
80°	11.6
82.5°	8.1
85°	5.0
87.5°	2.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)