

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582080

Luminaire Tested: **HCC6S25D010SL-HM60525930-61RWWC**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582080
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-14)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6S25D010SL-HM60525930-61RWWC
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2280.1 lumens
Efficiency: N/A
Efficacy: 85.1 lumens/watt
Spacing Criteria (0/90/45): 1.22 / 1.15 / 1.2
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 26.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582080

CATALOG NUMBER: HCC6S25D010SL-HM60525930-61RWWC

Luminous Intensity Polar Plot

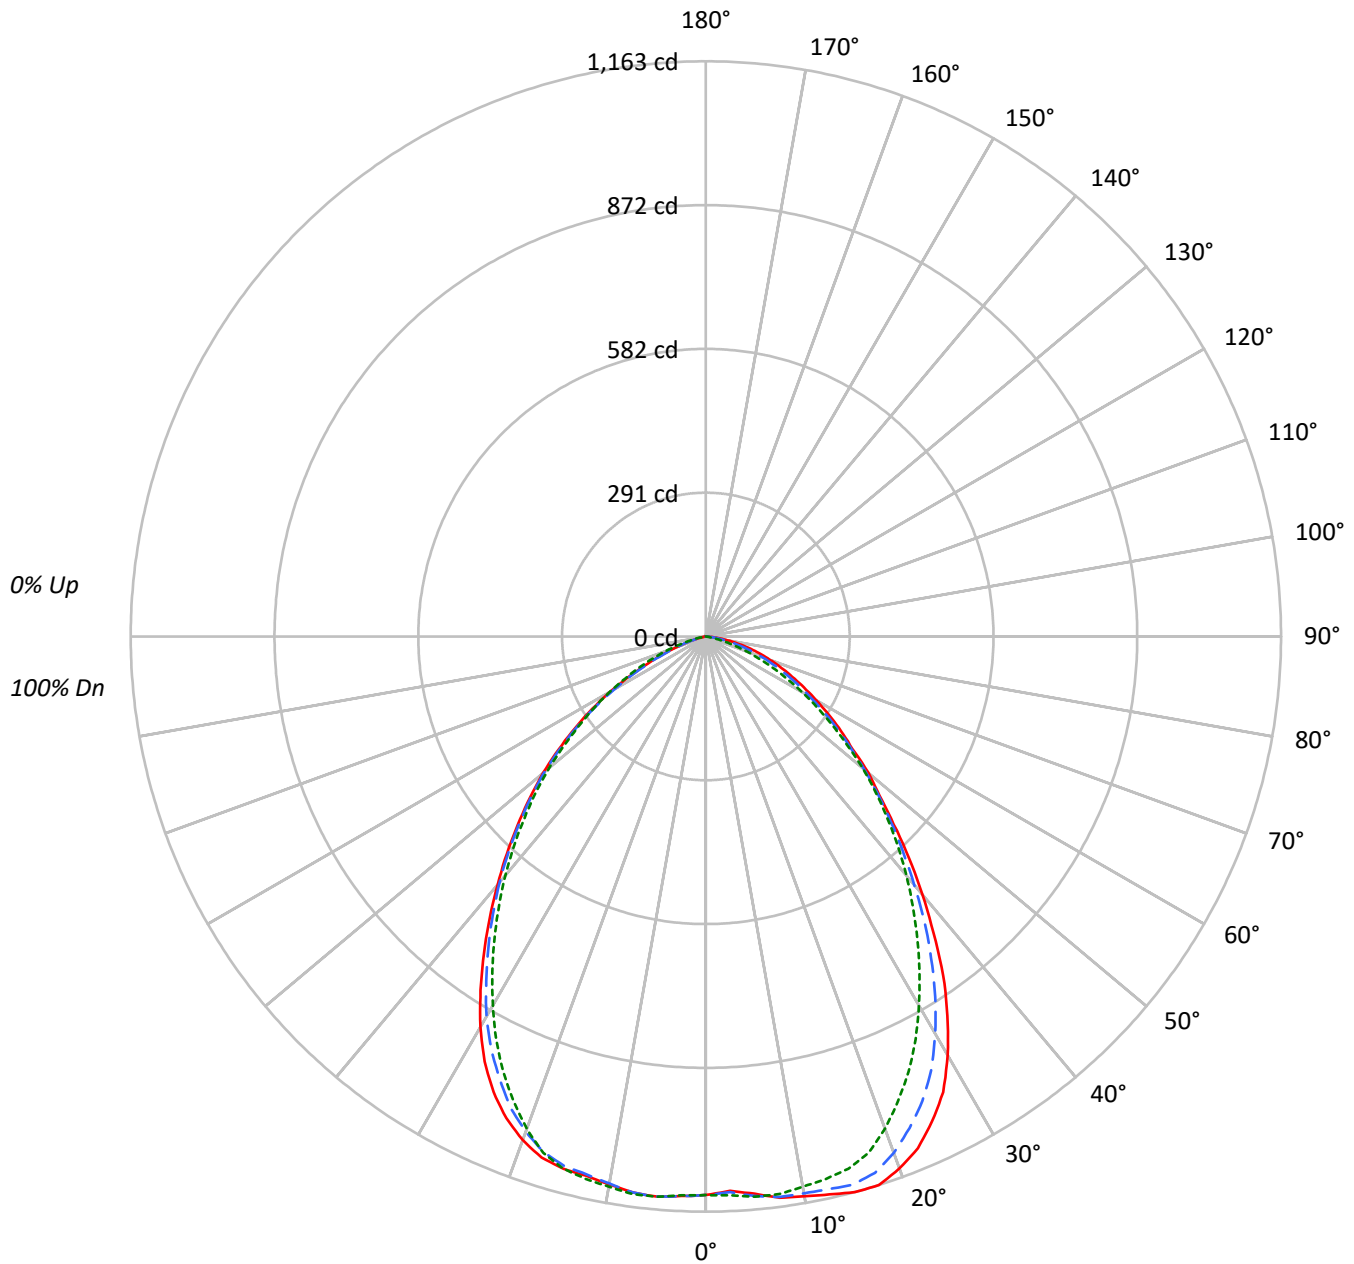

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582080

CATALOG NUMBER: HCC6S25D010SL-HM60525930-61RWWC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88		
2	103	96	90	86	100	94	89	85	91	86	83	88	84	81	85	82	79	77		
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	69	68		
4	88	78	70	64	86	76	69	64	74	68	63	72	67	62	70	65	61	60		
5	82	70	62	57	80	69	62	56	67	61	56	65	60	55	64	59	55	53		
6	76	64	56	50	74	63	56	50	62	55	50	60	54	49	58	53	49	47		
7	71	59	51	45	69	58	50	45	56	50	45	55	49	45	54	48	44	42		
8	66	54	46	41	65	53	46	41	52	45	41	51	45	40	50	44	40	38		
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35		
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32		

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	61919	61919	61919
5°	62238	62574	62574
10°	63977	62875	62613
15°	66005	63224	63224
20°	66780	61780	63210
25°	65447	58685	61467
30°	61896	54540	57737
35°	56021	49878	52334
40°	48734	45120	46866
45°	41648	40213	41648
50°	36545	35240	36673
55°	31894	29686	30862
60°	28189	24658	24329
65°	25009	19457	16681
70°	22071	13736	10066
75°	18787	7773	4850
80°	14017	2399	1452
85°	7737	943	943

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582080

CATALOG NUMBER: HCC6S25D010SL-HM60525930-61RWWC

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	108.3	4.8
10°-20°	317.0	13.9
20°-30°	462.9	20.3
30°-40°	485.5	21.3
40°-50°	409.0	17.9
50°-60°	286.6	12.6
60°-70°	153.6	6.7
70°-80°	51.5	2.3
80°-90°	5.6	0.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	888.2	39.0
0°-40°	1373.7	60.2
0°-60°	2069.3	90.8
0°-90°	2280.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2280.1	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1130	1130	1130	1130	1130	
5°	1131	1136	1137	1137	1137	109
15°	1163	1148	1114	1108	1114	328
25°	1082	1036	970	987	1016	496
35°	837	794	745	767	782	520
45°	537	528	519	532	537	418
55°	334	323	311	317	323	300
65°	193	176	150	124	129	193
75°	89	69	37	23	23	94
85°	12	6	2	2	2	17
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582080

CATALOG NUMBER: HCC6S25D010SL-HM60525930-61RWWC

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1129.5	1129.5	1129.5	1129.5	1129.5	1129.5	1129.5	1129.5	1129.5
2.5°	1121.7	1121.7	1124.8	1127.8	1131.0	1131.0	1132.5	1134.0	1132.5
5°	1131.0	1131.0	1135.5	1137.1	1137.1	1135.5	1137.1	1137.1	1137.1
7.5°	1144.7	1141.6	1143.1	1140.1	1137.1	1135.5	1134.0	1134.0	1134.0
10°	1149.3	1146.2	1143.1	1137.1	1129.5	1124.8	1123.3	1124.8	1124.8
12.5°	1155.4	1152.4	1144.7	1132.5	1123.3	1115.7	1114.0	1117.2	1117.2
15°	1163.0	1160.0	1147.7	1127.8	1114.0	1106.4	1108.0	1111.0	1114.0
17.5°	1163.0	1156.9	1137.1	1111.0	1094.2	1086.6	1092.6	1100.3	1104.9
20°	1144.7	1138.6	1111.0	1078.8	1059.0	1054.4	1065.2	1078.8	1083.5
22.5°	1120.2	1108.0	1075.8	1037.6	1016.2	1016.2	1031.5	1048.3	1054.4
25°	1082.0	1072.8	1036.1	991.6	970.2	968.7	987.1	1010.0	1016.2
27.5°	1039.1	1026.8	987.1	941.1	918.2	919.7	939.6	962.6	968.7
30°	977.8	962.6	927.3	883.0	861.6	867.7	887.6	904.4	912.1
32.5°	909.1	895.3	863.1	821.8	803.4	809.6	826.4	841.6	847.8
35°	837.1	821.8	794.3	757.6	745.3	751.4	766.7	779.0	782.0
37.5°	755.9	745.3	725.4	696.3	687.1	694.8	707.1	714.7	717.7
40°	681.0	671.9	654.9	633.5	630.5	636.6	648.9	653.4	654.9
42.5°	607.6	599.9	589.2	573.9	573.9	580.0	590.7	593.8	595.3
45°	537.2	532.5	528.0	515.7	518.7	526.4	532.5	537.2	537.2
47.5°	475.9	477.5	471.4	462.1	465.2	472.9	477.5	482.0	482.0
50°	428.5	423.9	417.8	408.6	413.2	419.3	425.4	428.5	430.0
52.5°	373.4	371.9	367.3	356.6	359.6	362.7	368.8	373.4	374.9
55°	333.7	329.0	322.9	310.6	310.6	313.8	316.8	319.9	322.9
57.5°	295.3	290.8	281.5	267.8	266.3	266.3	264.8	267.8	272.4
60°	257.1	255.6	241.8	229.5	224.9	220.4	214.3	215.8	221.9
62.5°	223.4	220.4	208.1	192.8	183.7	176.0	168.3	166.8	172.9
65°	192.8	189.7	176.0	160.6	150.0	136.2	123.9	123.9	128.6
67.5°	165.3	159.1	146.9	130.1	116.3	99.5	87.2	90.3	91.8
70°	137.7	133.2	119.4	102.5	85.7	68.9	61.3	62.8	62.8
72.5°	113.3	107.1	93.3	76.6	59.6	44.4	41.3	39.8	39.8
75°	88.7	82.7	68.9	52.0	36.7	26.1	22.9	22.9	22.9
77.5°	64.3	59.6	47.5	32.1	19.9	12.3	10.7	9.1	9.1
80°	44.4	39.8	29.1	16.8	7.6	4.6	4.6	4.6	4.6
82.5°	26.1	21.4	13.8	7.6	3.0	1.5	1.5	1.5	1.5
85°	12.3	9.1	6.1	3.0	1.5	1.5	1.5	1.5	1.5
87.5°	1.5	1.5	1.5	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



— 0°-180° - - 45°-225° - - - 90°-270°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)