

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582087

Luminaire Tested: **HCC6W25D010BZ-HM60525930-61WWBB**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582087
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-17)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W25D010BZ-HM60525930-61WWBB
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH
DISTRIBUTION, WHITE BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1938.8 lumens
Efficiency: N/A
Efficacy: 72.3 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.06 / 1.14
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 26.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582087

CATALOG NUMBER: HCC6W25D010BZ-HM60525930-61WWBB

Luminous Intensity Polar Plot

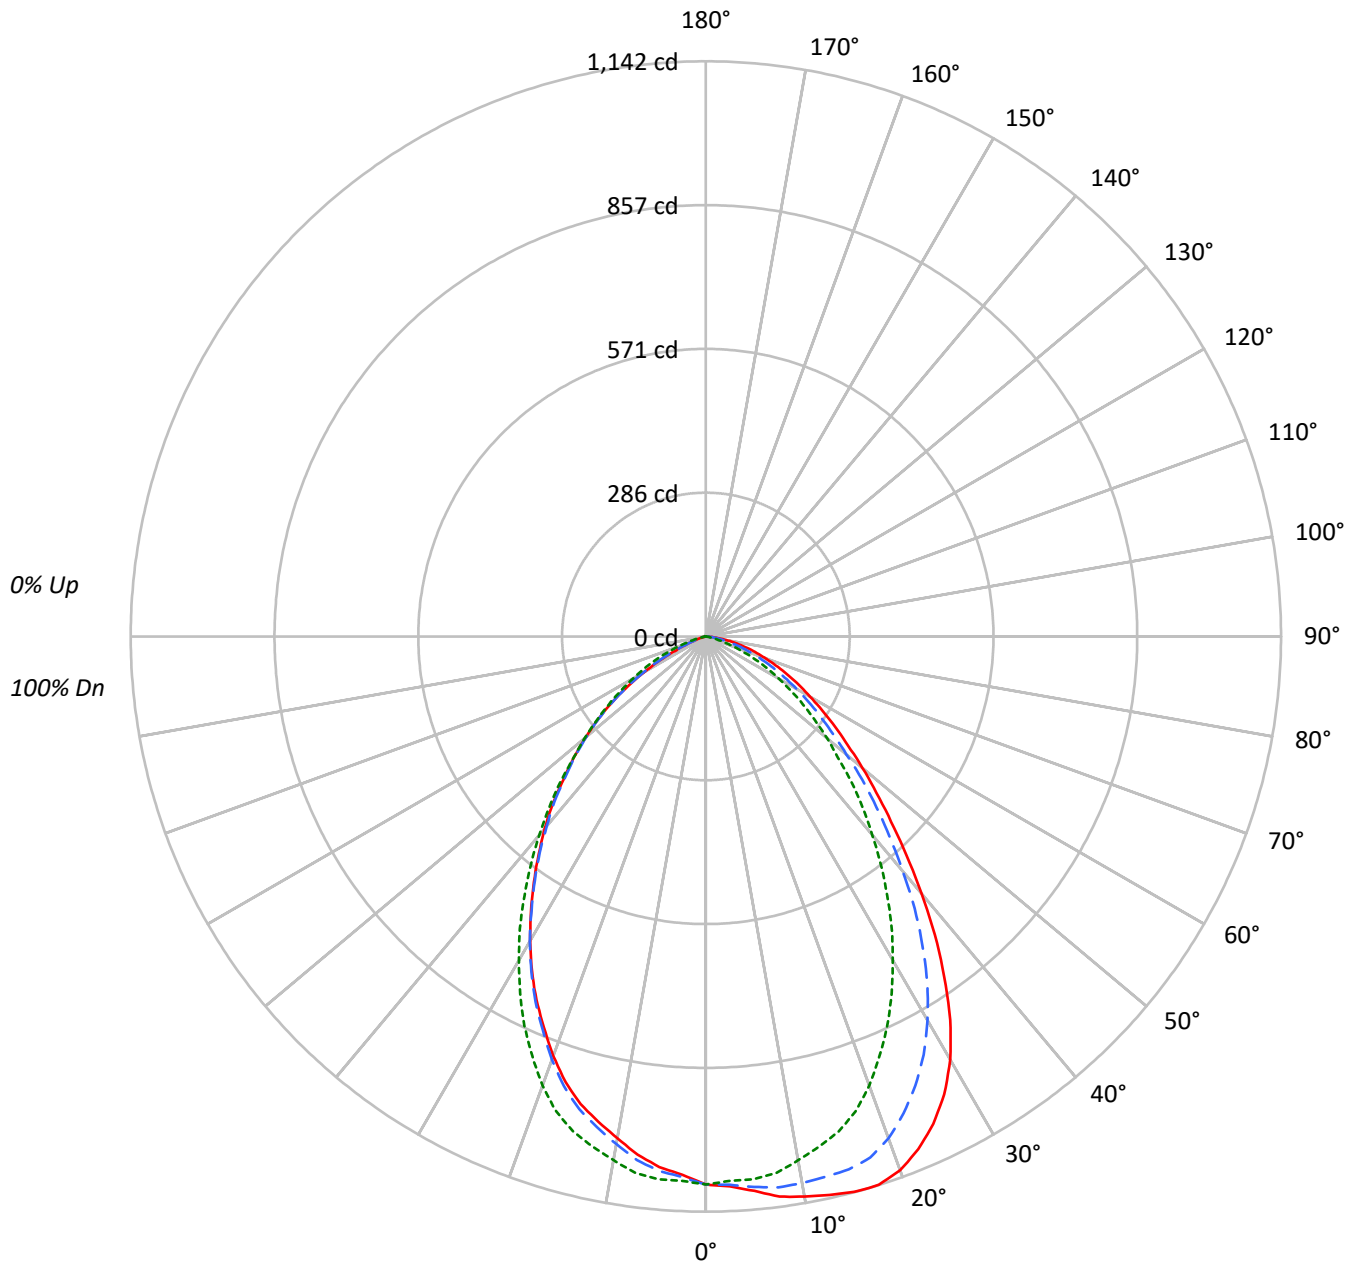

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582087

CATALOG NUMBER: HCC6W25D010BZ-HM60525930-61WWBB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	104	101	109	105	102	100	101	99	97	97	95	94	94	92	91	89		
2	103	97	91	87	101	95	90	86	91	87	84	88	85	82	85	83	80	78		
3	96	87	80	75	93	86	79	74	83	77	73	80	76	72	78	74	71	69		
4	89	79	71	66	87	78	71	65	75	69	64	73	68	64	71	67	63	61		
5	83	72	64	58	81	71	63	58	69	62	57	67	61	57	65	60	56	54		
6	77	65	58	52	75	65	57	52	63	56	51	61	55	51	60	55	51	49		
7	72	60	52	47	70	59	52	47	58	51	46	56	51	46	55	50	46	44		
8	67	55	48	43	66	55	47	42	53	47	42	52	46	42	51	46	42	40		
9	63	51	44	39	62	51	44	39	50	43	39	49	43	38	48	42	38	37		
10	60	48	40	36	58	47	40	36	46	40	36	45	40	35	45	39	35	34		

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	59644	59644	59644
5°	60802	59531	58188
10°	62863	58778	56306
15°	64790	57753	54546
20°	65794	55351	51688
25°	64607	51553	48136
30°	61415	46982	44171
35°	55198	41988	39839
40°	47632	36790	35588
45°	40330	31678	30840
50°	34583	26762	26490
55°	29992	22527	21638
60°	26171	18288	15437
65°	23037	14087	8535
70°	19859	9312	4183
75°	16860	4533	1610
80°	13038	1926	947
85°	7737	943	943

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582087

CATALOG NUMBER: HCC6W25D010BZ-HM60525930-61WWBB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	102.7	5.3
10°-20°	290.3	15.0
20°-30°	408.9	21.1
30°-40°	417.7	21.5
40°-50°	336.8	17.4
50°-60°	225.9	11.7
60°-70°	114.3	5.9
70°-80°	36.5	1.9
80°-90°	5.6	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	801.9	41.4
0°-40°	1219.6	62.9
0°-60°	1782.4	91.9
0°-90°	1938.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1938.8	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1088	1088	1088	1088	1088	
5°	1105	1097	1082	1065	1057	106
15°	1142	1096	1018	972	961	322
25°	1068	984	852	800	796	489
35°	825	750	627	592	595	513
45°	520	479	409	395	398	405
55°	314	278	236	225	226	282
65°	178	147	109	72	66	177
75°	80	57	21	8	8	85
85°	12	6	2	2	2	16
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582087

CATALOG NUMBER: HCC6W25D010BZ-HM60525930-61WWBB

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1088.0	1088.0	1088.0	1088.0	1088.0	1088.0	1088.0	1088.0	1088.0
2.5°	1092.6	1091.1	1089.5	1086.5	1081.8	1077.3	1074.2	1071.2	1069.7
5°	1104.9	1101.8	1097.1	1091.1	1081.8	1071.2	1065.0	1058.9	1057.4
7.5°	1121.7	1115.5	1103.3	1089.5	1074.2	1058.9	1048.3	1042.1	1037.5
10°	1129.3	1118.6	1101.8	1078.8	1055.9	1037.5	1023.7	1014.6	1011.5
12.5°	1135.5	1123.2	1098.8	1068.1	1037.5	1013.1	997.8	990.1	987.0
15°	1141.6	1129.3	1095.6	1055.9	1017.6	988.5	971.7	964.1	961.1
17.5°	1141.6	1124.7	1085.0	1034.5	988.5	953.3	936.5	928.8	927.3
20°	1127.8	1109.4	1060.4	1000.8	948.8	908.9	893.6	889.1	886.0
22.5°	1101.8	1080.3	1025.2	957.9	901.3	863.1	846.3	843.1	840.1
25°	1068.1	1046.6	984.0	912.1	852.3	814.1	800.3	797.3	795.8
27.5°	1025.2	1002.3	936.5	863.1	798.8	762.1	749.8	749.8	748.3
30°	970.2	944.1	879.9	806.4	742.2	708.4	699.3	699.3	697.8
32.5°	902.8	876.8	818.7	748.3	687.0	651.9	644.3	647.3	645.8
35°	824.8	803.4	749.8	681.0	627.4	595.3	592.2	595.3	595.3
37.5°	746.8	726.9	681.0	621.2	570.7	541.7	541.7	546.3	544.8
40°	665.6	650.3	607.5	555.5	514.1	494.3	491.2	495.8	497.3
42.5°	589.2	576.9	540.2	497.3	460.6	440.7	445.3	448.3	450.0
45°	520.2	508.1	479.0	434.5	408.6	394.8	394.8	399.3	397.8
47.5°	459.1	450.0	420.8	378.0	355.0	348.8	352.0	355.0	355.0
50°	405.5	391.7	364.2	330.5	313.8	306.1	309.1	310.6	310.6
52.5°	355.0	345.8	318.3	287.7	272.4	267.8	267.8	269.3	269.3
55°	313.8	303.0	278.5	247.8	235.7	229.5	224.9	223.4	226.4
57.5°	273.9	264.8	241.8	212.8	199.0	192.8	183.7	180.6	183.7
60°	238.7	231.1	208.1	180.6	166.8	154.5	143.8	137.7	140.8
62.5°	208.1	199.0	175.9	153.0	137.7	123.9	107.1	98.0	102.5
65°	177.6	169.9	146.9	123.9	108.6	91.8	71.9	65.8	65.8
67.5°	150.0	142.3	120.9	101.0	82.6	62.8	44.4	42.9	44.4
70°	123.9	116.3	98.0	78.1	58.1	38.2	26.1	26.1	26.1
72.5°	102.5	93.3	76.6	56.6	36.7	19.9	13.8	15.3	15.3
75°	79.6	71.9	56.6	38.2	21.4	9.1	7.6	7.6	7.6
77.5°	59.6	53.5	39.8	24.4	10.7	3.0	3.0	3.0	3.0
80°	41.3	35.2	26.1	15.3	6.1	3.0	3.0	3.0	3.0
82.5°	24.4	21.4	15.3	7.6	3.0	1.5	1.5	1.5	1.5
85°	12.3	10.7	6.1	3.0	1.5	1.5	1.5	1.5	1.5
87.5°	3.0	3.0	1.5	1.5	0.0	1.5	1.5	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



— 0°-180° - - 45°-225° - - - 90°-270°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)