

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582089

Luminaire Tested: **HCC6W25D010MB-HM60525930-61WWWB**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582089
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-18)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W25D010MB-HM60525930-61WWWB
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WALLWASH DISTRIBUTION, BLACK BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2192.9 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.09 / 1.17
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 26.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582089

CATALOG NUMBER: HCC6W25D010MB-HM60525930-61WWWB

Luminous Intensity Polar Plot

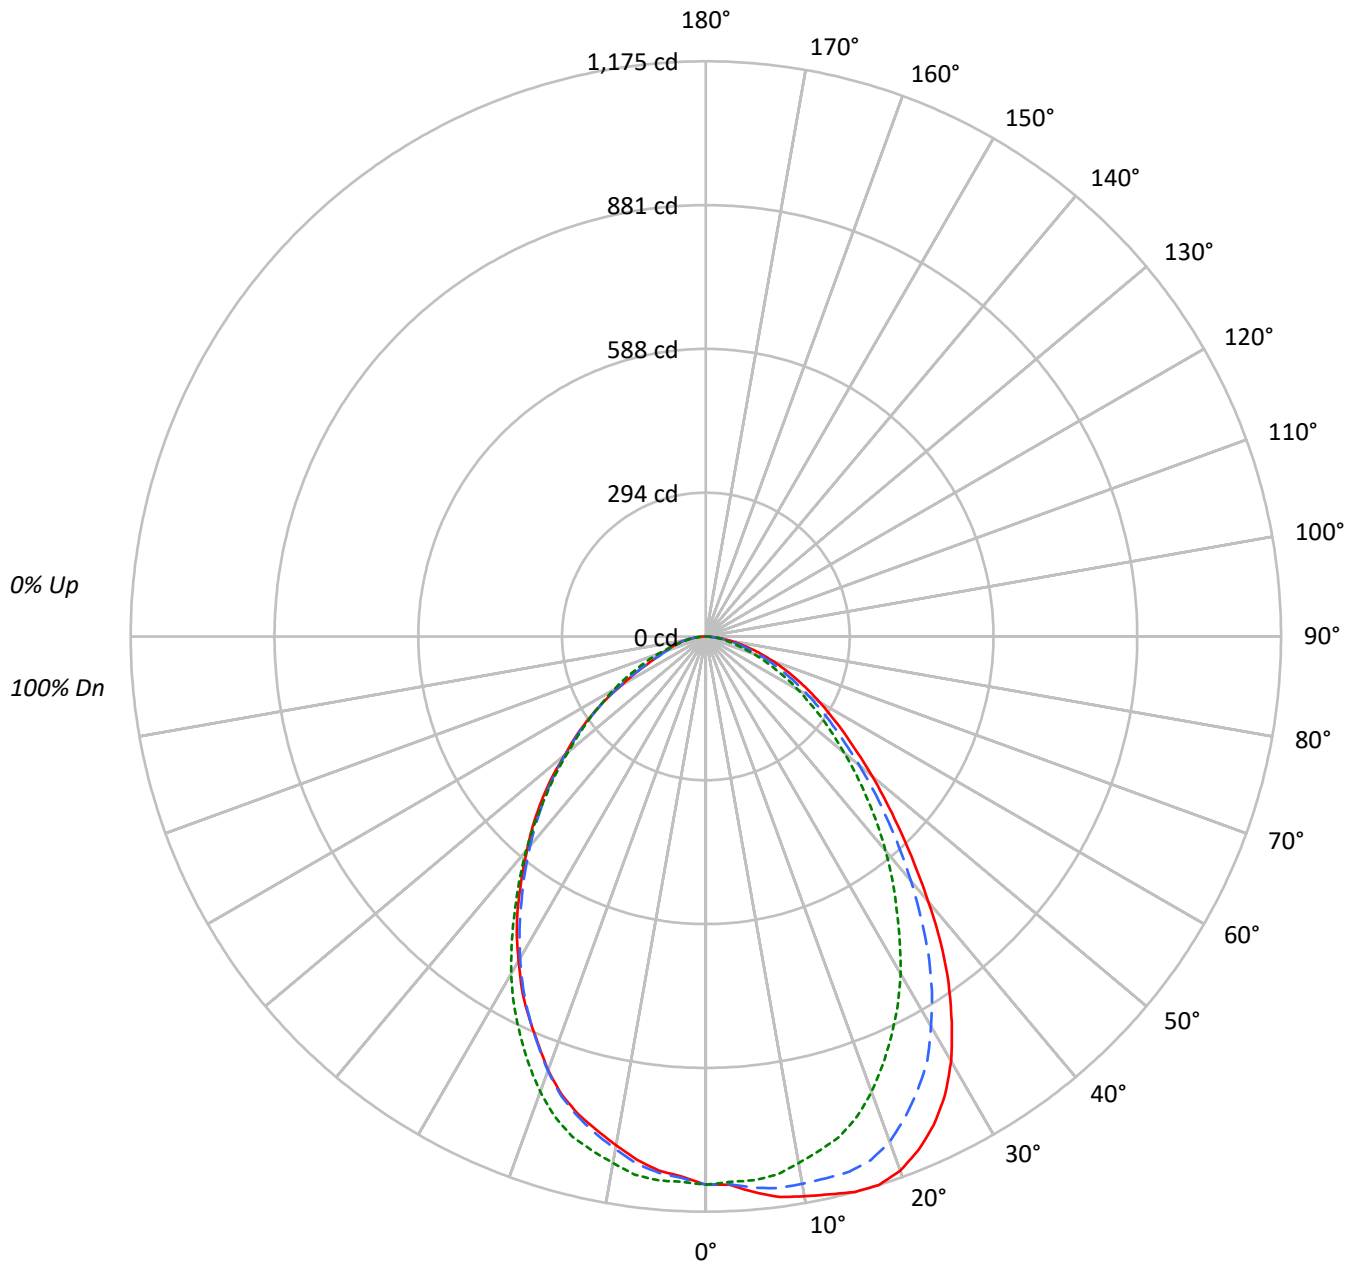

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582089

CATALOG NUMBER: HCC6W25D010MB-HM60525930-61WWWB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	107	103	100	108	104	101	98	100	97	95	96	94	92	93	91	89	87		
2	102	95	89	84	100	93	88	83	90	85	81	87	83	80	84	81	78	76		
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66		
4	87	77	69	63	85	75	68	63	73	67	62	71	65	61	69	64	60	58		
5	81	70	61	56	79	68	61	55	66	60	55	65	59	54	63	58	54	52		
6	75	63	55	49	74	62	55	49	61	54	49	59	53	48	58	52	48	46		
7	70	58	50	44	69	57	50	44	56	49	44	54	48	44	53	48	43	42		
8	66	53	46	40	64	53	45	40	51	45	40	50	44	40	49	44	39	38		
9	62	49	42	37	60	49	42	37	48	41	36	47	41	36	46	40	36	34		
10	58	46	38	34	57	45	38	33	44	38	33	43	37	33	43	37	33	31		

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	61388	61388	61388
5°	62712	61369	60268
10°	64628	60798	58755
15°	66675	59989	57305
20°	67731	57738	54972
25°	66621	54312	51820
30°	63427	50350	48413
35°	57842	45461	44738
40°	50573	40834	40612
45°	43516	35934	36771
50°	37832	31308	31965
55°	33041	27488	27784
60°	29340	23825	21807
65°	26203	20041	16681
70°	23049	16429	13977
75°	19762	12942	13302
80°	15943	11113	13038
85°	10567	9624	11573

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582089

CATALOG NUMBER: HCC6W25D010MB-HM60525930-61WWWB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	106.0	4.8
10°-20°	301.8	13.8
20°-30°	430.8	19.6
30°-40°	451.3	20.6
40°-50°	380.0	17.3
50°-60°	270.4	12.3
60°-70°	158.3	7.2
70°-80°	74.9	3.4
80°-90°	19.3	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	838.7	38.2
0°-40°	1290.0	58.8
0°-60°	1940.4	88.5
0°-90°	2192.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2192.9	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1120	1120	1120	1120	1120	
5°	1140	1130	1115	1100	1095	109
15°	1175	1132	1057	1014	1010	332
25°	1101	1023	898	855	857	504
35°	864	792	679	656	668	537
45°	561	520	464	465	474	436
55°	346	317	288	288	291	312
65°	202	179	154	130	129	201
75°	93	78	61	60	63	100
85°	17	14	15	18	18	22
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582089

CATALOG NUMBER: HCC6W25D010MB-HM60525930-61WWWB

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°
0°	1119.8	1119.8	1119.8	1119.8	1119.8	1119.8	1119.8	1119.8	1119.8
2.5°	1121.3	1121.3	1119.8	1118.2	1115.2	1110.5	1107.5	1104.4	1104.4
5°	1139.6	1136.6	1130.5	1122.8	1115.2	1106.0	1099.9	1095.2	1095.2
7.5°	1154.9	1148.9	1136.6	1122.8	1109.0	1096.8	1086.1	1080.0	1078.5
10°	1161.0	1153.4	1135.1	1113.7	1092.2	1075.4	1063.2	1055.5	1055.5
12.5°	1167.2	1158.0	1133.5	1102.9	1075.4	1052.4	1040.2	1034.1	1032.6
15°	1174.8	1162.5	1132.0	1093.7	1057.0	1031.0	1014.2	1009.7	1009.7
17.5°	1174.8	1159.5	1121.3	1073.8	1028.0	998.9	983.6	979.0	980.6
20°	1161.0	1144.2	1098.4	1040.2	989.7	959.2	943.9	940.8	942.3
22.5°	1135.1	1115.2	1063.2	1000.4	945.4	913.2	899.5	899.5	897.9
25°	1101.4	1080.0	1023.3	957.5	897.9	865.8	855.2	856.7	856.7
27.5°	1057.0	1035.6	979.0	908.7	849.0	816.8	809.2	812.3	813.8
30°	1002.0	979.0	919.3	850.5	795.4	763.3	758.7	763.3	764.8
32.5°	934.6	917.8	859.7	789.4	737.3	709.8	708.3	712.8	719.0
35°	864.3	845.9	792.4	728.1	679.3	656.2	656.2	663.8	668.5
37.5°	787.8	769.5	720.5	667.0	625.6	604.2	607.3	615.0	616.5
40°	706.7	692.9	651.7	605.8	570.6	553.7	558.3	566.0	567.5
42.5°	630.3	618.0	584.4	543.1	517.0	504.8	511.0	520.1	523.1
45°	561.3	547.7	520.1	484.9	463.5	457.3	465.0	471.1	474.3
47.5°	498.7	486.4	463.5	431.4	416.1	413.0	420.6	423.8	426.8
50°	443.6	431.4	408.5	379.4	367.1	367.1	373.3	376.3	374.8
52.5°	390.1	379.4	358.0	333.4	325.8	325.8	330.4	331.9	335.1
55°	345.7	335.1	316.6	293.7	287.6	284.6	287.6	287.6	290.7
57.5°	304.4	295.2	278.4	257.0	249.3	246.3	244.7	243.2	246.3
60°	267.6	260.0	241.7	223.3	217.3	209.6	203.5	197.3	198.9
62.5°	234.1	226.4	209.6	191.2	185.1	174.4	166.8	159.1	162.1
65°	202.0	194.2	178.9	163.6	154.5	142.2	130.1	125.4	128.6
67.5°	172.9	166.8	151.5	136.2	128.6	114.8	102.5	102.5	104.0
70°	143.8	137.7	125.4	111.6	102.5	90.2	85.7	87.2	87.2
72.5°	117.8	113.1	101.0	88.7	79.6	71.9	71.9	73.4	74.9
75°	93.3	90.2	78.1	67.3	61.1	56.6	59.6	61.1	62.8
77.5°	71.9	67.3	58.1	50.5	45.9	47.4	50.5	52.0	53.5
80°	50.5	49.0	41.3	36.7	35.2	36.7	39.7	41.3	41.3
82.5°	32.1	30.6	26.1	24.4	24.4	26.1	29.1	29.1	29.1
85°	16.8	15.3	13.8	13.8	15.3	16.8	18.4	18.4	18.4
87.5°	6.1	4.6	6.1	6.1	7.6	7.6	7.6	7.6	7.6
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



— 0°-180° - - 45°-225° - - - 90°-270°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)