

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P582086

Luminaire Tested: **HCC6W25D010SL-HM60525930-61WDWB**

Issue Date: 9/16/2021

Test Information

Test Method: LM-41-14
Report Number: P582086
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2105-241-10)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 9/16/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC6W25D010SL-HM60525930-61WDWB
Description: HALO COMMERCIAL 6" ROUND, NEW CONSTRUCTION FRAME, WITH 6" WIDE DISTRIBUTION, WHITE BAFFLE TRIM
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2407.1 lumens
Efficiency: N/A
Efficacy: 89.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.05
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct


Input Watts (W): 26.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P582086

CATALOG NUMBER: HCC6W25D010SL-HM60525930-61WDWB

Luminous Intensity Polar Plot

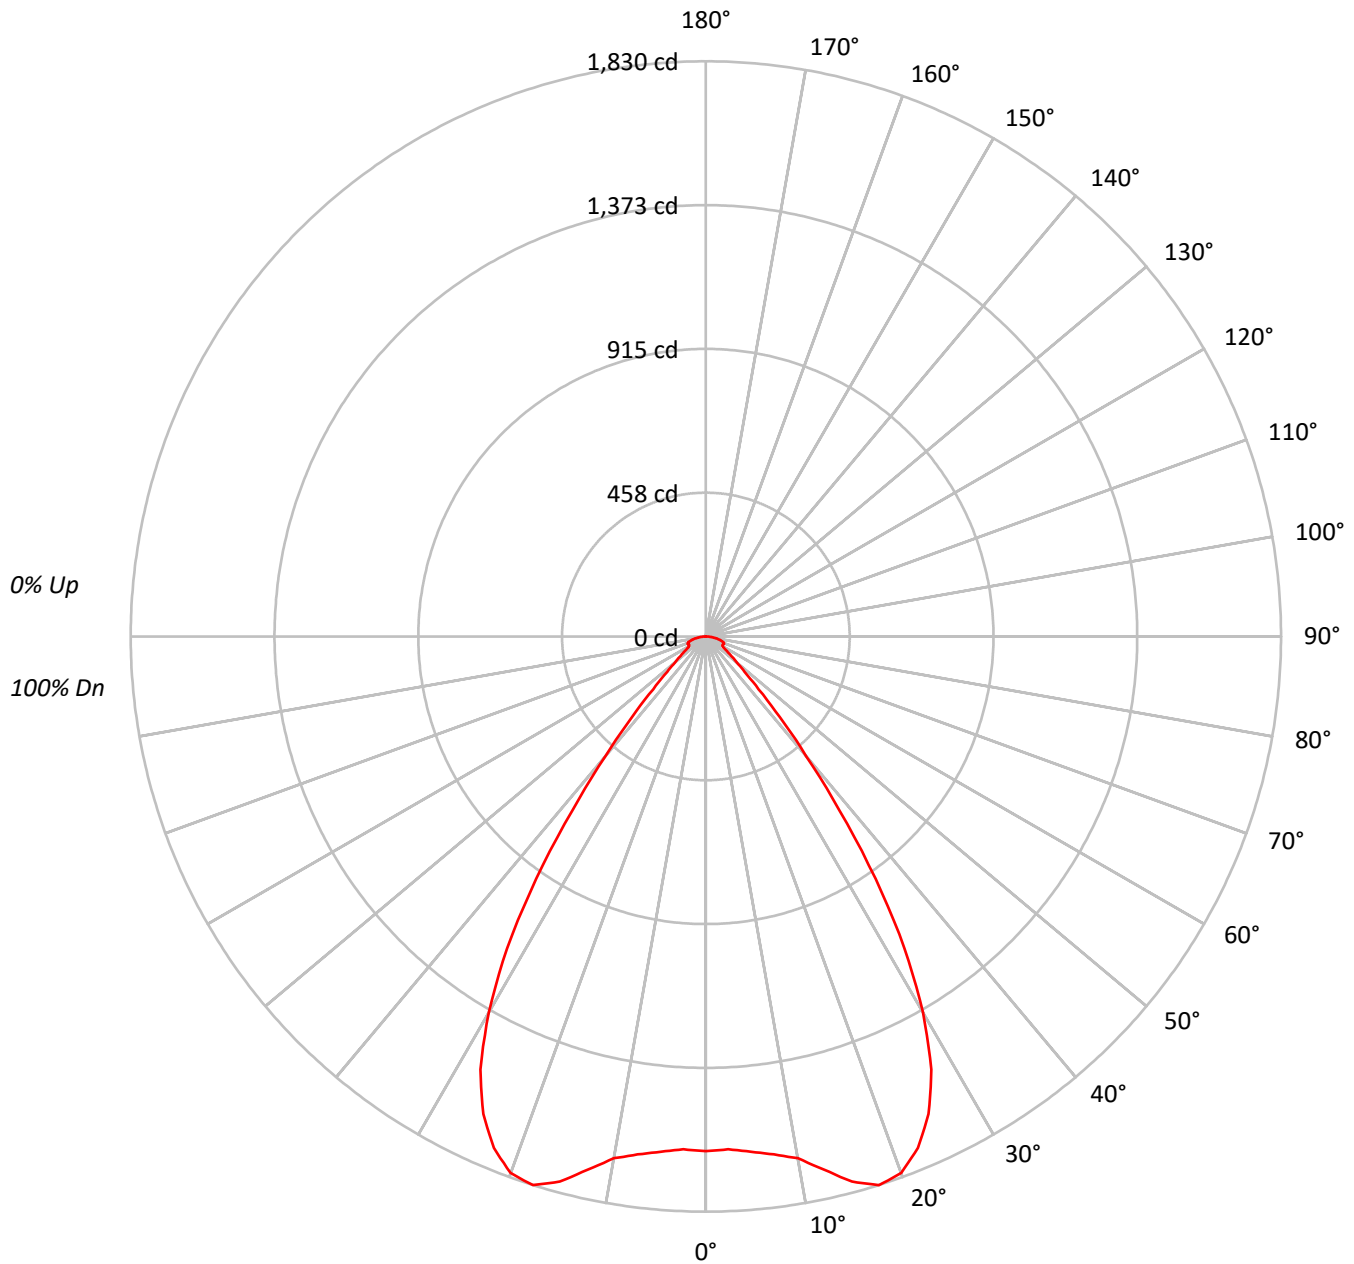

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P582086

CATALOG NUMBER: HCC6W25D010SL-HM60525930-61WDWB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	112	109	106	103	110	107	104	102	103	100	98	99	97	95	95	94	93	91		
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	86	84	82		
3	99	92	86	81	97	90	85	81	88	83	79	85	81	78	83	80	77	75		
4	93	85	78	73	91	83	78	73	81	76	72	79	75	71	77	73	70	69		
5	88	78	72	67	86	77	71	66	75	70	66	74	69	65	72	68	65	63		
6	83	73	66	61	81	72	66	61	70	65	60	69	64	60	67	63	60	58		
7	78	68	61	56	77	67	61	56	66	60	56	64	59	55	63	59	55	54		
8	74	63	57	52	73	63	56	52	61	56	52	60	55	51	59	55	51	50		
9	70	59	53	48	69	59	52	48	58	52	48	57	51	48	56	51	48	46		
10	66	56	49	45	65	55	49	45	54	48	45	53	48	44	53	48	44	43		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	89779
5°	90540
10°	93808
15°	101890
20°	105983
25°	101371
30°	87488
35°	62995
40°	35488
45°	18390
50°	10968
55°	7904
60°	6721
65°	7731
70°	9825
75°	10379
80°	10165
85°	9624



TEST NUMBER: P582086

CATALOG NUMBER: HCC6W25D010SL-HM60525930-61WDWB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	158.3	6.6
10°-20°	506.4	21.0
20°-30°	756.8	31.4
30°-40°	578.5	24.0
40°-50°	202.1	8.4
50°-60°	77.0	3.2
60°-70°	60.4	2.5
70°-80°	51.1	2.1
80°-90°	16.4	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1421.5	59.1
0°-40°	2000.1	83.1
0°-60°	2279.2	94.7
0°-90°	2407.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2407.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1638	
5°	1645	158
15°	1795	506
25°	1676	757
35°	941	579
45°	237	202
55°	83	77
65°	60	60
75°	49	51
85°	15	16
90°	0	



TEST NUMBER: P582086

CATALOG NUMBER: HCC6W25D010SL-HM60525930-61WDWB

CANDELA DISTRIBUTION (FULL):

0°	
0°	1637.7
2.5°	1633.0
5°	1645.3
7.5°	1662.2
10°	1685.2
12.5°	1737.2
15°	1795.3
17.5°	1830.5
20°	1816.7
22.5°	1761.7
25°	1675.9
27.5°	1553.5
30°	1382.1
32.5°	1176.9
35°	941.3
37.5°	697.9
40°	495.9
42.5°	347.5
45°	237.2
47.5°	166.8
50°	128.6
52.5°	101.0
55°	82.7
57.5°	67.3
60°	61.3
62.5°	59.6
65°	59.6
67.5°	62.8
70°	61.3
72.5°	56.6
75°	49.0
77.5°	41.3
80°	32.2
82.5°	22.9
85°	15.3
87.5°	6.1
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)