

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584395

Luminaire Tested: **HCC8W35D010MW-HM82555830-81RWWC**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584395
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-14)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W35D010MW-HM82555830-81RWWC
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WALLWASH DISTRIBUTION, SPECULAR TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3712.9 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.15 / 1.08 / 1.17
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

Luminous Intensity Polar Plot

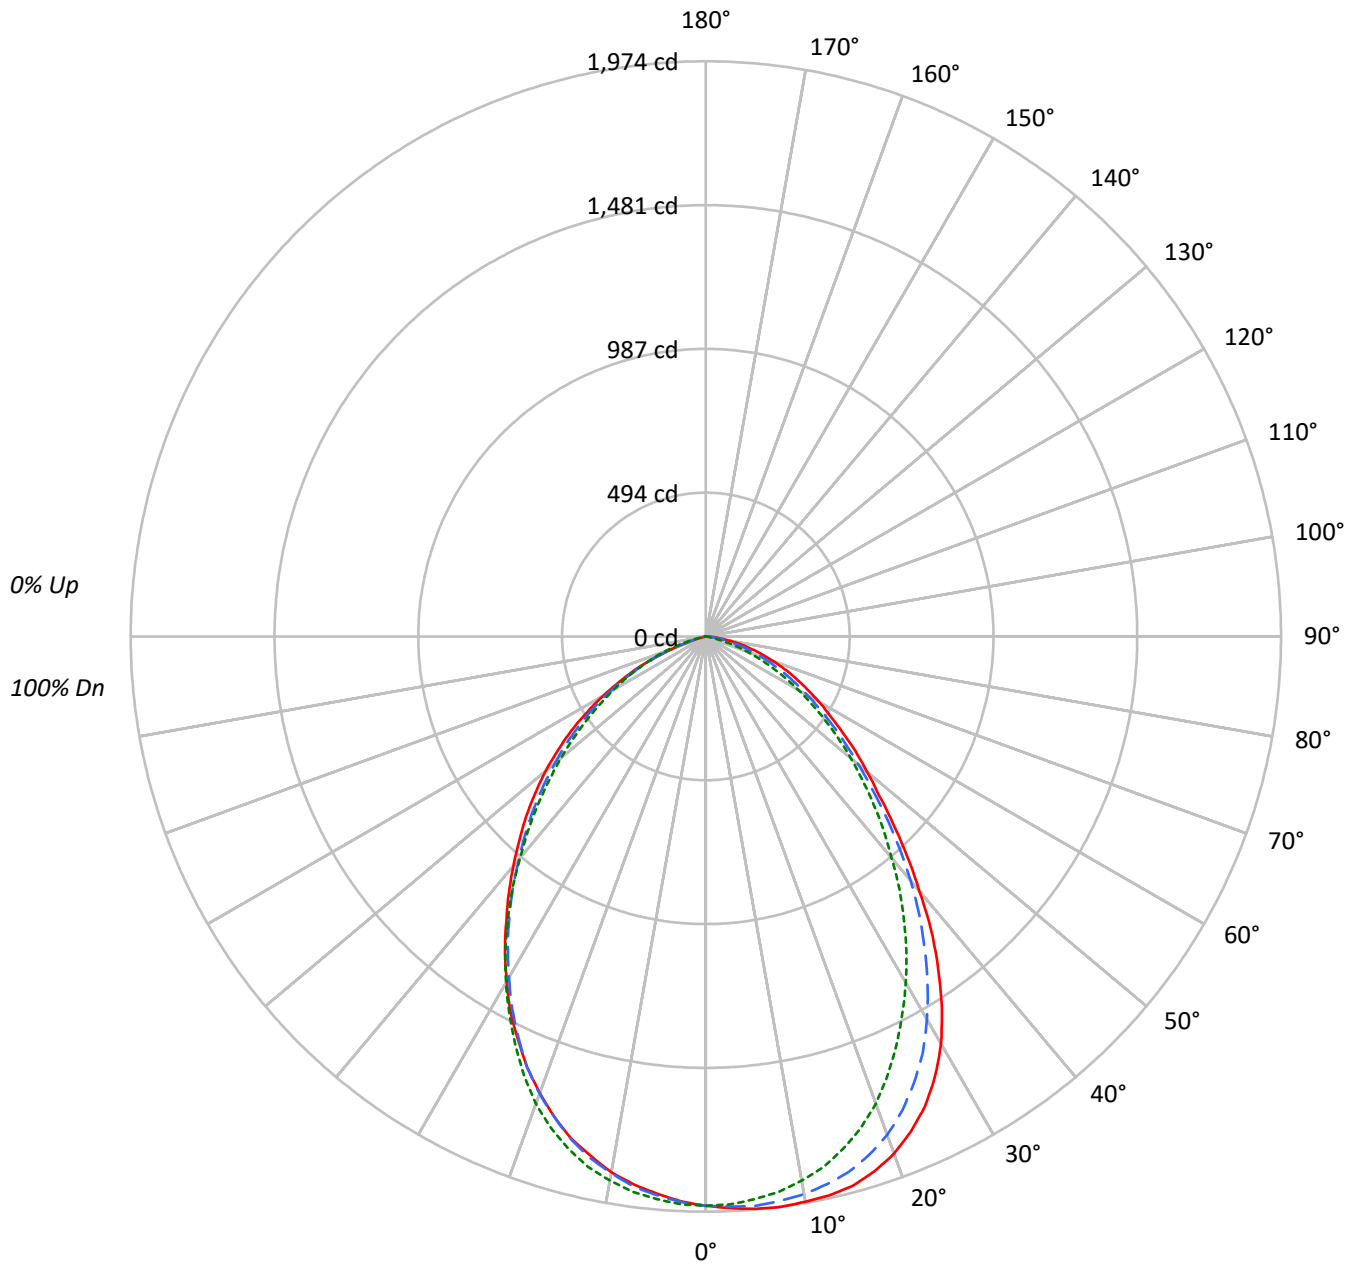

TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	111	107	104	101	108	105	102	99	101	98	96		97	95	93		93
2	103	96	90	85	100	94	89	84	91	86	82		87	84	81		84
3	95	86	79	73	93	84	78	73	82	76	72		79	74	70		76
4	88	77	70	64	86	76	69	64	74	68	63		72	66	62		69
5	81	70	62	56	80	69	62	56	67	61	56		65	59	55		63
6	76	64	56	50	74	63	55	50	61	55	50		60	54	49		58
7	71	59	51	45	69	58	50	45	56	50	45		55	49	44		54
8	66	54	46	41	65	53	46	41	52	45	40		51	45	40		50
9	62	50	42	37	61	49	42	37	48	42	37		47	41	37		46
10	58	46	39	34	57	46	39	34	45	38	34		44	38	34		43

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°
0°	60242	60242	60242
5°	61038	59986	59423
10°	61663	59374	58478
15°	62281	58121	56956
20°	61968	55976	54693
25°	60522	52625	51917
30°	57487	48849	48664
35°	52333	44574	44966
40°	45881	39896	41365
45°	39584	35489	37992
50°	34660	31154	34406
55°	30709	26779	30289
60°	27673	22523	25088
65°	24932	18073	19219
70°	21873	13163	10585
75°	18646	6839	2800
80°	14366	1847	462
85°	9234	0	0



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.3	5.0
10°-20°	518.2	14.0
20°-30°	735.5	19.8
30°-40°	774.2	20.9
40°-50°	658.6	17.7
50°-60°	475.9	12.8
60°-70°	270.7	7.3
70°-80°	85.3	2.3
80°-90°	10.4	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1437.9	38.7
0°-40°	2212.1	59.6
0°-60°	3346.6	90.1
0°-90°	3712.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3712.9	100.0

CANDELA DISTRIBUTION:

	0°	45°	90°	135°	180°	Flux
0°	1954	1954	1954	1954	1954	
5°	1972	1961	1938	1925	1920	188
15°	1951	1902	1821	1787	1784	549
25°	1779	1690	1547	1521	1526	815
35°	1390	1309	1184	1176	1194	865
45°	908	874	814	835	871	706
55°	571	530	498	527	563	515
65°	342	295	248	245	263	339
75°	156	120	57	26	24	168
85°	26	16	0	0	0	34
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6
2.5°	1964.0	1966.6	1961.4	1961.4	1966.6	1961.4	1964.0	1964.0	1961.4	1961.4	1958.8
5°	1971.9	1969.3	1969.3	1969.3	1971.9	1966.6	1964.0	1966.6	1961.4	1961.4	1961.4
7.5°	1974.4	1974.4	1971.9	1969.3	1969.3	1969.3	1966.6	1964.0	1961.4	1956.2	1953.6
10°	1969.3	1969.3	1971.9	1966.6	1966.6	1961.4	1961.4	1956.2	1956.2	1950.9	1943.2
12.5°	1964.0	1961.4	1961.4	1956.2	1956.2	1950.9	1950.9	1943.2	1940.5	1932.7	1924.9
15°	1950.9	1948.4	1943.2	1940.5	1937.9	1935.4	1930.1	1927.5	1919.7	1909.3	1901.5
17.5°	1924.9	1922.3	1919.7	1914.5	1909.3	1906.6	1904.0	1896.2	1885.8	1878.0	1864.9
20°	1888.4	1885.8	1885.8	1878.0	1875.3	1867.6	1864.9	1854.5	1846.6	1831.0	1820.6
22.5°	1838.8	1841.4	1836.2	1831.0	1825.8	1818.0	1812.7	1802.3	1789.2	1773.6	1760.6
25°	1778.8	1781.4	1776.3	1771.0	1763.2	1757.9	1752.8	1737.1	1724.0	1705.8	1690.1
27.5°	1703.2	1703.2	1703.2	1697.9	1685.0	1682.4	1677.1	1661.5	1643.2	1627.6	1611.9
30°	1614.5	1611.9	1611.9	1604.1	1598.9	1588.4	1580.6	1567.6	1554.5	1536.3	1518.0
32.5°	1507.6	1510.2	1502.4	1497.1	1489.4	1489.4	1478.9	1468.5	1452.8	1434.6	1416.3
35°	1390.2	1392.8	1387.6	1385.0	1371.9	1369.3	1366.7	1353.7	1343.2	1330.3	1309.3
37.5°	1270.2	1267.6	1265.0	1265.0	1257.2	1251.9	1246.8	1239.0	1223.3	1212.9	1202.4
40°	1139.8	1139.8	1139.8	1137.3	1134.6	1129.4	1126.7	1121.6	1111.1	1100.7	1092.8
42.5°	1022.5	1022.5	1019.9	1017.2	1012.0	1014.6	1009.4	1004.2	993.7	986.0	980.7
45°	907.7	907.7	907.7	910.2	905.1	897.3	897.3	892.0	886.8	881.6	873.8
47.5°	805.9	813.8	808.5	805.9	808.5	798.1	798.1	793.0	787.7	782.5	772.0
50°	722.5	722.5	722.5	717.2	714.6	714.6	706.8	701.7	699.0	693.8	683.3
52.5°	646.8	641.6	641.6	639.0	636.4	631.2	631.2	626.0	615.5	610.4	602.5
55°	571.2	571.2	568.6	565.9	563.4	560.8	558.1	550.4	545.1	537.3	529.5
57.5°	503.4	508.7	506.0	500.8	495.6	495.6	490.3	485.2	477.3	469.5	461.7
60°	448.7	446.0	446.0	443.4	438.2	435.6	433.0	425.2	417.3	409.5	401.7
62.5°	391.3	391.3	391.3	386.0	380.8	378.2	375.6	370.4	360.0	352.1	346.9
65°	341.7	339.0	336.5	333.9	331.2	326.0	323.5	318.2	310.4	302.6	294.7
67.5°	292.1	289.6	289.6	286.9	279.1	276.5	276.5	268.6	260.8	253.0	245.2
70°	242.6	242.6	242.6	237.3	234.7	232.2	229.5	224.3	216.5	208.7	200.8
72.5°	200.8	198.3	198.3	195.6	187.8	185.2	182.6	177.3	169.5	164.4	159.1
75°	156.5	156.5	153.9	151.3	148.7	146.0	143.4	138.2	130.5	122.6	120.0
77.5°	120.0	117.4	117.4	114.8	109.5	107.0	107.0	101.7	93.9	88.7	83.5
80°	80.9	83.5	80.9	78.2	75.6	73.1	70.4	67.8	62.7	57.4	52.1
82.5°	49.6	52.1	49.6	49.6	47.0	44.3	44.3	39.2	36.5	33.9	31.3
85°	26.1	26.1	26.1	26.1	23.5	23.5	23.5	20.8	18.2	15.7	15.7
87.5°	7.8	10.4	7.8	7.8	7.8	7.8	7.8	7.8	5.3	5.3	5.3
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°	95°
0°	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6
2.5°	1961.4	1958.8	1956.2	1956.2	1956.2	1956.2	1956.2	1953.6	1950.9	1950.9	1950.9
5°	1956.2	1956.2	1956.2	1953.6	1950.9	1950.9	1945.8	1943.2	1940.5	1937.9	1935.4
7.5°	1950.9	1945.8	1943.2	1940.5	1937.9	1937.9	1932.7	1927.5	1927.5	1922.3	1917.0
10°	1935.4	1932.7	1927.5	1922.3	1919.7	1917.0	1911.9	1904.0	1901.5	1896.2	1891.0
12.5°	1917.0	1911.9	1906.6	1896.2	1893.6	1891.0	1880.5	1872.7	1867.6	1864.9	1851.9
15°	1893.6	1883.1	1875.3	1862.3	1859.7	1854.5	1846.6	1838.8	1828.4	1820.6	1815.3
17.5°	1851.9	1841.4	1828.4	1815.3	1810.2	1810.2	1797.1	1786.7	1773.6	1768.4	1757.9
20°	1802.3	1789.2	1778.8	1763.2	1755.3	1747.5	1739.7	1724.0	1713.6	1705.8	1692.8
22.5°	1744.9	1726.7	1713.6	1697.9	1685.0	1677.1	1664.0	1651.1	1638.0	1630.1	1619.7
25°	1671.9	1656.2	1635.4	1619.7	1611.9	1601.5	1585.8	1572.7	1559.8	1546.7	1541.5
27.5°	1591.1	1570.2	1551.9	1533.7	1525.9	1518.0	1499.8	1484.1	1473.7	1460.6	1455.5
30°	1502.4	1481.4	1460.6	1445.0	1437.1	1424.1	1413.6	1395.4	1382.4	1371.9	1358.9
32.5°	1400.6	1385.0	1366.7	1343.2	1338.0	1327.6	1311.9	1304.1	1288.4	1280.7	1270.2
35°	1291.1	1280.7	1262.5	1244.1	1236.3	1231.1	1218.0	1202.4	1192.0	1184.1	1179.0
37.5°	1186.7	1173.7	1155.5	1142.4	1137.3	1129.4	1113.8	1105.9	1095.5	1090.3	1079.9
40°	1074.6	1061.5	1048.5	1040.7	1032.9	1027.6	1017.2	1009.4	999.0	991.1	988.6
42.5°	965.1	957.2	946.8	936.4	933.7	925.9	920.7	912.9	905.1	902.5	894.7
45°	865.9	858.1	847.7	837.3	834.6	829.4	826.9	819.0	813.8	813.8	813.8
47.5°	766.8	759.1	748.6	743.4	746.0	735.6	735.6	732.9	727.7	727.7	730.3
50°	678.2	667.8	665.1	659.9	654.7	649.4	652.1	644.3	644.3	649.4	646.8
52.5°	594.7	584.3	581.6	576.5	573.8	573.8	571.2	571.2	568.6	571.2	571.2
55°	519.1	511.2	506.0	500.8	498.1	498.1	498.1	495.6	493.0	498.1	500.8
57.5°	451.3	448.7	443.4	435.6	433.0	430.3	427.8	427.8	427.8	427.8	430.3
60°	391.3	386.0	380.8	372.9	372.9	370.4	367.8	365.2	365.2	365.2	365.2
62.5°	339.0	331.2	323.5	318.2	315.6	313.0	310.4	305.1	305.1	305.1	305.1
65°	286.9	279.1	273.9	268.6	263.4	263.4	258.2	255.7	250.4	247.7	242.6
67.5°	237.3	232.2	226.9	219.1	216.5	213.8	208.7	206.1	198.3	195.6	193.0
70°	193.0	185.2	179.9	174.8	172.2	166.9	161.7	156.5	151.3	146.0	140.9
72.5°	151.3	143.4	138.2	133.0	127.8	127.8	120.0	114.8	107.0	101.7	93.9
75°	112.1	104.3	99.1	91.3	88.7	86.0	78.2	73.1	65.2	57.4	52.1
77.5°	75.6	70.4	65.2	57.4	52.1	52.1	44.3	39.2	33.9	26.1	23.5
80°	47.0	41.7	36.5	31.3	31.3	26.1	23.5	18.2	13.1	10.4	7.8
82.5°	26.1	23.5	20.8	15.7	15.7	13.1	10.4	7.8	5.3	2.6	2.6
85°	13.1	10.4	7.8	7.8	5.3	5.3	5.3	2.6	2.6	0.0	0.0
87.5°	5.3	2.6	2.6	2.6	2.6	2.6	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

CANDELA DISTRIBUTION (continued):

	100°	105°	110°	112.5°	115°	120°	125°	130°	135°	140°	145°
0°	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6
2.5°	1948.4	1948.4	1945.8	1945.8	1945.8	1943.2	1945.8	1943.2	1943.2	1943.2	1945.8
5°	1937.9	1932.7	1932.7	1930.1	1930.1	1927.5	1930.1	1927.5	1924.9	1922.3	1924.9
7.5°	1917.0	1911.9	1909.3	1906.6	1906.6	1906.6	1904.0	1901.5	1904.0	1896.2	1901.5
10°	1888.4	1885.8	1880.5	1878.0	1875.3	1878.0	1875.3	1870.1	1870.1	1870.1	1867.6
12.5°	1851.9	1846.6	1844.1	1841.4	1836.2	1836.2	1838.8	1833.7	1833.7	1828.4	1828.4
15°	1807.5	1802.3	1797.1	1797.1	1791.8	1791.8	1789.2	1789.2	1786.7	1784.1	1784.1
17.5°	1752.8	1744.9	1739.7	1742.4	1739.7	1737.1	1737.1	1731.8	1729.3	1731.8	1731.8
20°	1687.5	1682.4	1677.1	1679.7	1674.6	1671.9	1674.6	1666.7	1669.3	1669.3	1669.3
22.5°	1614.5	1611.9	1604.1	1604.1	1598.9	1596.2	1598.9	1598.9	1601.5	1598.9	1598.9
25°	1533.7	1528.4	1523.3	1523.3	1520.6	1518.0	1520.6	1523.3	1520.6	1523.3	1523.3
27.5°	1447.5	1439.8	1439.8	1434.6	1434.6	1437.1	1434.6	1437.1	1439.8	1439.8	1445.0
30°	1353.7	1351.1	1348.5	1345.8	1345.8	1348.5	1348.5	1348.5	1351.1	1356.3	1356.3
32.5°	1265.0	1259.8	1254.5	1254.5	1259.8	1257.2	1259.8	1259.8	1265.0	1265.0	1270.2
35°	1168.5	1168.5	1163.3	1165.9	1165.9	1165.9	1165.9	1171.2	1176.3	1179.0	1184.1
37.5°	1079.9	1072.0	1074.6	1074.6	1077.2	1074.6	1082.4	1082.4	1087.7	1087.7	1092.8
40°	983.3	983.3	986.0	983.3	986.0	986.0	991.1	996.4	999.0	1004.2	1006.8
42.5°	892.0	897.3	892.0	894.7	897.3	899.8	902.5	905.1	915.5	920.7	928.6
45°	808.5	811.2	813.8	816.4	813.8	819.0	821.6	826.9	834.6	837.3	839.9
47.5°	727.7	730.3	732.9	735.6	735.6	740.7	743.4	748.6	753.8	756.4	759.1
50°	649.4	654.7	657.3	657.3	659.9	665.1	670.3	670.3	675.6	683.3	686.0
52.5°	579.0	579.0	584.3	586.9	589.4	589.4	597.3	600.0	602.5	607.7	612.9
55°	500.8	508.7	511.2	511.2	516.5	521.6	524.2	526.9	526.9	537.3	537.3
57.5°	433.0	435.6	440.7	440.7	440.7	448.7	448.7	453.8	456.4	459.1	464.2
60°	365.2	370.4	370.4	372.9	370.4	375.6	378.2	383.4	386.0	388.6	391.3
62.5°	302.6	302.6	305.1	305.1	305.1	305.1	310.4	310.4	315.6	318.2	320.8
65°	242.6	242.6	242.6	242.6	242.6	242.6	242.6	242.6	245.2	245.2	250.4
67.5°	187.8	185.2	179.9	182.6	179.9	179.9	177.3	177.3	179.9	179.9	185.2
70°	135.6	133.0	127.8	127.8	125.2	122.6	120.0	117.4	114.8	114.8	114.8
72.5°	88.7	83.5	75.6	73.1	73.1	67.8	62.7	60.0	60.0	60.0	60.0
75°	44.3	39.2	33.9	31.3	31.3	26.1	28.6	26.1	26.1	26.1	26.1
77.5°	18.2	13.1	10.4	10.4	10.4	7.8	7.8	7.8	7.8	7.8	7.8
80°	5.3	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
82.5°	2.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584395

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81RWWC

CANDELA DISTRIBUTION (continued):

	150°	155°	157.5°	160°	165°	170°	175°	180°
0°	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6	1953.6
2.5°	1943.2	1943.2	1937.9	1940.5	1940.5	1940.5	1940.5	1940.5
5°	1919.7	1922.3	1919.7	1922.3	1922.3	1919.7	1919.7	1919.7
7.5°	1896.2	1898.8	1896.2	1898.8	1898.8	1898.8	1896.2	1896.2
10°	1867.6	1867.6	1867.6	1867.6	1867.6	1864.9	1867.6	1867.6
12.5°	1828.4	1828.4	1828.4	1831.0	1831.0	1828.4	1828.4	1825.8
15°	1786.7	1781.4	1784.1	1786.7	1784.1	1784.1	1784.1	1784.1
17.5°	1729.3	1731.8	1729.3	1729.3	1729.3	1729.3	1731.8	1729.3
20°	1669.3	1669.3	1671.9	1669.3	1669.3	1669.3	1669.3	1666.7
22.5°	1601.5	1598.9	1598.9	1601.5	1601.5	1598.9	1601.5	1601.5
25°	1525.9	1528.4	1525.9	1525.9	1528.4	1528.4	1528.4	1525.9
27.5°	1445.0	1447.5	1450.2	1447.5	1447.5	1447.5	1450.2	1452.8
30°	1361.5	1366.7	1361.5	1361.5	1366.7	1364.2	1366.7	1366.7
32.5°	1272.9	1280.7	1275.4	1280.7	1280.7	1283.3	1280.7	1283.3
35°	1184.1	1192.0	1192.0	1192.0	1194.5	1197.2	1197.2	1194.5
37.5°	1100.7	1103.2	1103.2	1108.5	1111.1	1113.8	1113.8	1111.1
40°	1014.6	1019.9	1022.5	1022.5	1022.5	1027.6	1032.9	1027.6
42.5°	931.2	933.7	936.4	936.4	941.6	944.1	946.8	946.8
45°	850.3	855.5	858.1	860.8	863.3	868.6	865.9	871.2
47.5°	766.8	774.6	777.3	779.9	785.0	787.7	790.3	793.0
50°	691.2	696.4	696.4	701.7	709.5	709.5	714.6	717.2
52.5°	615.5	618.2	620.8	623.3	628.6	633.9	633.9	639.0
55°	542.6	545.1	545.1	547.7	550.4	560.8	563.4	563.4
57.5°	466.9	466.9	472.1	474.6	477.3	482.6	482.6	482.6
60°	393.9	396.4	396.4	399.1	401.7	406.8	409.5	406.8
62.5°	320.8	323.5	323.5	326.0	331.2	333.9	331.2	331.2
65°	253.0	255.7	255.7	258.2	263.4	263.4	260.8	263.4
67.5°	185.2	185.2	185.2	185.2	185.2	185.2	185.2	185.2
70°	117.4	114.8	112.1	114.8	114.8	114.8	112.1	117.4
72.5°	57.4	60.0	60.0	60.0	60.0	60.0	60.0	57.4
75°	26.1	26.1	23.5	23.5	23.5	26.1	26.1	23.5
77.5°	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8
80°	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



— 0°-180° - - 45°-225° - - - 90°-270°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)