

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584394

Luminaire Tested: **HCC8W35D010MW-HM82555830-81PSMDW**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584394
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-12)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W35D010MW-HM82555830-81PSMDW
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" PLASTIC TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3000K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3877.3 lumens
Efficiency: N/A
Efficacy: 115.1 lumens/watt
Spacing Criteria (0/90/45): 1.06 / 1.06 / 0.97
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 33.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584394

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81PSMDW

Luminous Intensity Polar Plot

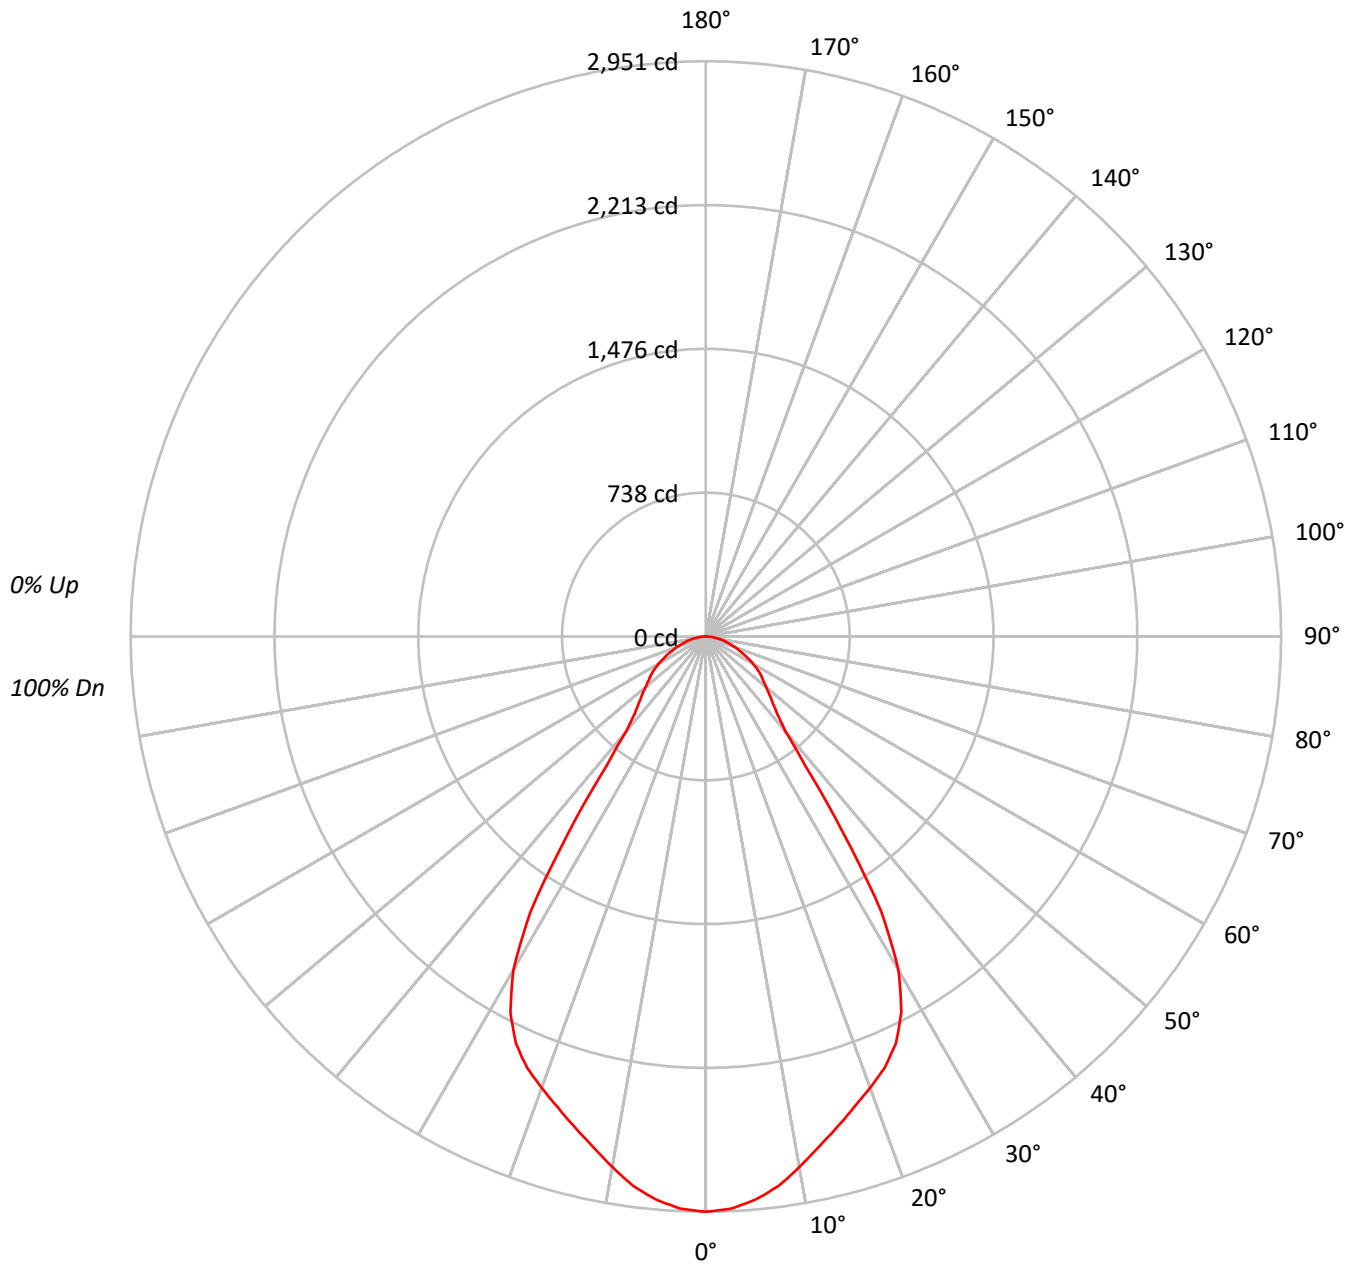

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584394

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81PSMDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	105	102	109	106	103	100	101	99	97	98	96	94	94	93	91	89		
2	104	98	92	88	102	96	91	87	92	88	85	89	86	83	86	84	81	79		
3	97	89	83	77	95	87	82	77	85	80	76	82	78	74	80	76	73	71		
4	91	81	74	69	89	80	74	69	78	72	68	76	71	67	74	70	66	64		
5	85	75	68	62	83	74	67	62	72	66	61	70	65	61	68	64	60	58		
6	80	69	62	57	78	68	61	56	67	61	56	65	60	56	64	59	55	53		
7	75	64	57	52	74	63	57	52	62	56	51	61	55	51	60	55	51	49		
8	71	60	53	48	70	59	52	48	58	52	47	57	51	47	56	51	47	45		
9	67	56	49	44	66	55	49	44	54	48	44	53	48	44	52	47	44	42		
10	64	52	46	41	62	52	45	41	51	45	41	50	45	41	49	44	41	39		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	91010
5°	89823
10°	86537
15°	83150
20°	80850
25°	78419
30°	70366
35°	46129
40°	25501
45°	21264
50°	19386
55°	18505
60°	17207
65°	15600
70°	14110
75°	12736
80°	11578
85°	11074



TEST NUMBER: P584394

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81PSMDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	272.6	7.0
10°-20°	734.8	19.0
20°-30°	1045.8	27.0
30°-40°	774.0	20.0
40°-50°	383.4	9.9
50°-60°	306.0	7.9
60°-70°	212.4	5.5
70°-80°	114.4	3.0
80°-90°	33.7	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2053.3	53.0
0°-40°	2827.3	72.9
0°-60°	3516.7	90.7
0°-90°	3877.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3877.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2951	
5°	2902	273
15°	2605	735
25°	2305	1046
35°	1225	774
45°	488	383
55°	344	306
65°	214	212
75°	107	114
85°	31	34
90°	0	



TEST NUMBER: P584394

CATALOG NUMBER: HCC8W35D010MW-HM82555830-81PSMDW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2951.4
2.5°	2938.3
5°	2901.8
7.5°	2844.5
10°	2763.7
12.5°	2680.3
15°	2604.6
17.5°	2531.6
20°	2463.8
22.5°	2396.0
25°	2304.8
27.5°	2171.9
30°	1976.2
32.5°	1676.5
35°	1225.4
37.5°	836.9
40°	633.5
42.5°	542.3
45°	487.6
47.5°	443.3
50°	404.1
52.5°	370.2
55°	344.2
57.5°	312.9
60°	279.0
62.5°	245.1
65°	213.8
67.5°	182.5
70°	156.5
72.5°	130.3
75°	106.9
77.5°	86.0
80°	65.2
82.5°	47.0
85°	31.3
87.5°	13.1
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)