

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584678

Luminaire Tested: **HCC8W45D010SL-HM82555835-81MDH**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584678
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-5)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W45D010SL-HM82555835-81MDH
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" MEDIUM DISTRIBUTION, HAZE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5034.8 lumens
Efficiency: N/A
Efficacy: 114.4 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.81
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 44
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584678

CATALOG NUMBER: HCC8W45D010SL-HM82555835-81MDH

Luminous Intensity Polar Plot

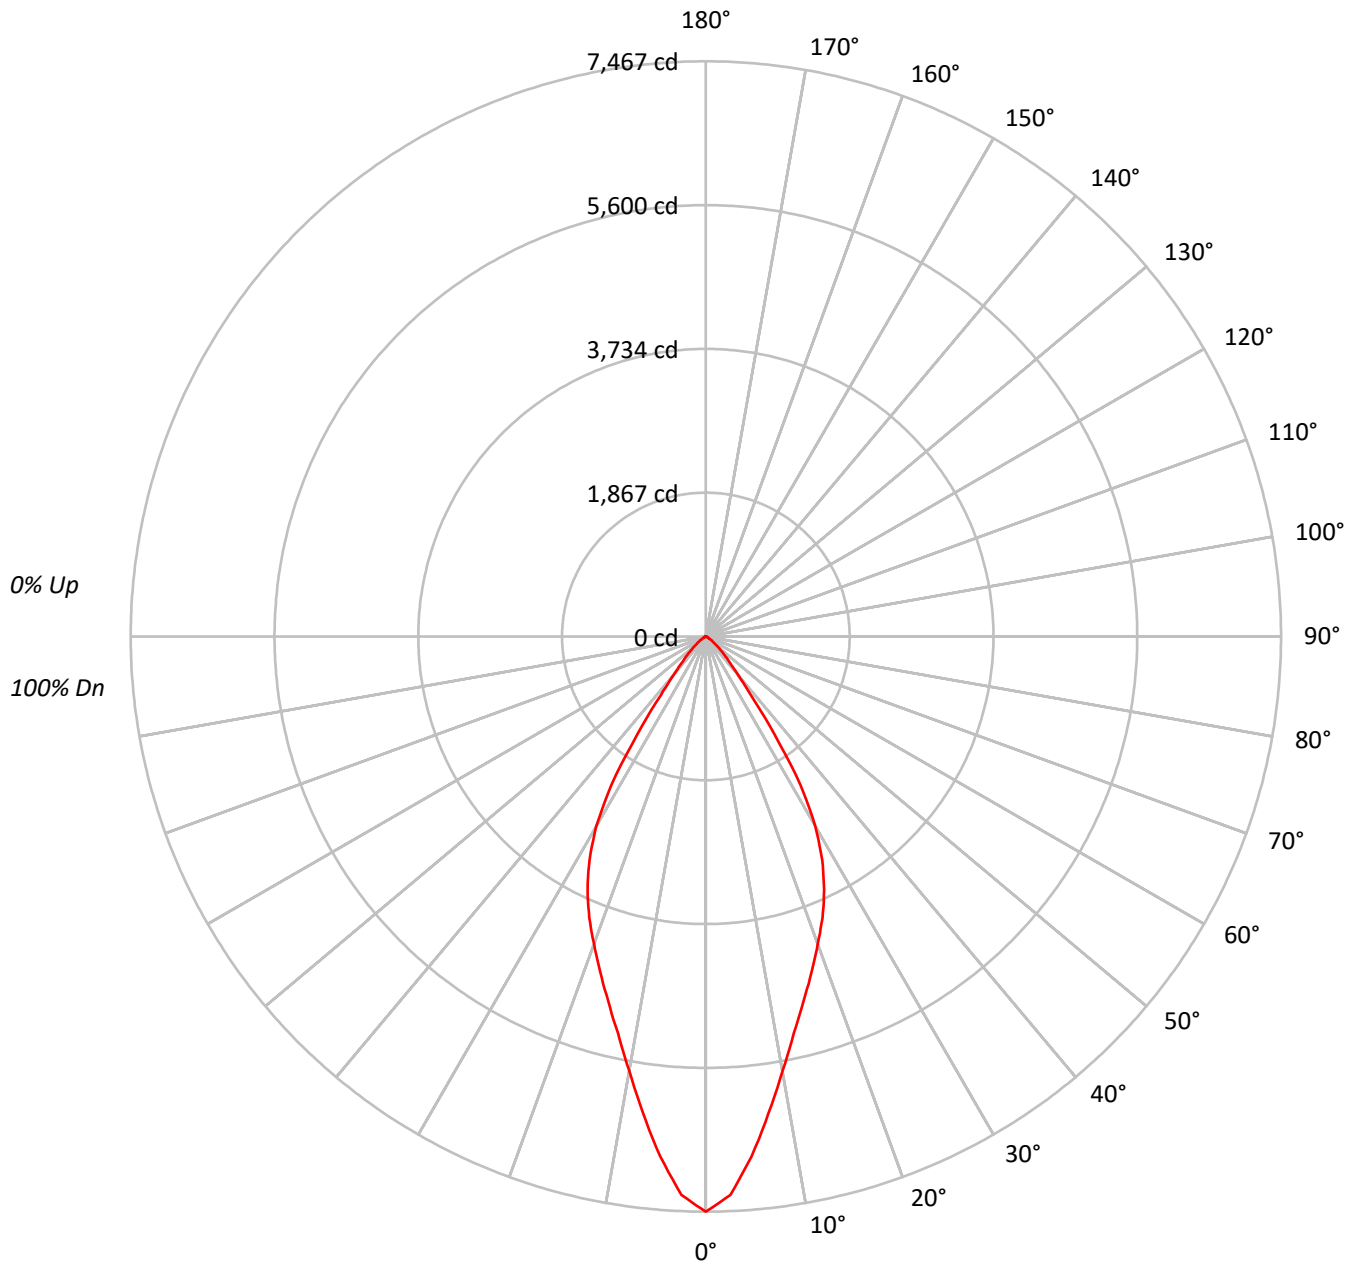

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584678

CATALOG NUMBER: HCC8W45D010SL-HM82555835-81MDH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	93	95	93	91	92	90	89	87		
3	103	96	91	87	101	95	90	87	92	88	85	90	87	84	88	85	83	81		
4	97	90	85	80	96	89	84	80	87	82	79	85	81	78	83	80	77	76		
5	93	84	79	74	91	83	78	74	82	77	73	80	76	73	78	75	72	71		
6	88	79	73	69	87	78	73	69	77	72	68	76	71	68	74	70	67	66		
7	84	75	69	64	82	74	68	64	73	68	64	71	67	64	70	66	63	62		
8	80	70	64	60	79	70	64	60	69	64	60	68	63	60	67	63	60	58		
9	76	67	61	57	75	66	61	57	65	60	57	64	60	56	63	59	56	55		
10	73	63	57	54	72	63	57	53	62	57	53	61	56	53	60	56	53	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	230261
5°	209832
10°	179280
15°	156348
20°	139350
25°	123610
30°	101209
35°	58119
40°	25791
45°	15015
50°	8664
55°	4946
60°	2732
65°	1737
70°	1226
75°	810
80°	604
85°	1203



TEST NUMBER: P584678

CATALOG NUMBER: HCC8W45D010SL-HM82555835-81MDH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	613.6	12.2
10°-20°	1376.6	27.3
20°-30°	1647.8	32.7
30°-40°	996.9	19.8
40°-50°	279.4	5.5
50°-60°	86.7	1.7
60°-70°	24.7	0.5
70°-80°	6.7	0.1
80°-90°	2.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3638.1	72.3
0°-40°	4635.0	92.1
0°-60°	5001.1	99.3
0°-90°	5034.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5034.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7467	
5°	6779	614
15°	4898	1377
25°	3633	1648
35°	1544	997
45°	344	279
55°	92	87
65°	24	25
75°	7	7
85°	3	2
90°	0	



TEST NUMBER: P584678

CATALOG NUMBER: HCC8W45D010SL-HM82555835-81MDH

CANDELA DISTRIBUTION (FULL):

	0°
0°	7467.2
2.5°	7255.9
5°	6778.8
7.5°	6240.2
10°	5725.6
12.5°	5275.8
15°	4897.5
17.5°	4563.4
20°	4246.5
22.5°	3953.4
25°	3633.0
27.5°	3271.8
30°	2842.4
32.5°	2286.9
35°	1543.9
37.5°	961.0
40°	640.7
42.5°	460.1
45°	344.3
47.5°	252.2
50°	180.6
52.5°	126.1
55°	92.0
57.5°	61.3
60°	44.3
62.5°	30.6
65°	23.8
67.5°	17.0
70°	13.6
72.5°	6.8
75°	6.8
77.5°	3.4
80°	3.4
82.5°	3.4
85°	3.4
87.5°	0.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)