

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO COMMERCIAL

Report Number: P584689

Luminaire Tested: **HCC8W45D010BZ-HM82555835-81WDW**

Issue Date: 10/21/2021

Test Information

Test Method: LM-41-14
Report Number: P584689
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2109-368-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 10/21/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: HALO COMMERCIAL
Catalog Number: HCC8W45D010BZ-HM82555835-81WDW
Description: HALO COMMERCIAL 8" ROUND, NEW CONSTRUCTION FRAME, WITH 8" WIDE DISTRIBUTION, WHITE TRIM
Light Source: (1) HIGH LUMEN LED 80CRI / 3500K CCT
CYLINDER
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5236.0 lumens
Efficiency: N/A
Efficacy: 119.0 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.06
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 44
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P584689

CATALOG NUMBER: HCC8W45D010BZ-HM82555835-81WDW

Luminous Intensity Polar Plot

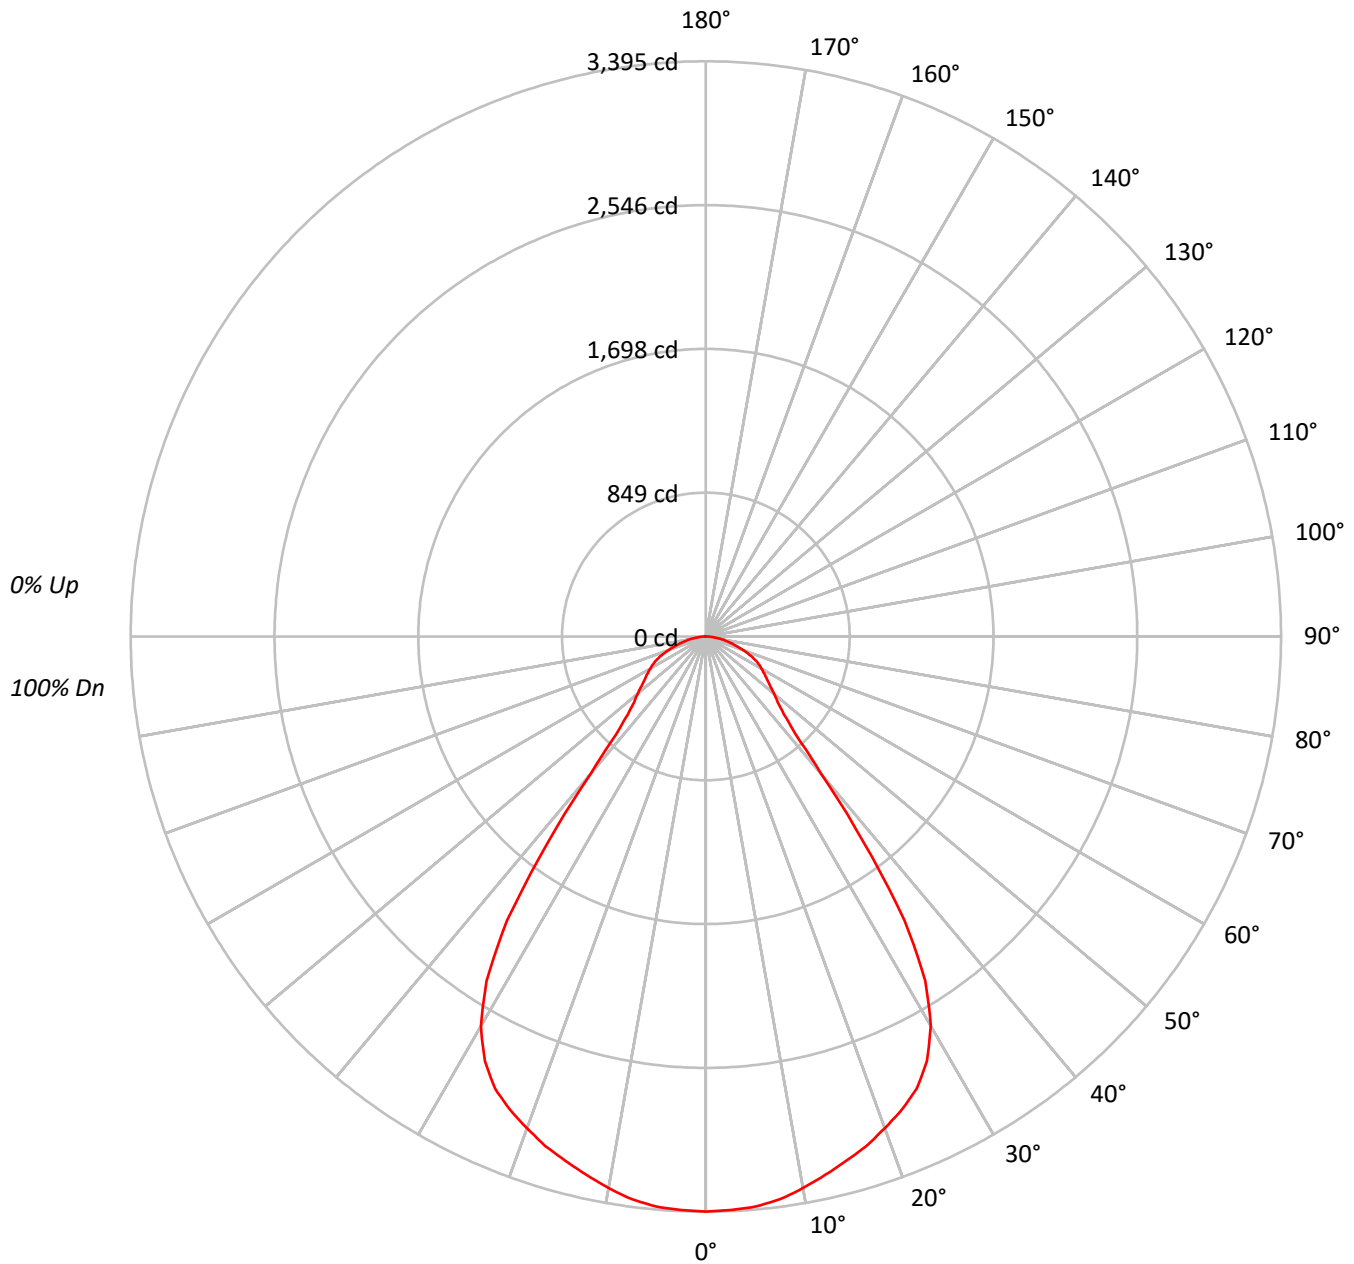

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



TEST NUMBER: P584689

CATALOG NUMBER: HCC8W45D010BZ-HM82555835-81WDW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	119	119	119	119		116	116	116	116		111	111	111		106	106	106		102	102	102
1	111	108	104	101		109	105	102	100		101	99	96		97	95	94		94	92	91
2	104	97	92	87		101	95	90	86		92	88	84		89	85	82		86	83	81
3	97	88	82	76		94	87	81	76		84	79	75		81	77	73		79	75	72
4	90	80	73	68		88	79	73	67		77	71	67		75	70	66		73	68	65
5	84	74	66	61		82	73	66	61		71	65	60		69	64	59		67	63	59
6	79	68	61	55		77	67	60	55		65	59	55		64	58	54		62	58	54
7	74	63	56	50		73	62	55	50		61	54	50		59	54	50		58	53	49
8	70	58	51	46		69	58	51	46		57	50	46		55	50	46		54	49	45
9	66	54	47	43		65	54	47	42		53	47	42		52	46	42		51	46	42
10	62	51	44	39		61	50	44	39		49	43	39		49	43	39		48	43	39

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	104680
5°	104554
10°	103521
15°	102278
20°	101330
25°	100194
30°	94539
35°	76982
40°	42532
45°	28390
50°	25181
55°	23634
60°	23331
65°	23123
70°	20899
75°	18682
80°	16355
85°	14471



TEST NUMBER: P584689

CATALOG NUMBER: HCC8W45D010BZ-HM82555835-81WDW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	320.1	6.1
10°-20°	904.6	17.3
20°-30°	1344.2	25.7
30°-40°	1210.5	23.1
40°-50°	536.7	10.2
50°-60°	397.4	7.6
60°-70°	309.1	5.9
70°-80°	167.6	3.2
80°-90°	45.9	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2568.9	49.1
0°-40°	3779.4	72.2
0°-60°	4713.5	90.0
0°-90°	5236.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5236.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3395	
5°	3378	320
15°	3204	905
25°	2945	1344
35°	2045	1211
45°	651	537
55°	440	397
65°	317	309
75°	157	168
85°	41	46
90°	0	



TEST NUMBER: P584689

CATALOG NUMBER: HCC8W45D010BZ-HM82555835-81WDW

CANDELA DISTRIBUTION (FULL):

0°	
0°	3394.7
2.5°	3387.9
5°	3377.7
7.5°	3350.4
10°	3306.1
12.5°	3255.0
15°	3203.8
17.5°	3152.7
20°	3087.9
22.5°	3023.2
25°	2944.8
27.5°	2825.5
30°	2655.1
32.5°	2409.7
35°	2045.0
37.5°	1526.9
40°	1056.6
42.5°	780.5
45°	651.0
47.5°	576.1
50°	524.9
52.5°	477.2
55°	439.6
57.5°	409.0
60°	378.3
62.5°	351.1
65°	316.9
67.5°	276.1
70°	231.8
72.5°	194.2
75°	156.8
77.5°	122.7
80°	92.1
82.5°	64.7
85°	40.9
87.5°	17.0
90°	0.0

Classified

Scaled Data Report

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269



Report Generated By 670245859 / DESKTOP-T8S5UU9

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



Classified

Cooper Lighting Solutions Photometric Lab

1121 Highway 74 South

Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)