

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: HALO

Report Number: P990877

Luminaire Tested: **ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K**

Issue Date: 5/13/2025

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P990877
 Test Lab: Cooper Lighting Solutions
 Issue Date: 5/13/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: HALO
 Catalog Number: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K
 Description: 4IN SQUARE ML FLEX ADJUSTABLE, SELECTABLE CCT, WITH 25D TIR, MATTE BLACK TRIM
 Light Source: (1) STANDARD SELECTABLE LUMEN LED 90CRI / 2700K CCT
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 879.1 lumens
 Efficiency: N/A
 Efficacy: 67.6 lumens/watt
 Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.56
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 13
 Input Voltage (V): NR
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P990877
CATALOG NUMBER: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K

Luminous Intensity Polar Plot

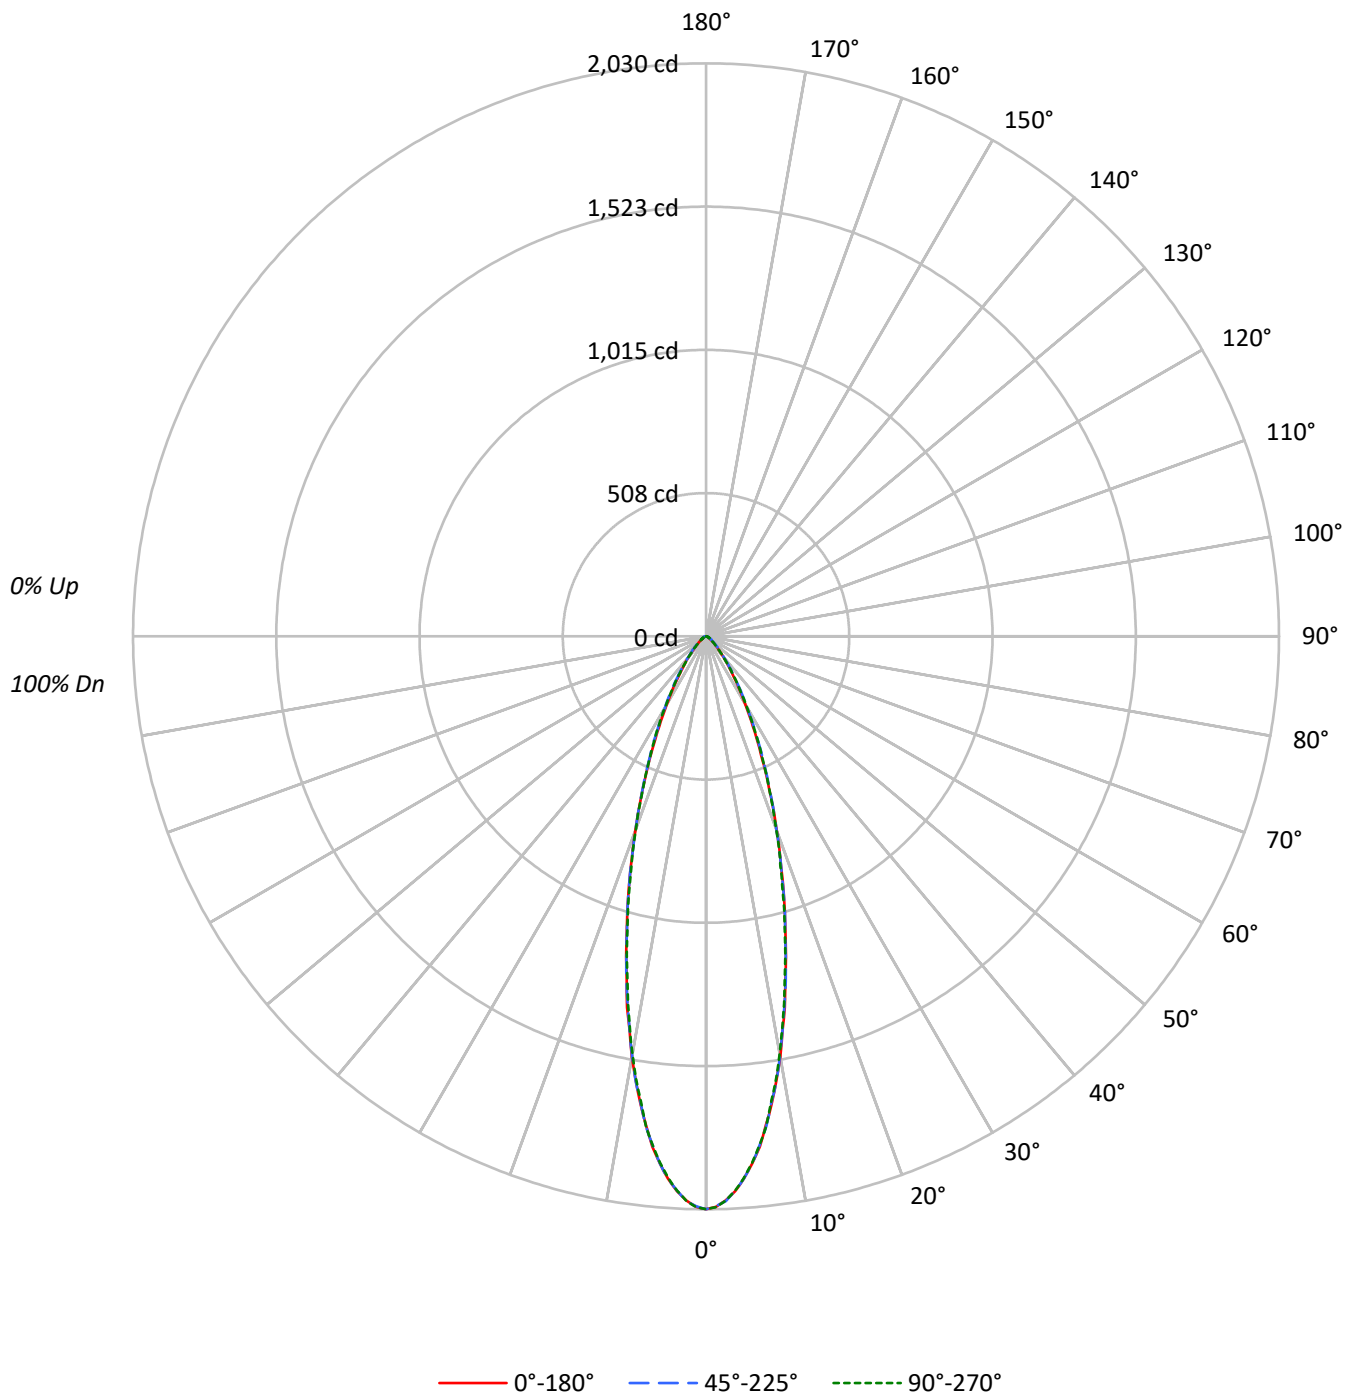

TEST NUMBER: P990877

CATALOG NUMBER: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	114	111	109	107	111	109	107	105	105	103	102		101	100	99		98
2	108	104	100	97	106	102	99	96	99	96	94		96	94	92		93
3	104	97	93	89	102	96	92	88	93	90	87		91	88	86		89
4	99	92	87	83	97	91	86	82	89	84	81		87	83	80		85
5	94	87	81	77	93	86	81	77	84	80	76		82	79	76		81
6	90	82	77	73	89	81	76	72	80	75	72		79	75	71		77
7	87	78	73	69	85	77	72	69	76	72	68		75	71	68		74
8	83	74	69	65	82	74	69	65	73	68	65		72	68	64		71
9	80	71	66	62	79	71	65	62	70	65	62		69	65	62		68
10	77	68	63	59	76	68	62	59	67	62	59		66	62	59		65

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	196618	196618	196618
5°	182384	182384	181995
10°	148775	148578	147693
15°	108848	108647	108146
20°	75588	75381	74866
25°	49180	50463	49822
30°	30885	32563	32227
35°	19159	20696	19986
40°	12267	13026	12140
45°	7672	8494	7398
50°	4823	5878	4823
55°	3378	4222	3547
60°	2713	3488	2906
65°	2521	2980	2521
70°	1983	2832	2266
75°	1497	2246	1497
80°	558	1116	558
85°	0	0	0

TEST NUMBER: P990877

CATALOG NUMBER: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	167.0	19.0
10°-20°	299.0	34.0
20°-30°	217.5	24.7
30°-40°	110.1	12.5
40°-50°	47.2	5.4
50°-60°	21.1	2.4
60°-70°	11.9	1.3
70°-80°	5.2	0.6
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	683.4	77.7
0°-40°	793.5	90.3
0°-60°	861.8	98.0
0°-90°	879.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	879.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2030	2030	2030	2030	2030	
5°	1876	1874	1876	1872	1872	167
15°	1085	1084	1083	1084	1078	300
25°	460	465	472	468	466	215
35°	162	166	175	173	169	106
45°	56	58	62	58	54	45
55°	20	22	25	23	21	19
65°	11	11	13	12	11	11
75°	4	5	6	5	4	4
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P990877

CATALOG NUMBER: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2029.6	2029.6	2029.6	2029.6	2029.6
1°	2021.6	2023.6	2019.6	2020.6	2022.6
2°	1999.6	2001.6	2002.6	1998.6	2000.6
3°	1968.5	1974.5	1966.5	1969.5	1966.5
4°	1926.5	1927.5	1926.5	1925.5	1923.5
5°	1875.5	1874.5	1875.5	1871.5	1871.5
6°	1818.5	1814.5	1813.5	1811.5	1812.5
7°	1744.5	1748.5	1749.5	1742.5	1748.5
8°	1672.5	1670.5	1666.5	1669.5	1662.5
9°	1592.4	1596.4	1595.4	1580.4	1586.4
10°	1512.4	1514.4	1510.4	1496.4	1501.4
11°	1421.4	1425.4	1420.4	1414.4	1415.4
12°	1344.4	1335.4	1335.4	1336.4	1329.4
13°	1249.3	1253.3	1255.3	1250.3	1239.3
14°	1170.3	1167.3	1166.3	1160.3	1161.3
15°	1085.3	1084.3	1083.3	1084.3	1078.3
16°	1010.3	1005.3	1011.3	1004.3	1002.3
17°	939.3	935.3	934.3	931.3	925.3
18°	864.2	862.2	864.2	857.2	853.2
19°	796.2	793.2	795.2	792.2	795.2
20°	733.2	731.2	731.2	728.2	726.2
22.5°	585.2	584.2	590.2	589.2	583.2
25°	460.1	465.1	472.1	468.1	466.1
27.5°	359.1	366.1	373.1	370.1	372.1
30°	276.1	282.1	291.1	290.1	288.1
32.5°	214.1	217.1	227.1	227.1	221.1
35°	162.0	166.0	175.0	173.0	169.0
37.5°	125.0	129.0	135.0	132.0	128.0
40°	97.0	98.0	103.0	100.0	96.0
42.5°	73.0	76.0	80.0	77.0	72.0
45°	56.0	58.0	62.0	58.0	54.0
47.5°	42.0	45.0	49.0	45.0	41.0
50°	32.0	35.0	39.0	35.0	32.0
52.5°	25.0	27.0	31.0	28.0	26.0
55°	20.0	22.0	25.0	23.0	21.0
57.5°	17.0	18.0	21.0	19.0	18.0
60°	14.0	15.0	18.0	16.0	15.0
62.5°	12.0	13.0	15.0	14.0	13.0
65°	11.0	11.0	13.0	12.0	11.0
67.5°	9.0	10.0	11.0	11.0	10.0
70°	7.0	8.0	10.0	9.0	8.0
72.5°	6.0	7.0	8.0	7.0	6.0
75°	4.0	5.0	6.0	5.0	4.0
77.5°	2.0	3.0	4.0	3.0	2.0
80°	1.0	1.0	2.0	1.0	1.0

TEST NUMBER: P990877

CATALOG NUMBER: ML4ALSFL9FS1E-TIR4D25NFL-TL4SDMB-1000LM-2700K

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)