

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1302961

Luminaire Tested: P3RT05R129024DE010 E3BUS1WMH

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1302961  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3RT05R129024DE010 E3BUS1WMH  
Description: 3in Adjustable LED luminaire with, R12 optic, 2400K CCT AND, 90CRI , E3BUS1WMH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 537.0 lumens  
Efficiency: N/A  
Efficacy: 70.7 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.22  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 7.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1302961  
CATALOG NUMBER: P3RT05R129024DE010 E3BUS1WMH

### Luminous Intensity Polar Plot

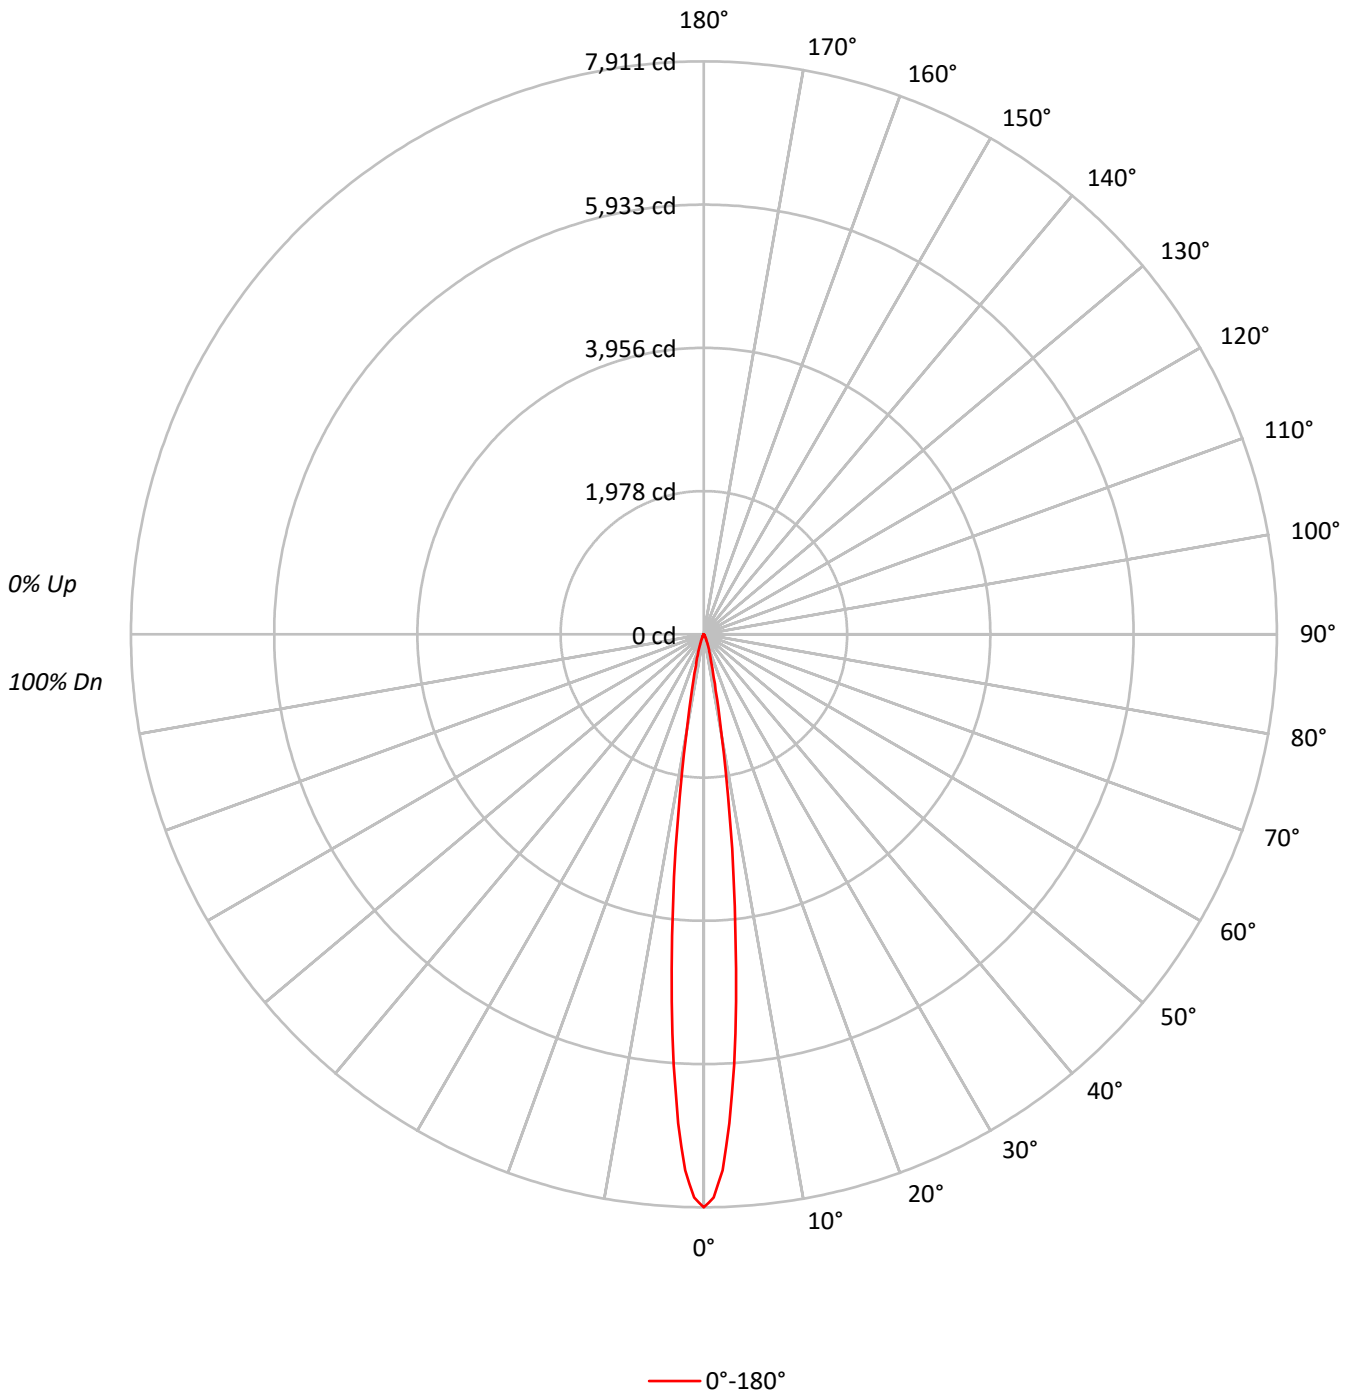



TEST NUMBER: P1302961  
 CATALOG NUMBER: P3RT05R129024DE010 E3BUS1WMH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98	98	98	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97	97	97	97
3	110	107	104	102	109	105	103	101	103	101	99	101	99	98	99	98	96	95	95	95	95
4	108	104	101	98	107	103	100	98	101	99	97	99	97	96	98	96	95	94	94	94	94
5	106	102	98	96	105	101	98	96	99	97	95	98	96	94	96	95	93	92	92	92	92
6	104	99	96	94	103	99	96	94	98	95	93	96	94	93	95	93	92	91	91	91	91
7	102	98	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	90	90	90	90
8	101	96	93	91	100	95	93	90	95	92	90	94	92	90	93	91	90	89	89	89	89
9	99	94	91	89	98	94	91	89	93	91	89	93	90	89	92	90	88	88	88	88	88
10	98	93	90	88	97	93	90	88	92	90	88	91	89	88	91	89	87	87	87	87	87

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1734795
5°	1120908
10°	316271
15°	89422
20°	37383
25°	16549
30°	8457
35°	4470
40°	1918
45°	527
50°	580
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 50°  
 Luminance: 580 cd/sqm



TEST NUMBER: P1302961

CATALOG NUMBER: P3RT05R129024DE010 E3BUS1WMH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	358.8	66.8
10°-20°	130.2	24.2
20°-30°	34.8	6.5
30°-40°	11.0	2.0
40°-50°	2.1	0.4
50°-60°	0.2	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	523.8	97.5
0°-40°	534.8	99.6
0°-60°	537.0	100.0
0°-90°	537.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	537.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7911	
5°	5092	359
15°	394	130
25°	68	35
35°	17	11
45°	2	2
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1302961  
CATALOG NUMBER: P3RT05R129024DE010 E3BUS1WMH

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	7911.3
1°	7777.8
2°	7402.2
3°	6759.6
4°	5961.8
5°	5092.3
6°	4186.0
7°	3374.8
8°	2597.0
9°	1932.8
10°	1420.4
11°	1046.5
12°	787.8
13°	610.9
14°	484.0
15°	393.9
17.5°	250.4
20°	160.2
22.5°	103.5
25°	68.4
27.5°	46.7
30°	33.4
32.5°	23.4
35°	16.7
37.5°	11.7
40°	6.7
42.5°	3.3
45°	1.7
47.5°	1.7
50°	1.7
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1302961  
CATALOG NUMBER: P3RT05R129024DE010 E3BUS1WMH

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)