Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: IRiS

Report Number: P1249134

Luminaire Tested: P3AS13R129027DE010 E3D1MW

Issue Date: 1/30/2026

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1249134
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-24)
Test Lab:	INNOVATION CENTER
Issue Date:	1/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	IRiS
Catalog Number:	P3AS13R129027DE010 E3D1MW
Description:	3in Adjustable LED luminaire with, R12 optic, 2700K CCT AND, 90CRI , E3D1MW TRIM
Light Source:	-
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	1064.0 lumens
Efficiency:	N/A
Efficacy:	68.6 lumens/watt
Spacing Criteria (0/90/45):	0.22 / 0.22 / 0.22
Luminous Opening:	Circular (Dia: 0.25' x H: 0')
CIE Type:	Direct

Input Watts (W):	15.5
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1249134
CATALOG NUMBER: P3AS13R129027DE010 E3D1MW

Luminous Intensity Polar Plot

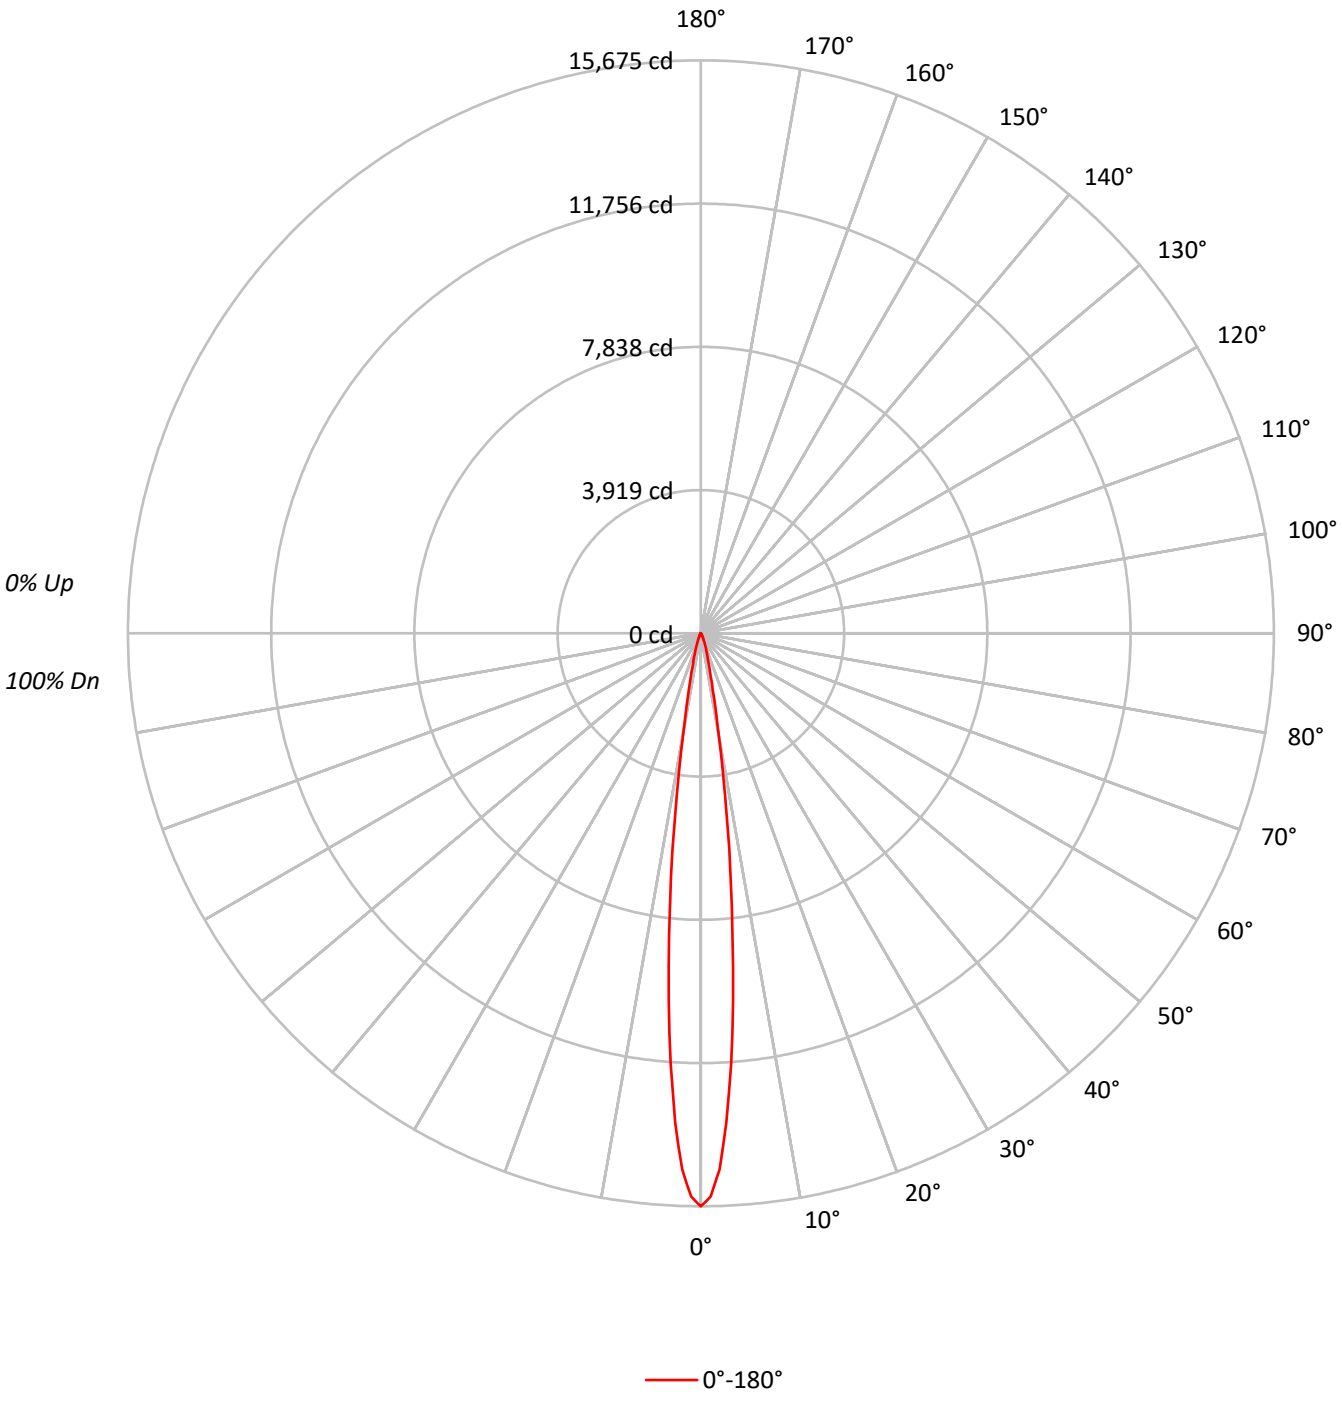

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1249134
CATALOG NUMBER: P3AS13R129027DE010 E3D1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	116	114	113	111	114	112	111	109	108	107	106	104	104	103	101	101	100	98
2	113	110	108	106	111	108	106	104	105	104	102	103	101	100	100	99	98	97
3	110	107	104	102	109	105	103	101	103	101	99	101	99	98	99	98	96	95
4	108	104	101	98	107	103	100	98	101	99	97	99	97	96	98	96	95	94
5	106	102	98	96	105	101	98	96	99	97	95	98	96	94	97	95	93	92
6	104	99	96	94	103	99	96	94	98	95	93	96	94	93	95	93	92	91
7	102	98	94	92	101	97	94	92	96	93	92	95	93	91	94	92	91	90
8	101	96	93	91	100	95	93	90	95	92	90	94	92	90	93	91	90	89
9	99	94	91	89	98	94	91	89	93	91	89	93	90	89	92	90	88	88
10	98	93	90	88	97	93	90	88	92	90	88	91	89	88	91	89	87	87

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3437268
5°	2220928
10°	626642
15°	177186
20°	74090
25°	32808
30°	16737
35°	8861
40°	3779
45°	1023
50°	1126
55°	0
60°	0
65°	0
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 50°
Luminance: 1126 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1249134
CATALOG NUMBER: P3AS13R129027DE010 E3D1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	710.9	66.8
10°-20°	257.9	24.2
20°-30°	69.1	6.5
30°-40°	21.7	2.0
40°-50°	4.1	0.4
50°-60°	0.4	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1037.9	97.5
0°-40°	1059.6	99.6
0°-60°	1064.0	100.0
0°-90°	1064.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1064.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	15675	
5°	10090	711
15°	780	258
25°	136	69
35°	33	22
45°	3	4
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1249134
CATALOG NUMBER: P3AS13R129027DE010 E3D1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	15675.2
1°	15410.7
2°	14666.6
3°	13393.4
4°	11812.7
5°	10089.7
6°	8294.0
7°	6686.8
8°	5145.7
9°	3829.5
10°	2814.3
11°	2073.5
12°	1560.9
13°	1210.4
14°	959.0
15°	780.5
17.5°	496.1
20°	317.5
22.5°	205.0
25°	135.6
27.5°	92.6
30°	66.1
32.5°	46.3
35°	33.1
37.5°	23.1
40°	13.2
42.5°	6.6
45°	3.3
47.5°	3.3
50°	3.3
52.5°	0.0
55°	0.0
57.5°	0.0
60°	0.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1249134
CATALOG NUMBER: P3AS13R129027DE010 E3D1MW

CANDELA DISTRIBUTION (continued):

	0°
90°	*0.0*

(END OF REPORT)