

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1250763

Luminaire Tested: P3AS02R309030DE010 E3CD1MMS

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1250763  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-16)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS02R309030DE010 E3CD1MMS  
Description: 3in Adjustable LED luminaire with, R30 optic, 3000K CCT AND, 90CRI , E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 309.9 lumens  
Efficiency: N/A  
Efficacy: 86.1 lumens/watt  
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.47  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 3.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1250763  
CATALOG NUMBER: P3AS02R309030DE010 E3CD1MMS

### Luminous Intensity Polar Plot

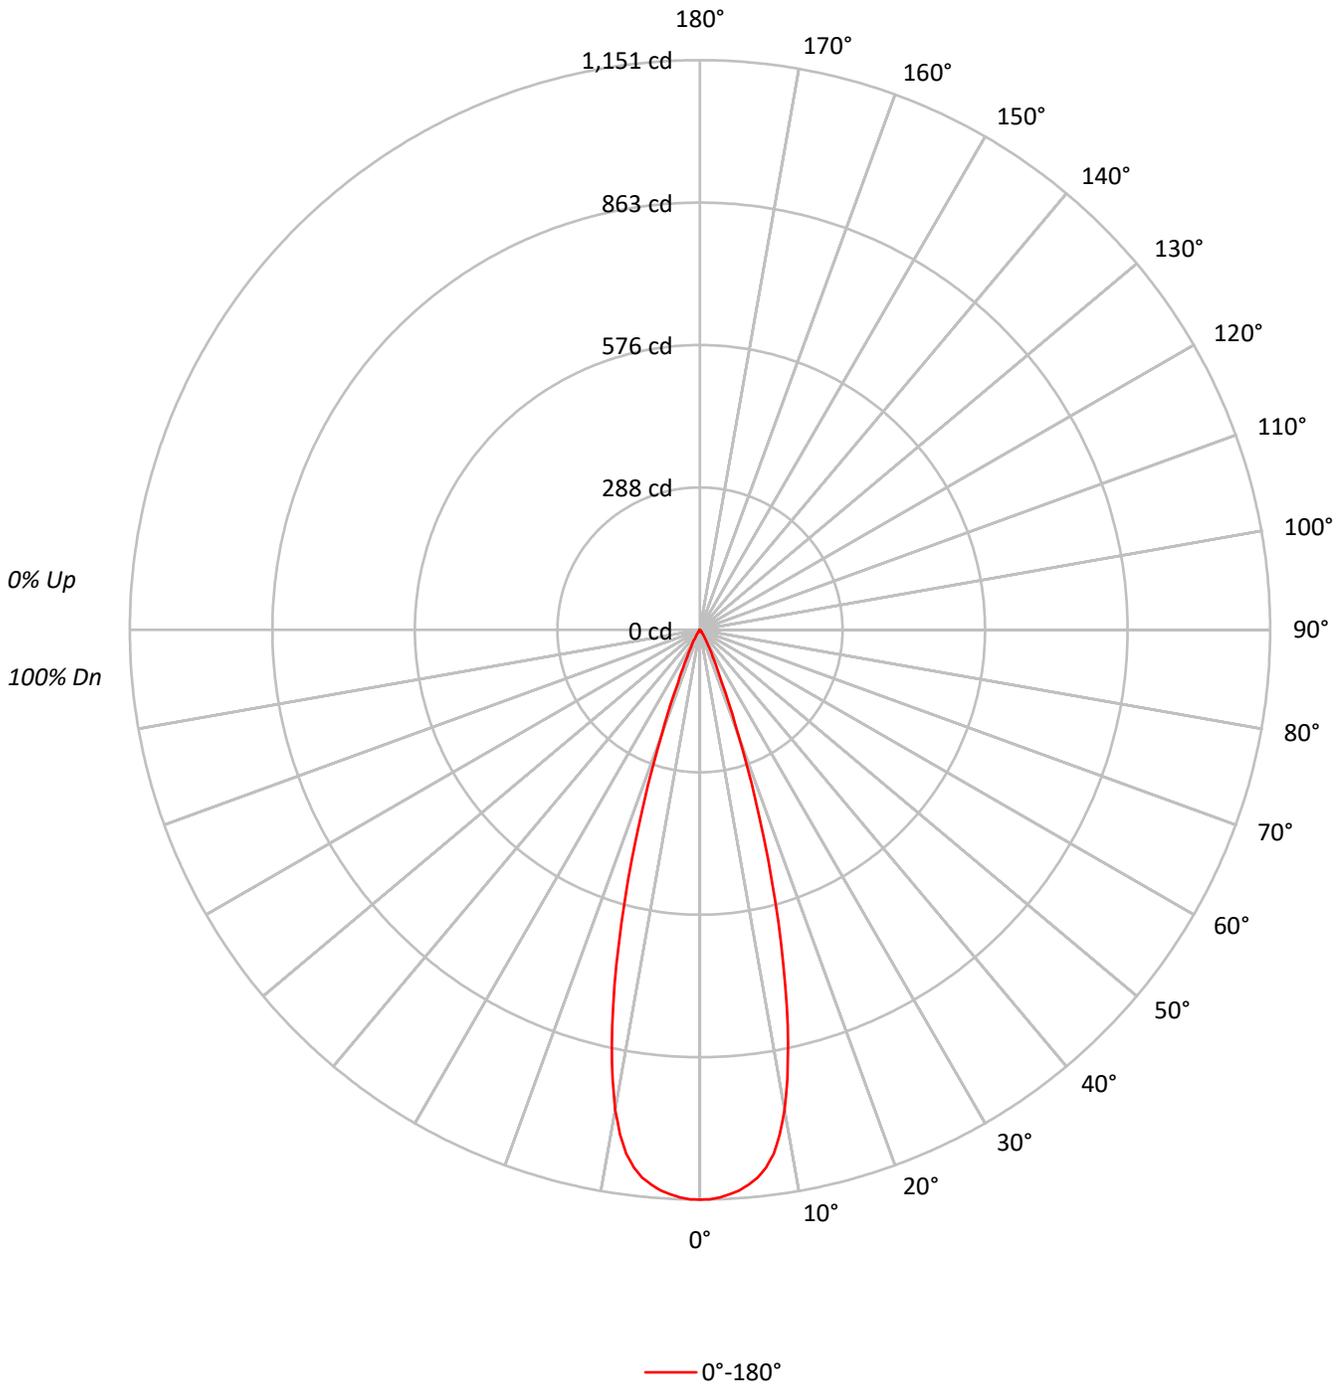



TEST NUMBER: P1250763

CATALOG NUMBER: P3AS02R309030DE010 E3CD1MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	99	98	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	98	96	95	97
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	95	94	92	94
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	94	92	93	91	89	91
4	105	100	96	93	103	99	95	92	97	94	91	95	92	90	93	91	89	93	91	89	88
5	102	96	92	89	100	95	92	89	94	90	88	92	89	87	91	88	87	91	88	87	85
6	99	93	89	86	98	92	88	86	91	88	85	90	87	85	89	86	84	89	86	84	83
7	96	90	86	83	95	89	86	83	88	85	83	87	84	82	86	84	82	86	84	82	81
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	84	82	80	79
9	91	85	81	78	90	84	81	78	84	80	78	83	80	78	82	79	77	82	79	77	77
10	89	83	79	76	88	82	78	76	82	78	76	81	78	76	80	78	75	80	78	75	75

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	252436
5°	247677
10°	219257
15°	138911
20°	52738
25°	15606
30°	6153
35°	1901
40°	830
45°	310
50°	239
55°	191
60°	219
65°	259
70°	128
75°	169
80°	253
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 310 cd/sqm



TEST NUMBER: P1250763  
 CATALOG NUMBER: P3AS02R309030DE010 E3CD1MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	103.4	33.4
10°-20°	161.2	52.0
20°-30°	37.4	12.1
30°-40°	5.8	1.9
40°-50°	1.0	0.3
50°-60°	0.5	0.2
60°-70°	0.4	0.1
70°-80°	0.2	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	302.1	97.5
0°-40°	307.9	99.3
0°-60°	309.3	99.8
0°-90°	309.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	309.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1151	
5°	1125	103
15°	612	161
25°	64	37
35°	7	6
45°	1	1
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1250763  
CATALOG NUMBER: P3AS02R309030DE010 E3CD1MMS

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1151.2
1°	1150.5
2°	1147.3
3°	1142.0
4°	1135.2
5°	1125.2
6°	1112.8
7°	1094.3
8°	1068.9
9°	1031.7
10°	984.7
11°	924.1
12°	855.6
13°	779.7
14°	696.1
15°	611.9
17.5°	400.3
20°	226.0
22.5°	115.4
25°	64.5
27.5°	39.7
30°	24.3
32.5°	13.1
35°	7.1
37.5°	4.6
40°	2.9
42.5°	1.7
45°	1.0
47.5°	0.7
50°	0.7
52.5°	0.5
55°	0.5
57.5°	0.5
60°	0.5
62.5°	0.5
65°	0.5
67.5°	0.2
70°	0.2
72.5°	0.2
75°	0.2
77.5°	0.2
80°	0.2
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1250763  
CATALOG NUMBER: P3AS02R309030DE010 E3CD1MMS

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)