

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1251919

Luminaire Tested: P3AS13R259030DE010 E3CB1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1251919  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-12)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS13R259030DE010 E3CB1MW  
Description: 3in Adjustable LED luminaire with, R25 optic, 3000K CCT AND, 90CRI , E3CB1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1237.0 lumens  
Efficiency: N/A  
Efficacy: 84.7 lumens/watt  
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.41  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1251919

CATALOG NUMBER: P3AS13R259030DE010 E3CB1MW

### Luminous Intensity Polar Plot

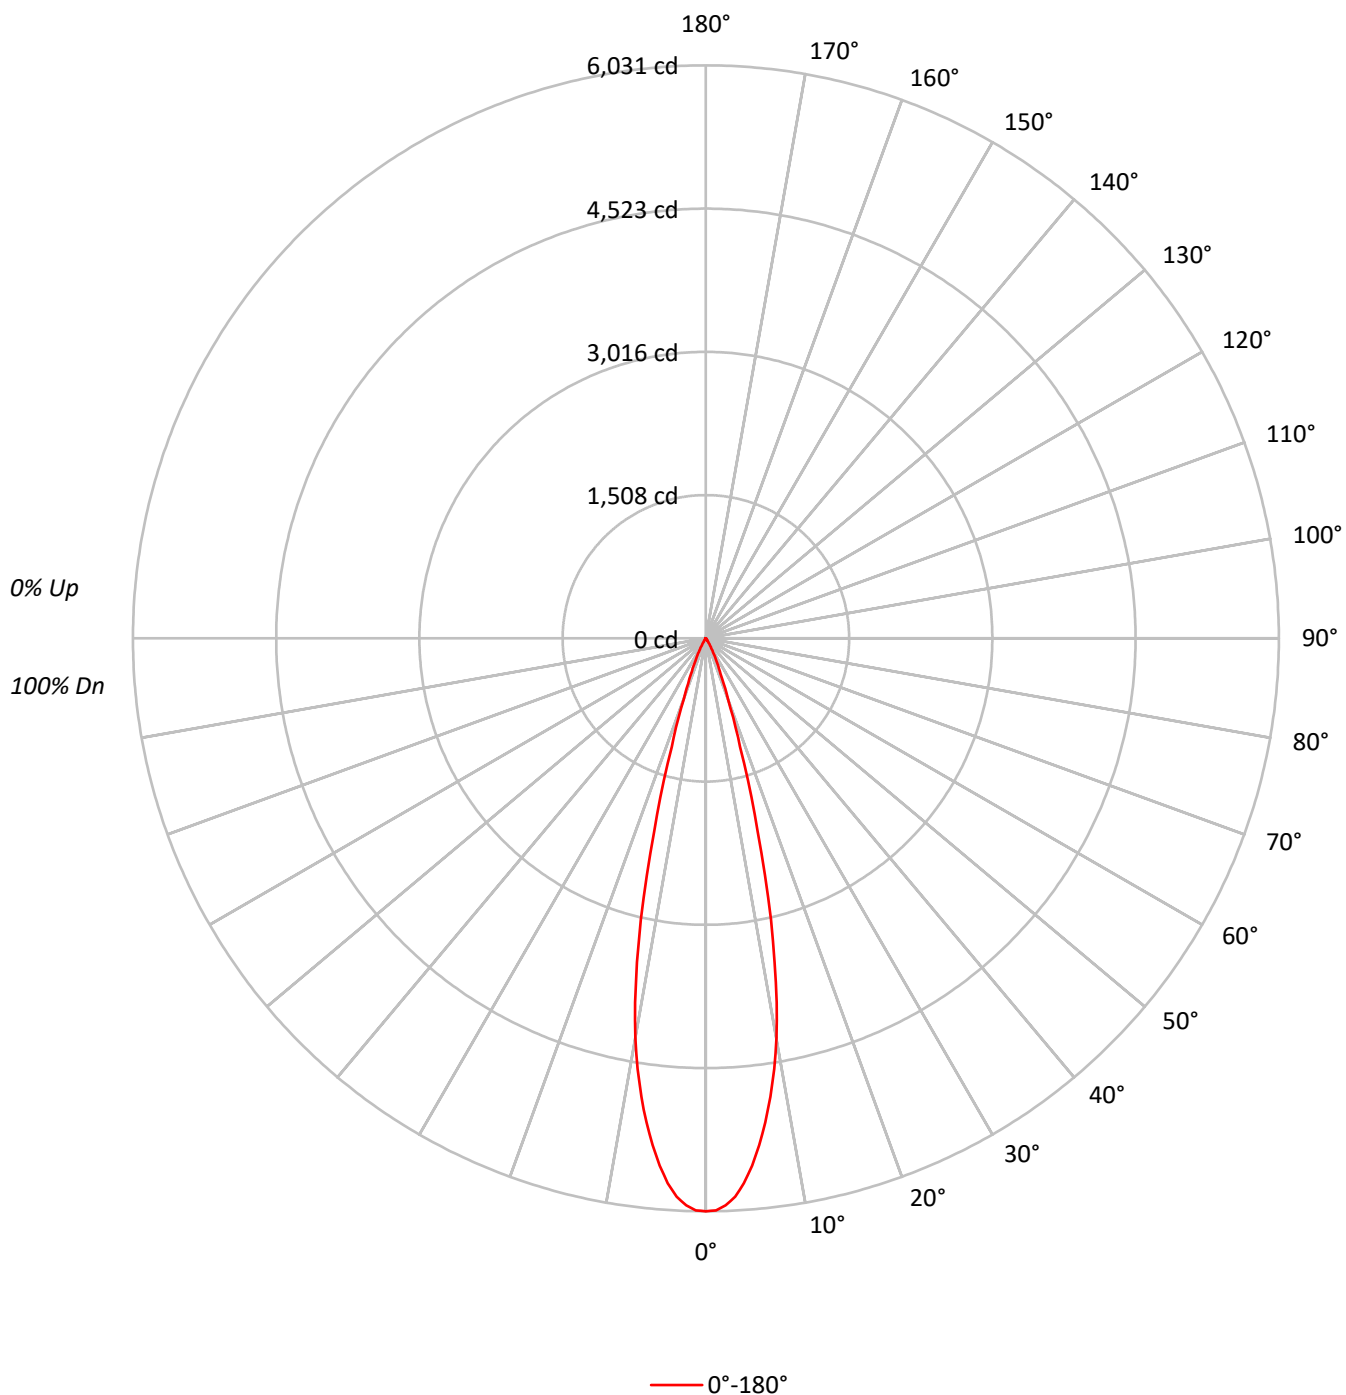

TEST NUMBER: P1251919

CATALOG NUMBER: P3AS13R259030DE010 E3CB1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 99 | 99 |
| 1   | 115 | 113 | 111 | 110 | 113 | 111 | 109 | 108 | 107 | 106 | 105 | 103 | 103 | 102 | 100 | 99  | 99  | 97  | 96 | 96 |
| 2   | 112 | 108 | 105 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 | 101 | 99  | 98  | 98  | 97  | 96  | 94  | 93 | 93 |
| 3   | 108 | 104 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 98  | 96  | 98  | 96  | 94  | 96  | 94  | 93  | 92  | 91 | 91 |
| 4   | 105 | 100 | 97  | 94  | 104 | 99  | 96  | 93  | 97  | 95  | 92  | 96  | 93  | 91  | 94  | 92  | 90  | 89  | 88 | 88 |
| 5   | 103 | 97  | 93  | 90  | 101 | 96  | 93  | 90  | 95  | 92  | 89  | 93  | 91  | 89  | 92  | 90  | 88  | 87  | 86 | 86 |
| 6   | 100 | 94  | 90  | 87  | 99  | 93  | 90  | 87  | 92  | 89  | 87  | 91  | 88  | 86  | 90  | 87  | 86  | 85  | 84 | 84 |
| 7   | 97  | 91  | 88  | 85  | 96  | 91  | 87  | 85  | 90  | 87  | 84  | 89  | 86  | 84  | 88  | 85  | 83  | 83  | 82 | 82 |
| 8   | 95  | 89  | 85  | 83  | 94  | 89  | 85  | 82  | 88  | 84  | 82  | 87  | 84  | 82  | 86  | 83  | 81  | 81  | 80 | 80 |
| 9   | 93  | 87  | 83  | 80  | 92  | 86  | 83  | 80  | 86  | 82  | 80  | 85  | 82  | 80  | 84  | 82  | 80  | 79  | 78 | 78 |
| 10  | 91  | 85  | 81  | 78  | 90  | 84  | 81  | 78  | 84  | 80  | 78  | 83  | 80  | 78  | 82  | 80  | 78  | 77  | 76 | 76 |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1322526 |
| 5°  | 1226609 |
| 10° | 951263  |
| 15° | 476983  |
| 20° | 156697  |
| 25° | 62302   |
| 30° | 23371   |
| 35° | 6773    |
| 40° | 3063    |
| 45° | 1209    |
| 50° | 989     |
| 55° | 726     |
| 60° | 833     |
| 65° | 986     |
| 70° | 641     |
| 75° | 847     |
| 80° | 1263    |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 80°

Luminance: 1263 cd/sqm

TEST NUMBER: P1251919

CATALOG NUMBER: P3AS13R259030DE010 E3CB1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 490.1  | 39.6      |
| 10°-20°   | 584.8  | 47.3      |
| 20°-30°   | 131.8  | 10.7      |
| 30°-40°   | 21.4   | 1.7       |
| 40°-50°   | 3.9    | 0.3       |
| 50°-60°   | 2.0    | 0.2       |
| 60°-70°   | 1.8    | 0.1       |
| 70°-80°   | 1.1    | 0.1       |
| 80°-90°   | 0.1    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1206.7 | 97.6      |
| 0°-40°    | 1228.1 | 99.3      |
| 0°-60°    | 1234.0 | 99.8      |
| 0°-90°    | 1237.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1237.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 6031 |      |
| 5°  | 5572 | 490  |
| 15° | 2101 | 585  |
| 25° | 258  | 132  |
| 35° | 25   | 21   |
| 45° | 4    | 4    |
| 55° | 2    | 2    |
| 65° | 2    | 2    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1251919

CATALOG NUMBER: P3AS13R259030DE010 E3CB1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 6031.2 |
| 1°    | 6021.5 |
| 2°    | 5972.9 |
| 3°    | 5883.5 |
| 4°    | 5748.4 |
| 5°    | 5572.5 |
| 6°    | 5362.6 |
| 7°    | 5135.2 |
| 8°    | 4874.7 |
| 9°    | 4590.0 |
| 10°   | 4272.2 |
| 11°   | 3905.8 |
| 12°   | 3484.0 |
| 13°   | 3042.8 |
| 14°   | 2569.5 |
| 15°   | 2101.1 |
| 17.5° | 1197.3 |
| 20°   | 671.5  |
| 22.5° | 405.3  |
| 25°   | 257.5  |
| 27.5° | 158.4  |
| 30°   | 92.3   |
| 32.5° | 48.6   |
| 35°   | 25.3   |
| 37.5° | 16.5   |
| 40°   | 10.7   |
| 42.5° | 6.8    |
| 45°   | 3.9    |
| 47.5° | 2.9    |
| 50°   | 2.9    |
| 52.5° | 2.9    |
| 55°   | 1.9    |
| 57.5° | 1.9    |
| 60°   | 1.9    |
| 62.5° | 1.9    |
| 65°   | 1.9    |
| 67.5° | 1.9    |
| 70°   | 1.0    |
| 72.5° | 1.0    |
| 75°   | 1.0    |
| 77.5° | 1.0    |
| 80°   | 1.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |



TEST NUMBER: P1251919

CATALOG NUMBER: P3AS13R259030DE010 E3CB1MW

CANDELA DISTRIBUTION (continued):



(END OF REPORT)