

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1251949

Luminaire Tested: P3AS13R309030DE010 E3CB1MB

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1251949  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-16)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS13R309030DE010 E3CB1MB  
Description: 3in Adjustable LED luminaire with, R30 optic, 3000K CCT AND, 90CRI , E3CB1MB TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1237.0 lumens  
Efficiency: N/A  
Efficacy: 84.7 lumens/watt  
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.47  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 14.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1251949  
CATALOG NUMBER: P3AS13R309030DE010 E3CB1MB

### Luminous Intensity Polar Plot

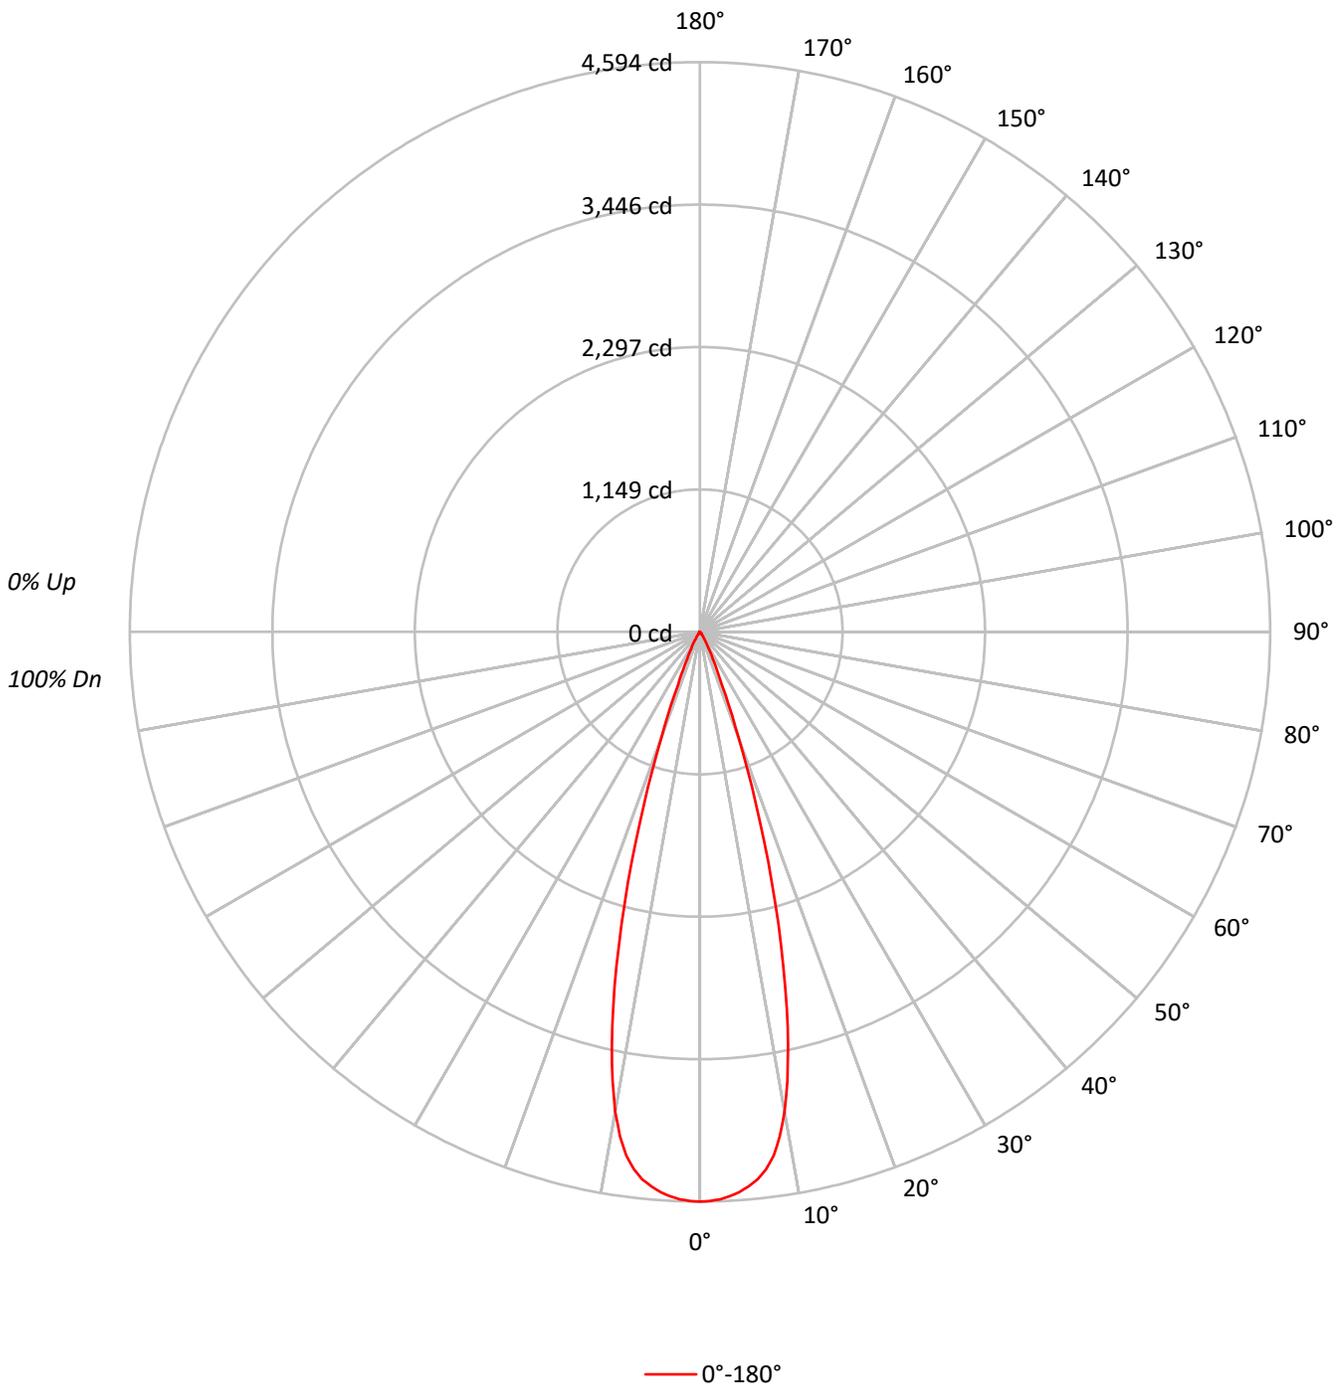



TEST NUMBER: P1251949  
 CATALOG NUMBER: P3AS13R309030DE010 E3CB1MB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 115 | 113 | 111 | 109 | 113 | 111 | 109 | 108 | 107 | 106 | 104 | 103 | 102 | 101 | 100 | 99  | 98  | 98  | 97  | 97  | 97  |
| 2   | 111 | 108 | 105 | 102 | 109 | 106 | 104 | 101 | 103 | 101 | 99  | 100 | 99  | 97  | 98  | 96  | 95  | 95  | 94  | 94  | 94  |
| 3   | 108 | 103 | 100 | 97  | 106 | 102 | 99  | 96  | 100 | 97  | 95  | 97  | 95  | 93  | 95  | 94  | 92  | 93  | 91  | 91  | 91  |
| 4   | 105 | 100 | 96  | 93  | 103 | 99  | 95  | 92  | 97  | 94  | 91  | 95  | 92  | 90  | 93  | 91  | 89  | 93  | 91  | 89  | 88  |
| 5   | 102 | 96  | 92  | 89  | 100 | 95  | 91  | 89  | 94  | 90  | 88  | 92  | 89  | 87  | 91  | 88  | 87  | 91  | 88  | 87  | 85  |
| 6   | 99  | 93  | 89  | 86  | 98  | 92  | 88  | 86  | 91  | 88  | 85  | 90  | 87  | 85  | 89  | 86  | 84  | 89  | 86  | 84  | 83  |
| 7   | 96  | 90  | 86  | 83  | 95  | 89  | 86  | 83  | 88  | 85  | 82  | 87  | 84  | 82  | 86  | 84  | 82  | 86  | 84  | 82  | 81  |
| 8   | 94  | 87  | 83  | 81  | 93  | 87  | 83  | 80  | 86  | 83  | 80  | 85  | 82  | 80  | 84  | 82  | 80  | 84  | 82  | 80  | 79  |
| 9   | 91  | 85  | 81  | 78  | 90  | 84  | 81  | 78  | 84  | 80  | 78  | 83  | 80  | 78  | 82  | 79  | 77  | 82  | 79  | 77  | 77  |
| 10  | 89  | 83  | 79  | 76  | 88  | 82  | 78  | 76  | 82  | 78  | 76  | 81  | 78  | 76  | 80  | 77  | 75  | 80  | 77  | 75  | 75  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1007332 |
| 5°  | 988309  |
| 10° | 874889  |
| 15° | 554305  |
| 20° | 210415  |
| 25° | 62302   |
| 30° | 24611   |
| 35° | 7549    |
| 40° | 3349    |
| 45° | 1209    |
| 50° | 989     |
| 55° | 726     |
| 60° | 833     |
| 65° | 986     |
| 70° | 641     |
| 75° | 847     |
| 80° | 1263    |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 80°  
 Luminance: 1263 cd/sqm



TEST NUMBER: P1251949  
 CATALOG NUMBER: P3AS13R309030DE010 E3CB1MB

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 412.7  | 33.4      |
| 10°-20°   | 643.2  | 52.0      |
| 20°-30°   | 149.4  | 12.1      |
| 30°-40°   | 23.2   | 1.9       |
| 40°-50°   | 4.0    | 0.3       |
| 50°-60°   | 1.8    | 0.1       |
| 60°-70°   | 1.5    | 0.1       |
| 70°-80°   | 1.1    | 0.1       |
| 80°-90°   | 0.1    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1205.3 | 97.4      |
| 0°-40°    | 1228.5 | 99.3      |
| 0°-60°    | 1234.3 | 99.8      |
| 0°-90°    | 1237.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1237.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 4594 |      |
| 5°  | 4490 | 413  |
| 15° | 2442 | 643  |
| 25° | 258  | 149  |
| 35° | 28   | 23   |
| 45° | 4    | 4    |
| 55° | 2    | 2    |
| 65° | 2    | 2    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P1251949  
CATALOG NUMBER: P3AS13R309030DE010 E3CB1MB

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 4593.8 |
| 1°    | 4590.9 |
| 2°    | 4578.3 |
| 3°    | 4556.9 |
| 4°    | 4529.7 |
| 5°    | 4489.9 |
| 6°    | 4440.3 |
| 7°    | 4366.5 |
| 8°    | 4265.4 |
| 9°    | 4116.7 |
| 10°   | 3929.2 |
| 11°   | 3687.3 |
| 12°   | 3414.3 |
| 13°   | 3111.1 |
| 14°   | 2777.9 |
| 15°   | 2441.7 |
| 17.5° | 1597.3 |
| 20°   | 901.7  |
| 22.5° | 460.5  |
| 25°   | 257.5  |
| 27.5° | 158.4  |
| 30°   | 97.2   |
| 32.5° | 52.5   |
| 35°   | 28.2   |
| 37.5° | 18.5   |
| 40°   | 11.7   |
| 42.5° | 6.8    |
| 45°   | 3.9    |
| 47.5° | 2.9    |
| 50°   | 2.9    |
| 52.5° | 1.9    |
| 55°   | 1.9    |
| 57.5° | 1.9    |
| 60°   | 1.9    |
| 62.5° | 1.9    |
| 65°   | 1.9    |
| 67.5° | 1.0    |
| 70°   | 1.0    |
| 72.5° | 1.0    |
| 75°   | 1.0    |
| 77.5° | 1.0    |
| 80°   | 1.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |



TEST NUMBER: P1251949  
CATALOG NUMBER: P3AS13R309030DE010 E3CB1MB

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)