

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1252098

Luminaire Tested: P3AS13R559030DE010 E3D1H

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1252098
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-14)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS13R559030DE010 E3D1H
Description: 3in Adjustable LED luminaire with, R55 optic, 3000K CCT AND, 90CRI , E3D1H TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1254.0 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 0.93 / 0.93 / 0.82
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 14.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1252098
CATALOG NUMBER: P3AS13R559030DE010 E3D1H

Luminous Intensity Polar Plot

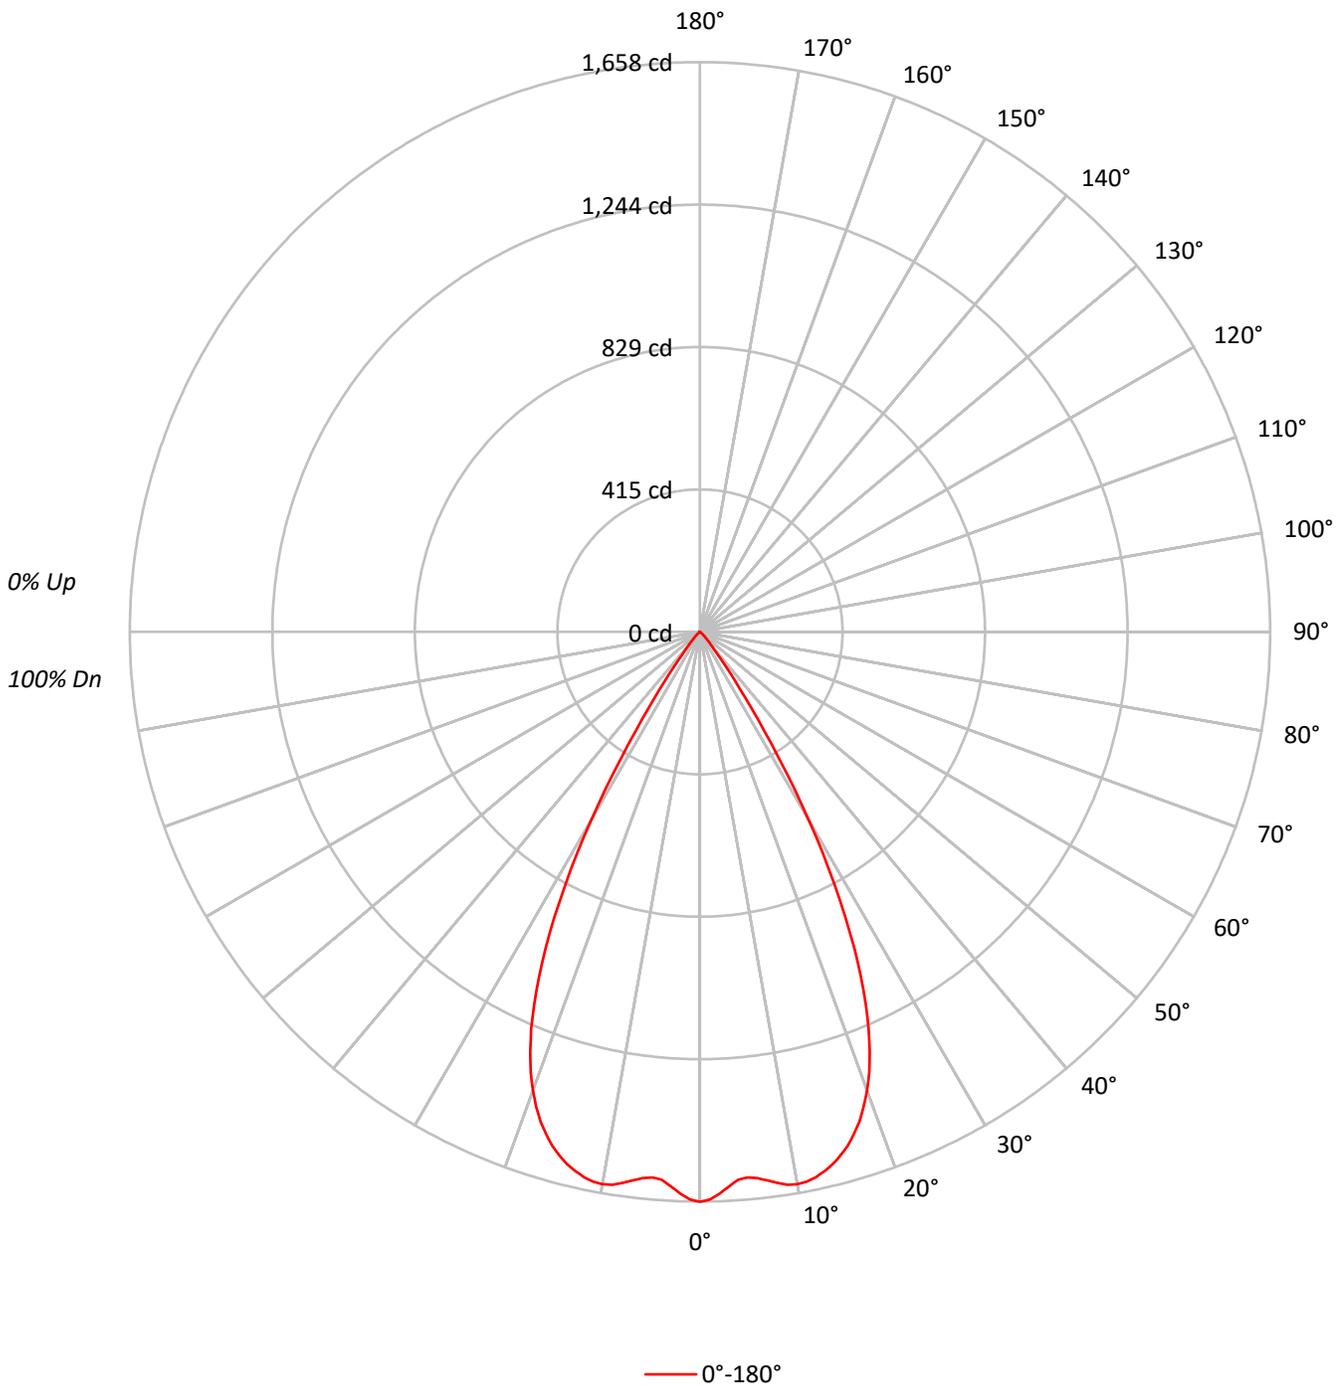



TEST NUMBER: P1252098

CATALOG NUMBER: P3AS13R559030DE010 E3D1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | |
| RCR | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | 100 |
| 1 | 114 | 111 | 109 | 107 | 112 | 109 | 107 | 105 | 105 | 104 | 102 | 102 | 100 | 99 | 98 | 97 | 96 | 95 | | | | 95 |
| 2 | 109 | 105 | 101 | 98 | 107 | 103 | 100 | 97 | 100 | 97 | 95 | 97 | 95 | 93 | 94 | 92 | 91 | 89 | | | | 89 |
| 3 | 104 | 98 | 94 | 90 | 102 | 97 | 93 | 90 | 95 | 91 | 88 | 92 | 89 | 87 | 90 | 88 | 86 | 84 | | | | 84 |
| 4 | 100 | 93 | 88 | 84 | 98 | 92 | 87 | 84 | 90 | 86 | 83 | 88 | 84 | 82 | 86 | 83 | 81 | 79 | | | | 79 |
| 5 | 95 | 88 | 82 | 79 | 94 | 87 | 82 | 78 | 85 | 81 | 78 | 84 | 80 | 77 | 82 | 79 | 76 | 75 | | | | 75 |
| 6 | 91 | 83 | 78 | 74 | 90 | 82 | 77 | 74 | 81 | 76 | 73 | 80 | 76 | 73 | 78 | 75 | 72 | 71 | | | | 71 |
| 7 | 87 | 79 | 73 | 70 | 86 | 78 | 73 | 69 | 77 | 72 | 69 | 76 | 72 | 69 | 75 | 71 | 68 | 67 | | | | 67 |
| 8 | 83 | 75 | 69 | 66 | 82 | 74 | 69 | 66 | 73 | 69 | 65 | 72 | 68 | 65 | 71 | 68 | 65 | 63 | | | | 63 |
| 9 | 80 | 71 | 66 | 62 | 79 | 71 | 66 | 62 | 70 | 65 | 62 | 69 | 65 | 62 | 68 | 64 | 61 | 60 | | | | 60 |
| 10 | 77 | 68 | 62 | 59 | 76 | 67 | 62 | 59 | 67 | 62 | 59 | 66 | 62 | 59 | 65 | 61 | 58 | 57 | | | | 57 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 363655 |
| 5° | 350781 |
| 10° | 363320 |
| 15° | 358186 |
| 20° | 331502 |
| 25° | 268104 |
| 30° | 160683 |
| 35° | 54449 |
| 40° | 15000 |
| 45° | 6636 |
| 50° | 1944 |
| 55° | 382 |
| 60° | 219 |
| 65° | 259 |
| 70° | 321 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6636 cd/sqm



TEST NUMBER: P1252098
 CATALOG NUMBER: P3AS13R559030DE010 E3D1H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 154.2 | 12.3 |
| 10°-20° | 439.3 | 35.0 |
| 20°-30° | 488.3 | 38.9 |
| 30°-40° | 152.0 | 12.1 |
| 40°-50° | 18.2 | 1.5 |
| 50°-60° | 1.4 | 0.1 |
| 60°-70° | 0.5 | 0.0 |
| 70°-80° | 0.1 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1081.8 | 86.3 |
| 0°-40° | 1233.8 | 98.4 |
| 0°-60° | 1253.5 | 100.0 |
| 0°-90° | 1254.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1254.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1658 | |
| 5° | 1594 | 154 |
| 15° | 1578 | 439 |
| 25° | 1108 | 488 |
| 35° | 203 | 152 |
| 45° | 21 | 18 |
| 55° | 1 | 1 |
| 65° | 0 | 0 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P1252098
CATALOG NUMBER: P3AS13R559030DE010 E3D1H

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 1658.4 |
| 1° | 1652.2 |
| 2° | 1636.0 |
| 3° | 1616.0 |
| 4° | 1597.9 |
| 5° | 1593.6 |
| 6° | 1598.3 |
| 7° | 1608.3 |
| 8° | 1619.8 |
| 9° | 1628.8 |
| 10° | 1631.7 |
| 11° | 1629.8 |
| 12° | 1622.2 |
| 13° | 1610.2 |
| 14° | 1596.4 |
| 15° | 1577.8 |
| 16° | 1556.4 |
| 17° | 1529.3 |
| 18° | 1498.8 |
| 19° | 1462.1 |
| 20° | 1420.6 |
| 21° | 1373.5 |
| 22° | 1317.7 |
| 23° | 1256.3 |
| 24° | 1185.8 |
| 25° | 1108.1 |
| 26° | 1022.8 |
| 27° | 932.3 |
| 28° | 835.6 |
| 29° | 736.0 |
| 30° | 634.6 |
| 31° | 532.6 |
| 32° | 433.0 |
| 32.5° | 388.7 |
| 33° | 343.0 |
| 34° | 265.4 |
| 35° | 203.4 |
| 36° | 154.8 |
| 37° | 114.8 |
| 37.5° | 98.1 |
| 38° | 85.3 |
| 39° | 64.8 |
| 40° | 52.4 |
| 42.5° | 33.3 |
| 45° | 21.4 |



TEST NUMBER: P1252098
CATALOG NUMBER: P3AS13R559030DE010 E3D1H

CANDELA DISTRIBUTION (continued):

| | 0° |
|-------|------|
| 47.5° | 12.9 |
| 50° | 5.7 |
| 52.5° | 1.9 |
| 55° | 1.0 |
| 57.5° | 0.5 |
| 60° | 0.5 |
| 62.5° | 0.5 |
| 65° | 0.5 |
| 67.5° | 0.5 |
| 70° | 0.5 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

(END OF REPORT)